

OHIO SCHOOL
FACILITIES
COMMISSION

2010
OHIO
SCHOOL
DESIGN
MANUAL



The Ohio School Facilities Commission is pleased to announce the 2010 Ohio School Design Manual (OSDM) update.

Each year the Commission revises the OSDM with support and valuable input from the design and construction community, school districts, state agencies and other interested parties. The result is a dynamic document that reinforces our commitment to high quality school facilities while maintaining flexibility and local control.

The manual is a cornerstone of the Commission's efforts to promote the 21st century learning environment, providing guidelines that serve the diverse needs of local school communities and their students. For our Design Professionals, the OSDM provides a wide selection of high quality materials and systems to serve the districts over the entire lifecycle of the building. This approach ensures that both the district and the taxpayers of Ohio achieve the maximum benefit from their investment.

Ohio continues to build on past design achievements that meet the U.S. Green Building Council's Leadership in Energy and Environmental Design (LEED) for Schools. The LEED system is the national benchmark for high performance green buildings.

The OSFC acknowledges the difficult design and construction tasks that ultimately result in the buildings so critical to our Ohio communities and the new educational goals set by Governor Strickland. There is a necessary balance measured between the complexity and cost of 21st century structures and the sustainability and maintenance requirements to be born by local taxpayers for decades to come. The OSFC will be guided by best practices, mindful that what we build today must last.

We look forward to working with you to design and build exciting educational environments for Ohio school students.

Sincerely,

Ohio School Facilities Commission

Richard C. Murray
Executive Director

FOREWORD

THIS PAGE HAS BEEN INTENTIONALLY LEFT BLANK.

OHIO SCHOOL DESIGN MANUAL

Ohio School Facilities Commission

TABLE OF CONTENTS

0100 Foreword
0200 Table of Contents

VOLUME ONE

Chapter 1: Introduction

1000	Executive Summary
1010	Introduction
1020	<i>Overview of the Planning, Design, and Construction Process</i>
1030	<i>Design Manual Organization</i>
1040	<i>Highlights of Planning and Funding Parameters</i>
1050	Community Engagement
1060	Special Education Program Summary
1070	Career-Technical Education Summary
1100	Educational Programming
1110	Special Education Program Overview
1200	<i>Cost Information</i>
1300	Definitions
1400	<i>Abbreviations</i>

Chapter 2: Bracketing

2000	Introduction
	<u>Summary of Spaces</u>
2100	Elementary Schools
2200	Middle Schools
2300	High Schools
2400	K – 12 Combination Schools
2500	K – 8 Combination Schools
2600	6 – 12 Combination Schools

Chapter 2: Bracketing (Career-Technical)

2700	Introduction
	<u>Summary of Spaces</u>
2800	<i>Career-Technical School</i>
2900	<i>Comprehensive K-12 / CT School</i>
2925	<i>Comprehensive 6–12 / CT School</i>
2950	<i>Comprehensive 9–12 / CT School</i>

Chapter 3: School Site

3000	Introduction
	<u>Site Selection Criteria</u>
3100	Introduction
3101	Site/Size
3102	Topography
3103	Vehicular Access
3104	Soil Characteristics

TABLE OF CONTENTS (cont.)

3105	<i>Site Utilities</i>
3106	Site Preparation
3107	Codes and Zoning
3108	Adjacent Property Facilities
3109	Easements/Rights-of-Way
3110	Environmental Restrictions
3111	Testing
3112	Aesthetic Consideration
	<u>Site Design</u>
3200	Introduction
3201	Vehicular Circulation
3202	Pedestrian Circulation
3203	Emergency Vehicle Circulation
3204	Bicycle Circulation
3205	Storm Drainage
3206	Sanitary Sewerage
3207	Directional Signage
3208	Physical Education Facilities
3209	Playground
3210	Fencing
3211	<i>Lighting</i>
3212	Mechanical/Electrical Yard
3213	Landscaping
3214	Site Furnishings
3215	Site Security Provisions
	<u>Elementary School Site Design</u>
3301	Vehicular Circulation
3302	Physical Education Facilities
3303	Playground
	<u>Middle School Site Design</u>
3401	Vehicular Circulation
3402	Physical Education Facilities
3403	Playground
	<u>High School Site Design</u>
3501	Vehicular Circulation
3502	Physical Education Facilities
	<u>Combination School Site Design</u>
3601	Vehicular Circulation
3602	Physical Education Facilities
3603	Playground
	<u>Career-Technical School Site Design</u>
3701	Vehicular Circulation

TABLE OF CONTENTS (cont.)

Chapter 4: Elementary School

4000	<i>Introduction</i>	
4100		Spatial Relationship Diagram
		<u>Academic Core Spaces</u>
4101	E-AC	Spatial Relationship Diagram
	<i>E-AC-1</i>	<i>Pre-K/Kindergarten Classroom</i>
	E-AC-2	Pre-K/Kindergarten Restroom
	<i>E-AC-3</i>	<i>Elementary Classroom</i>
	<i>E-AC-4</i>	<i>Teacher Prep Area/Workroom</i>
	E-AC-5	Individual Restroom
	<i>E-AC-6</i>	<i>Instructional Material Storage</i>
		<u>Special Education Spaces</u>
4102	E-SE	Spatial Relationship Diagram
	<i>E-SE-1</i>	<i>Self-contained Classroom</i>
	<i>E-SE-2</i>	<i>Workroom/Conference</i>
	E-SE-3	Restroom/Shower
	<i>E-SE-4</i>	<i>Special Education/Resource</i>
	<i>E-SE-5</i>	<i>Small Self-Contained Classroom</i>
		<u>Administrative Spaces</u>
4103	E-AD	Spatial Relationship Diagram
	E-AD-1	Reception Area
	E-AD-2	Secretarial Area
	E-AD-3	Principal's Office
	<i>E-AD-4</i>	<i>Assistant Principal's Office</i>
	E-AD-5	Conference Room
	<i>E-AD-6</i>	<i>Mail/Work/Copy Room</i>
	<i>E-AD-7</i>	<i>Administrative Storage</i>
	<i>E-AD-8</i>	<i>Vault/Records Storage</i>
	<i>E-AD-9</i>	<i>In-school Suspension</i>
	E-AD-10	Restroom
	E-AD-11	Guidance Counselor's Office
	<i>E-AD-12</i>	<i>Guidance Records/Storage</i>
	E-AD-13	Parent/Volunteer Room
	<i>E-AD-14</i>	<i>Health Clinic (includes restroom)</i>
	E-AD-15	Itinerant Personnel Office
		<u>Media Center Spaces</u>
4104	E-MC	Spatial Relationship Diagram
	<i>E-MC-1</i>	<i>Reading Room/Circulation</i>
	E-MC-2	Media Specialist Office
	<i>E-MC-3</i>	<i>Workroom/Storage</i>
	<i>E-MC-4</i>	<i>Main Control/Equipment Room</i>
	E-MC-5	Computer Lab
	<i>E-MC-6</i>	<i>A/V Storage</i>
	E-MC-7	Conference Room

TABLE OF CONTENTS (cont.)

4105	E-VA E-VA-1 E-VA-2 E-VA-3	<u>Visual Arts Spaces</u> Spatial Relationship Diagram Art Room Kiln/Ceramic Storage Art Material Storage
4106	E-MU E-MU-1	<u>Music Spaces</u> Spatial Relationship Diagram Music Room
4107	E-PE E-PE-1 E-PE-2	<u>Physical Education Spaces</u> Spatial Relationship Diagram Gymnasium P.E. Workroom/Storage
4108	E-SD E-SD-1 E-SD-2 E-SD-3 E-SD-4 E-SD-5	<u>Student Dining Spaces</u> Spatial Relationship Diagram Student Dining Stage Staff Dining Table Storage Family Restroom
4109	E-FS E-FS-1 E-FS-0 E-FS-1a E-FS-1b E-FS-1c E-FS-1d E-FS-1e E-FS-2 E-FS-3 E-FS-4	<u>Food Service Spaces</u> Spatial Relationship Diagram Kitchen Warming Kitchen Preparation Area Serving Area Dry Food Storage Cooler/Freezer Ware Washing Dietician's Office Restroom / Locker Room Locker Room
4110	E-CU E-CU-1 E-CU-2	<u>Custodial Spaces</u> Spatial Relationship Diagram Workroom Custodial Office
4111	E-BS-1 E-BS-2 E-BS-3 E-BS-4 E-BS-5 E-BS-6 E-BS-7 E-BS-8 E-BS-9 E-BS-10	<u>Building Services</u> Large Group Restrooms Custodial Closet Electrical Closet Telecommunications Room Corridors Mechanical /Electrical Space/Decks Storage Area Central Storage Area Loading/Receiving Area Restroom

TABLE OF CONTENTS (cont.)

Chapter 5: Middle School

5000	<i>Introduction</i>	
5100	Spatial Relationship Diagram	<u>Academic Core Spaces</u>
5101	M-AC	Spatial Relationship Diagram
	M-AC-1	Middle School Classroom
	M-AC-2	Project Laboratory
	M-AC-3	Teacher Prep Area/Workroom
	M-AC-4	Individual Restroom
	M-AC-5	Instructional Material Storage
	M-AC-6	Small Group Room
		<u>Special Education Spaces</u>
5102	M-SE	Spatial Relationship Diagram
	M-SE-1	Self-contained Classroom
	M-SE-2	Workroom/Conference
	M-SE-3	Restroom/Shower
	M-SE-4	Special Education/Resource
	M-SE-5	Small Self-Contained Classroom
		<u>Administrative Spaces</u>
5103	M-AD	Spatial Relationship Diagram
	M-AD-1	Reception Area
	M-AD-2	Secretarial Area
	M-AD-3	Principal's Office
	M-AD-4	Assistant Principal's Office
	M-AD-5	Conference Room
	M-AD-6	Mail/Work/Copy Room
	M-AD-7	Administrative Storage
	M-AD-8	Vault/Records Storage
	M-AD-9	In-school Suspension
	M-AD-10	Restroom
	M-AD-11	Guidance Counselor's Office
	M-AD-12	Guidance Records/Storage
	M-AD-13	Parent/Volunteer Room
	M-AD-14	Health Clinic (includes restroom)
	M-AD-15	Itinerant Personnel Office
		<u>Media Center Spaces</u>
5104	M-MC	Spatial Relationship Diagram
	M-MC-1	Reading Room/Circulation
	M-MC-2	Media Specialist Office
	M-MC-3	Workroom/Storage
	M-MC-4	Main Control/Equipment Room
	M-MC-5	Computer Lab
	M-MC-6	A/V Storage
	M-MC-7	Conference Room
	M-MC-8	Multimedia Production Room

TABLE OF CONTENTS (cont.)

5105	M-VA M-VA-1 M-VA-2 M-VA-3	<u>Visual Arts Spaces</u> Spatial Relationship Diagram Art Room Kiln/Ceramic Storage Art Material Storage
5106	M-MU M-MU-1 M-MU-2 M-MU-3	<u>Music Spaces</u> Spatial Relationship Diagram Instrumental Room Vocal Room Music Library
5107	M-TE M-TE-1a M-TE-1b M-TE-2	<u>Technology Education Spaces</u> Spatial Relationship Diagram Modular Technology Lab Production Lab Storage
5108	M-FCS M-FCS-1 M-FCS-2	<u>Family and Consumer Science Spaces</u> Spatial Relationship Diagram Life Skills Lab Life Skills Storage
5109	M-PE M-PE-1 M-PE-2 M-PE-3 M-PE-4 M-PE-5 M-PE-6	<u>Physical Education Spaces</u> Spatial Relationship Diagram Gymnasium P.E./Athletic Office Staff Shower Student Locker Room Student Restroom/Shower Physical Education Storage
5110	M-SD M-SD-1 M-SD-2 M-SD-3 M-SD-4 M-SD-5	<u>Student Dining Spaces</u> Spatial Relationship Diagram Student Dining Stage Staff Dining Table Storage Family Restroom
5111	M-FS M-FS-1 M-FS-0 M-FS-1a M-FS-1b M-FS-1c M-FS-1d M-FS-1e M-FS-2 M-FS-3 M-FS-4	<u>Food Service Spaces</u> Spatial Relationship Diagram Kitchen Warming Kitchen Preparation Area Serving Area Dry Food Storage Cooler/Freezer Ware Washing Dietician's Office Restroom / Locker Room Locker Room

TABLE OF CONTENTS (cont.)

5112	M-CU M-CU-1 M-CU-2	<u>Custodial Spaces</u> Spatial Relationship Diagram Workroom Custodial Office
5113	M-BS-1 M-BS-2 M-BS-3 M-BS-4 M-BS-5 M-BS-6 M-BS-7 M-BS-8 M-BS-9 M-BS-10	<u>Building Services</u> Large Group Restrooms Custodial Closet Electrical Closet Telecommunications Room Corridors Mechanical/Electrical Space/Decks Storage Area Central Storage Area Loading/Receiving Area Restroom

TABLE OF CONTENTS (cont.)

Chapter 6: High School

6000	<i>Introduction</i>	
6100	Spatial Relationships Diagram	
6101	H-AC	<u>Academic Core Spaces</u>
		Spatial Relationship Diagram
	H-AC-1	High School Classroom
	H-AC-2	Science Classroom - General/Physics
	H-AC-3	Science Classroom - Chemistry
	H-AC-4	Science Classroom - Biology
	H-AC-5	Science Prep
	H-AC-6	Teacher Prep Area/Workroom
	H-AC-7	Individual Restroom
	H-AC-8	Project/Classroom
	H-AC-9	Small Group Room
	H-AC-10	Instructional Material Storage
	H-AC-11	Multi-use Room
	H-AC-12	Science Laboratory
6102	H-SE	<u>Special Education Spaces</u>
		Spatial Relationship Diagram
	H-SE-1	Self-contained Classroom
	H-SE-2	Workroom/Conference
	H-SE-3	Restroom/Shower
	H-SE-4	Special Education/Resource
	H-SE-5	Small Self-Contained Classroom
6103	H-AD	<u>Administrative Spaces</u>
		Spatial Relationship Diagram
	H-AD-1	Reception Area
	H-AD-2	Secretarial Area
	H-AD-3	Principal's Office
	H-AD-4	Assistant Principal's Office
	H-AD-5	Conference Room
	H-AD-6	Mail/Work/Copy Room
	H-AD-7	Administrative Storage
	H-AD-8	Vault/Records Storage
	H-AD-9	In-school Suspension
	H-AD-10	Restroom
	H-AD-11	Guidance Counselor's Office
	H-AD-12	Guidance Records/Storage
	H-AD-13	Guidance Conference Room
	H-AD-14	Parent/Volunteer Room
	H-AD-15	Health Clinic
	H-AD-16	Itinerant Personnel Office
	H-AD-17	Career Center

TABLE OF CONTENTS (cont.)

6104	H-MC H-MC-1 H-MC-2 H-MC-3 H-MC-4 H-MC-5 H-MC-6 H-MC-7 H-MC-8	<u>Media Center Spaces</u> Spatial Relationship Diagram Reading Room/Circulation Media Specialist Office Workroom/Storage Main Control/Equipment Room A/V Storage Conference Room Multimedia Production Room Document Storage
6105	H-VA H-VA-1 H-VA-2 H-VA-3	<u>Visual Arts Spaces</u> Spatial Relationship Diagram Art Room Kiln/Ceramic Storage Art Material Storage
6106	H-MU H-MU-1 H-MU-2 H-MU-3 H-MU-4 H-MU-5 H-MU-6 H-MU-7 H-MU-8 H-MU-9 H-MU-10	<u>Music Spaces</u> Spatial Relationship Diagram Instrumental Room Instrument Storage Orchestra Storage Instrumental Music Library Uniform Storage Vocal Room Vocal Storage Vocal Music Library Ensemble Room Practice Room
6107	H-TE H-TE-1 H-TE-1a H-TE-2 H-TE-3 H-TE-4	<u>Technology Education Spaces</u> Spatial Relationship Diagram Modular Technology Lab Ag-Ed Lab Storage CADD Lab Production Lab
6108	H-BE H-BE-1 H-BE-2 H-BE-3	<u>Business Education Spaces</u> Spatial Relationship Diagram Computer and Business Classroom Marketing Classroom Workroom/Storage
6109	H-FCS H-FCS-1 H-FCS-2 H-FCS-3 H-FCS-4	<u>Family and Consumer Science Spaces</u> Spatial Relationship Diagram Life Skills Lab Life Skills Storage Laundry Child Development

TABLE OF CONTENTS (cont.)

6110	H-PE	<u>Physical Education Spaces</u>
		Spatial Relationship Diagram
	H-PE-1	Gymnasium
	H-PE-2	Auxiliary Gymnasium
	H-PE-3	Student Locker Room
	H-PE-4	Student Restroom/Shower
	H-PE-5	Physical Education Storage
	H-PE-6	P.E./Athletic Office
	H-PE-7	Staff Shower
	H-PE-8	Athletic Director's Office
	H-PE-9	Lobby Services
	H-PE-10	Training Room
H-PE-11	Physical Health Classroom	
H-PE-12	Multi-use P.E. Room	
6111	H-SD	<u>Student Dining Spaces</u>
		Spatial Relationship Diagram
	H-SD-1	Student Dining
	H-SD-2	Stage
	H-SD-3	Scene Shop and Storage
	H-SD-4	Makeup/Dressing Rooms
	H-SD-5	Theatrical Control Room
	H-SD-6	Drama Storage
	H-SD-7	Staff Dining
H-SD-8	Table Storage	
H-SD-9	Family Restroom	
6112	H-FS	<u>Food Service Spaces</u>
		Spatial Relationship Diagram
	H-FS-1	Kitchen
	H-FS-0	Warming Kitchen
	H-FS-1a	Preparation Area
	H-FS-1b	Serving Area
	H-FS-1c	Dry Food Storage
	H-FS-1d	Cooler/Freezer
	H-FS-1e	Ware Washing
	H-FS-2	Dietician's Office
H-FS-3	Restroom / Locker Room	
H-FS-4	Locker Room	
6113	H-CU	<u>Custodial Spaces</u>
		Spatial Relationship Diagram
	H-CU-1	Workroom
H-CU-2	Custodial Office	
6114		<u>Building Services</u>
	H-BS-1	Large Group Restrooms
	H-BS-2	Custodial Closet
	H-BS-3	Electrical Closet
	H-BS-4	Telecommunications Room
	H-BS-5	Corridors
	H-BS-6	Mechanical/Electrical Space/Decks
	H-BS-7	Storage Area
	H-BS-8	Central Storage Area
	H-BS-9	Loading/Receiving Area
H-BS-10	Restroom	

TABLE OF CONTENTS (cont.)

VOLUME TWO

Chapter 6: Career-Technical School

6200 *Introduction*

6300 Spatial Relationships Diagram

Core Spaces

6301

<p>CT-AC CT-AC-1 CT-AC-2 CT-AC-3 CT-AC-4 CT-AC-5 CT-AC-6 CT-AC-7 CT-AC-8 CT-AC-9 CT-AC-10 CT-AC-11</p>	<p><u>Academic Core Spaces</u> Spatial Relationship Diagram Academic Classroom Computer Room General Science/Physics Biology Chemistry Science Prep Teacher Prep/Workroom Individual Restroom Small Group Room Material Storage Multipurpose Room</p>
---	---

6302

<p>CT-SE CT-SE-1 CT-SE-2 CT-SE-3 CT-SE-4 CT-SE-5 CT-SE-6 CT-SE-7 CT-SE-8</p>	<p><u>Special Education/Student Services Spaces</u> Spatial Relationships Diagram Classroom Workroom/Conference Restroom/Shower Career Technical Evaluation Career Technical Evaluation Office Small Group Room Job Training Office Resource Room</p>
---	---

6303

<p>CT-AD CT-AD-1 CT-AD-2 CT-AD-3 CT-AD-4 CT-AD-5 CT-AD-6 CT-AD-7 CT-AD-8 CT-AD-9 CT-AD-10 CT-AD-11 CT-AD-12 CT-AD-13 CT-AD-14 CT-AD-15 CT-AD-16 CT-AD-17 CT-AD-18</p>	<p><u>Administrative Spaces</u> Spatial Relationships Diagram Reception Area Secretarial Area Director/Principal's Office Assistance Director/Principal's Office Supervisor's Office Coordinator's Office Conference Room Mail/Work/Copy Room Administrative Storage Vault/Records Restroom Guidance Counselor Guidance Records/Storage Guidance Conference Parent/Volunteer Health Clinic (includes restroom) Itinerant Personnel In-School Suspension</p>
---	--

TABLE OF CONTENTS (cont.)

6304	CT-MC CT-MC-1 CT-MC-2 CT-MC-3 CT-MC-4 CT-MC-5 CT-MC-6 CT-MC-7 CT-MC-8	<u>Media Center Spaces</u> Spatial Relationships Diagram Reading Room/Circulation Media Specialist Office Workroom/Storage Main Control/Equipment Room A/V Storage Conference Room Multimedia Production Room Document Storage
6305	CT-SD CT-SD-1 CT-SD-2 CT-SD-3 CT-SD-4 CT-SD-5	<u>Student Dining Spaces</u> Spatial Relationships Diagram Student Dining Stage Staff Dining Table Storage Family Restroom
6306	CT-FS CT-FS-1 CT-FS-0 CT-FS-1a CT-FS-1b CT-FS-1c CT-FS-1d CT-FS-1e CT-FS-2 CT-FS-3 CT-FS-4	<u>Food Service Spaces</u> Spatial Relationships Diagram Kitchen Warming Kitchen Preparation Area Serving Area Dry Food Storage Cooler/Freezer Ware Washing Dietician's Office Restroom / Locker Room Locker Room
6307	CT-CU CT-CU-1 CT-CU-2	<u>Custodial Spaces</u> Spatial Relationships Diagram Workroom Custodial Office
6308	CT-GS-1 CT-GS-2 CT-GS-3 CT-GS-4 CT-GS-5 CT-GS-6 CT-GS-7 CT-GS-8	<u>General Spaces</u> Large Group Restrooms Custodial Closet Electrical Closet Telecommunications Room Storage Area Central Storage/Distribution Center Loading/Receiving/Warehouse Area Restroom
6309	CT-BS-1 CT-BS-2	<u>Building Spaces</u> Corridors Mechanical/Electrical/Space Decks

TABLE OF CONTENTS (cont.)

Program Spaces

6311

Program Type 1 - Table of Contents

Spatial Relationship Diagram

Example

CT-P1-1 Lab

Accounting - 7

Administrative and Professional Support - 8

Automation & Robotics - 11

Aviation Occupations - 9

Business Management – 10

Electronics - 11

Financial Services - 12

Information Support & Services - 16

Interactive Media - 16

Legal Management and Support - 8

Medical Management and Support - 13

Network Systems - 16

Programming and Software Development - 16

Telecommunications - 14

Travel and Tourism - 15

Visual Design and Imaging - 16

CT-P1-2 Office

CT-P1-3 Storage Area

6312

Program Type 2 – Table of Contents

Spatial Relationship Diagram

Example

CT-P2-1 Lab

Animal Bioscience – 8

Biotechnology - 7

Biotechnology for Food, Plant, Animal Sciences - 8

Community Health Aide - 10

Criminal Science Technology - 8

Dental Laboratory Technology - 11

Emergency Medical Technician - 12

Energy Science - 7

Exercise Science/Sports & Recreation Health Care - 13

Health Information Management Service - 15

Health Support Pathway - 14

Health Unit Coordinator – 15

Home Health - 10

Medical Laboratory Technology – 8

Pharmacy Assisting - 7

Plant Bioscience - 8

Practical Nursing - 16

Therapeutic Pathway - 14

CT-P2-2 Office

CT-P2-3 Storage Area

CT-P2-4 Changing Room

TABLE OF CONTENTS (cont.)

6313

Program Type 3 – Table of Contents

Spatial Relationship Diagram

Example

CT-P3-1 Lab

Early Childhood Education and Care - 7

Observation Room / Infants Room / Kitchen/Break Room

Work Room / Toddler Restroom / Reception

Entrepreneurship – 15

Bookstore / Display

Ground Operations - 19

Reference Room

Lodging - 21

Banquet Room

Marketing Communications - 15

Bookstore/Display

Marketing Management and Research – 15

Bookstore / Display

CT-P3-2 Office

CT-P3-3 Storage Area

6314

Program Type 4 – Table of Contents

Spatial Relationship Diagram

Example

CT-P4-1 Lab

Animal Science and Management (small animal) - 7

Pet Shop/Clinic/Grooming/Animal Room #1/Animal Room #2/Kennel

Career Paths for the Law Profession - 14

Weight Room / Interrogation Room

Clinical Health Care Services - 17

Training Restroom / Laundry Room

Cosmetology - 20

Dispensary / Laundry Room / Facial Room / Manicure Room /

Customer Toilet

Criminal Justice - 14

Weight Room / Interrogation Room

Culinary and Food Service Operations - 26

Restaurant / Dry Storage

Dental Assistant - 29

X-Ray Room / Darkroom

Diagnostic Pathway - 32

Exam Room

Fire Fighter Training - 34

Weight Room

Media Arts - 36

Media Arts Control Room/Edit / Vestibule

Nurse Assisting - 17

Training Restroom / Laundry Room

Optometric Occupations - 39

Exam Room

Patient Care Technician - 41

Training Restroom / Laundry Room

TABLE OF CONTENTS (cont.)

- Performing Arts - 44*
 - Practice Room*
- Private Security – 14*
 - Weight Room / Interrogation Room*
- Surgical Technology - 46*
 - Operating Room / Instrument Room / Scrub Room*
- CT-P4-2 Related Classroom**
- CT-P4-3 Office**
- CT-P4-4 Storage Area**
- CT-P4-5 Changing Room**

6315

Program Type 5 – Table of Contents **Spatial Relationship Diagram**

Example

CT-P5-1 Lab

- Agribusiness and Production Systems - 8*
- Auto Specialization - 9*
- Brick, Block, and Cement Masonry - 10*
- Building and Property Maintenance - 11*
- Building Technology - 11*
- Custodial Services - 12*
- Electrical Trades - 13*
- Environmental Controls Technologies - 14*
- Heavy Equipment (Construction) - 15*
- Integrated Systems Technology - 16*
- Interior Design and Application - 17*
- Manufacturing Design and Development - 18*
- Manufacturing Operations - 18*
- Natural Resource Management - 19*
- Plumbing and Pipefitting - 20*
- Power Equipment Technology - 21*
- Power Transmission - 22*
- Procurement, Acquisition, Logistics, and Supply Chain Management - 7*
- Welding and Cutting - 23*

CT-P5-2 Related Classroom

CT-P5-3 Office

CT-P5-4 Storage Area

CT-P5-5 Changing Room

CT-P5-6 Tool Crib

CT-P5-7 Reference Room

CT-P5-8 Toilet Room

6316

Program Type 6 – Table of Contents **Spatial Relationship Diagram**

Example

CT-P6-1 Lab

- Agriculture/Industrial Equipment - 7*
 - Engine Storage / Flammable Material Storage*
- Auto Collision Repair - 10*
 - Auto Parts Storage*
- Auto Technology - 12*
 - Engine Storage / Machine Room / Flammable Material Storage*

TABLE OF CONTENTS (cont.)

Carpentry - 16
 Finishing Room / Material Storage
Construction (2 clusters) - 19
 Design/Build / Management / CAD Room
Engineering Technology – 21
 CAD Room
Food Science and Technology - 23
 Freezer / Cooler / **Retail**
Horticulture - 27
 Retail
Medium/Heavy Truck Technician - 29
 Engine Storage / Flammable Material Storage / Machine Room
Precision Machining - 33
 CNC Room / **Inspection Room**
Wood Product Technologies - 36
 Finishing Room / Material Storage
CT-P6-2 Related Classroom
CT-P6-3 Office
CT-P6-4 Storage Area
CT-P6-5 Changing Room
CT-P6-6 Tool Crib
CT-P6-7 Reference Room
CT-P6-8 Toilet Room

6317

Program Type 7 – Table of Contents
Spatial Relationship Diagram
Example
CT-P7-1 Lab
 Animal Science and Management – Equine - 11
 Stables
Aviation Maintenance - 7
 Cleaning Room / Parts Storage / Hazardous Material Storage
CT-P7-2 Related Classroom
CT-P7-3 Office
CT-P7-4 Storage Area
CT-P7-5 Changing Room
CT-P7-6 Tool Crib
CT-P7-7 Reference Room
CT-P7-8 Toilet Room

TABLE OF CONTENTS (cont.)

Chapter 7: Sustainable Design

7000	Introduction
	7010 Whole Building Design
7100	Daylighting Considerations
	7100-1 Consider Human Factors
	7100-3 Consider the Energy Ramifications
	7100-9 Account for Site Constraints and Benefits
	7100-9 Select Well-Integrated Daylighting Strategies
	7100-14 Optimize the Most Appropriate Daylighting Strategies
	7100-31 Accurately Simulate Daylighting Performance
	7100-33 Verify and Modify Your Design Process
7200	Green Spec – Energy Efficient Plug Loads
	7200-1 Commercial Food Service Equipment
	7200-2 Cabinets
	7200-3 Kitchen Ventilation Hood
	7200-4 Ice Machines
	7200-5 Computers and Servers
	7200-6 Computer Monitors
	7200-7 Notebook & Tablet Computers
	7200-7 TV & Video Replay Equipment
	7200-8 Vending Machines
	7200-9 Screens in Daylit Spaces
	7200-10 Digital Video Projector
7300	Rainwater Harvesting and Collection
7400	Solar Ready Schools
	7401 Solar Hot Water System – Indirect Drain-Back Option 1
	7402 Solar Hot Water System – Indirect Drain-Back Option 2
	7403 Solar Hot Water System – indirect Pressurized Glycol

TABLE OF CONTENTS (cont.)

Chapter 8: Systems and Materials

8000	Introduction
	<u>Exterior Walls</u>
8110	<i>Masonry Cavity Wall</i>
8112	<i>Metal Panel On Concrete Masonry Wall</i>
8113	Plant-Precast Concrete Insulated Sandwich Wall
8114	Metal Panel on Metal Framing
8115	Metal Panel on Metal Framing
8116	Exterior Wall/Roof Closure

Roofs

8120	<i>Shingle Roof</i>
8121	<i>Shingle Roof System</i>
8122	<i>Metal Roof with Rigid Insulation</i>
8123	<i>Metal Roof with Rigid Insulation</i>
8124	Built-up Roof
8125	Membrane Roof
8126	Recommended Roof Ridge
8127	Exterior Wall System
8128	Recommended Wall-Low Roof

Interior Walls

8130	<i>Steel Stud and Wallboard</i>
-------------	--

Structural

8210	Materials and Systems
8220	Design Criteria/Evaluation

Plumbing

8310	<i>Design Criteria</i>
-------------	-------------------------------

HVAC

8410	<i>Systems Evaluation</i>
8420	Design Criteria
8430	<i>Systems Description</i>

Technology

8500	<i>Systems</i>
-------------	-----------------------

Electrical

8600	<i>Systems</i>
-------------	-----------------------

Chapter 8: Systems and Materials (Career-Technical)

8001	Introduction
8116	Manufactured Wall Panels
8126	Metal Roof with Batt Insulation
	<u>Plumbing</u>
8311	Design Criteria
	<u>HVAC</u>
8421	Design Criteria
	<u>Electrical</u>
8601	Systems

TABLE OF CONTENTS (cont.)

Chapter 9: Specifications

9100	Introduction
9101	<u>General Requirements</u> 013100 Project Management and Coordination 014000 Quality Requirements 015000 Temporary Facilities and Controls 015800 Project Identification 017419 Construction Waste Management and Disposal 017700 Closeout Procedures 018113 Sustainable Design Requirements 019100 Commissioning
9102	<u>Existing Conditions</u> 024116 Structural Demolition 024119 Selective Structural Demolition 025000 Site Remediation
9103	<u>Concrete</u> 031119 Insulating Concrete Forming 033000 Cast-In-Place Concrete 033510 Polished Concrete Finishing 033519 Colored Concrete Finishing 034100 Precast Structural Concrete 034500 Precast Architectural Concrete 035113 Cementitious Wood Fiber Decks 035216 Lightweight Insulating Concrete
9104	<u>Masonry</u> 042000 Unit Masonry 042250 Autoclaved Aerated Concrete (AAC) Masonry 042700 Glass Masonry Units 047200 Cast Stone
9105	<u>Metals</u> 051200 Structural Steel Framing 052100 Steel Joists Framing 053100 Steel Decking 054000 Cold-Formed Metal Framing 055000 Metal Fabrications 055100 Metal Stairs 055213 Pipe and Tube Railings
9106	<u>Wood, Plastics, and Composites</u> 061000 Rough Carpentry 061600 Sheathing 062000 Finish Carpentry 064023 Interior Architectural Woodwork
9107	<u>Thermal and Moisture Protection</u> 071000 Dampproofing and Waterproofing 072100 Thermal Insulation 072700 Air Barriers 073113 Asphalt Shingles

TABLE OF CONTENTS (cont.)

- 074113 Metal Roof Panels**
- 074213 Metal Wall Panels**
- 074216 Insulated-Core Metal Wall Panels**
- 074219 Metal Plate Wall Panels**
- 074243 Composite Wall Panels**
- 075000 Membrane Roofing**
- 075113 Built-Up Asphalt Roofing**
- 075200 Modified Bituminous Membrane Roofing**
- 075323 EPDM Roofing**
- 075400 Thermoplastic Membrane Roofing**
- 075700 Coated Foamed Roofing**
- 076200 Sheet Metal Flashing and Trim**
- 077100 Roof Specialties**
- 077200 Roof Accessories**
- 078100 Applied Fireproofing**
- 078400 Firestopping**
- 079200 Joint Sealants**

9108

Openings

- 081113 Hollow Metal Doors and Frames
- 081116 Aluminum Doors and Frames
- 081416 Flush Wood Doors
- 081613 Fiberglass Doors and Frames
- 083113 Access Doors and Frames
- 083320 Overhead Coiling Doors and Grilles
- 083613 Sectional Doors
- 084413 Glazed Aluminum Curtain Walls
- 085113 Aluminum Windows
- 085200 Wood Windows
- 085410 Fiberglass Windows
- 085656 Security Window Screens / Glazing
- 086300 Metal-Framed Skylights
- 087100 Door Hardware**
- 087113 Automatic Door Operators
- 088000 Glazing
- 088300 Mirrors
- 089000 Louvers and Vents

9109

Finishes

- 092116 Gypsum Board Assemblies
- 092400 Portland Cement Plastering
- 092513 Acrylic Plaster Ceilings
- 093000 Tiling
- 095113 Acoustical Panel Ceilings
- 096400 Wood Flooring
- 096466 Wood Athletic Flooring
- 096500 Resilient Flooring**
- 096516 Linoleum Flooring
- 096566 Resilient Athletic Flooring
- 096723 Resinous Flooring
- 096766 Fluid-Applied Athletic Flooring
- 096813 Tile Carpeting
- 096816 Sheet Carpeting
- 096900 Access Flooring
- 098000 Acoustic Treatment
- 099100 Painting

TABLE OF CONTENTS (cont.)

099300	Staining and Transparent Finishing
099419	Multicolored Coating System
099600	High-Performance Coatings
9110	<u>Specialties</u>
101100	Visual Display Surfaces
101200	Display Cases
101400	Signage
101426	Post and Panel/Pylon Signage
101453	Traffic Signage
102113	Toilet Compartments
102123	Cubicles
102213	Wire Mesh Partitions
102226	Operable Partitions
102813	Toilet Accessories
104400	Fire Protection Specialties
105113	Lockers
105613	Metal Storage Shelving
105626	Mobile Storage Shelving
107500	Flagpoles
9111	<u>Equipment</u>
111300	Loading Dock Equipment
113100	Residential Equipment
114000	Food Service Equipment
115123	Library Stack Systems
115213	Projection Screens
115313	Laboratory Fume Hoods
116143	Stage Curtains
116623	Gymnasium Equipment
116643	Interior Scoreboards
118226	Waste Compactors and Destructors
119200	Art Room Equipment - Kilns
9112	<u>Furnishings</u>
122113	Horizontal Louver Blinds
122413	Roller Window Shades
123550	Educational Casework
123553	Laboratory Casework
124813	Entrance Floor Mats and Frames
124816	Entrance Floor Grilles
126600	Telescoping Stands
129100	Site Furnishings
9113	<u>Special Construction</u>
134814	Sound Barriers
9114	<u>Conveying Equipment</u>
142100	Electric Traction Elevators
142400	Hydraulic Elevators
9121	<u>Fire Suppression</u>
211000	Water-Based Fire-Suppression Systems

TABLE OF CONTENTS (cont.)

9122	<u>Plumbing</u>
220519	Meters and Gages for Plumbing Piping
220533	Electric Self-Regulating Hot Water Temperature Maintenance Cable
221116	Domestic Water Piping System
221119	Plumbing Piping Specialties
221123	Plumbing Pumps and Accessories
221316	Sanitary Piping System
221323	Grease/Oil/Acid Interceptors
221413	Storm Piping System
221500	Compressed Air System
223100	Domestic Water Softener Equipment
223200	Domestic Water Filtration Equipment
223400	Fuel-Fired Domestic Water Heaters
224000	Plumbing Fixtures
226313	Gas Piping Systems
9123	<u>Heating, Ventilating, and Air Conditioning</u>
230501	Common Work Results for HVAC
230507	HVAC Piping
230514	Variable Frequency Drives
230519	Meters and Gages for HVAC Piping
230523	General Duty Valves for HVAC Piping
230525	Roof Curbs
230529	Hangers and Supports for HVAC
230548	Vibration and Seismic Control for HVAC
230553	Identification for HVAC
230593	Testing, Adjusting, and Balancing for HVAC
230719	HVAC Insulation
230923	HVAC Direct Digital Controls
230993	Sequence of Operation for HVAC
231101	Liquid Petroleum Gas Piping
232113	HVAC Piping Specialties
232117	Glycol Heat Transfer Fluid
232119	HVAC Flow Control
232123	HVAC Hydronic Pumps
232300	Refrigerant Piping
232500	HVAC Water Treatment
233113	Low-Pressure Ductwork
233115	Medium-Pressure Ductwork
233117	Flexible Ductwork
233300	Ductwork Accessories
233313	Exterior Wall Louvers
233400	HVAC Fans
233423	Rooftop Intake, Exhaust, & Relief Ventilators
233513	Dust Collection System
233515	Welding Exhaust System
233600	Variable Air Volume Terminals
233713	Air Outlets and Inlets
233716	Fabric Air Distribution Devices
233718	Underfloor Air Distribution System
233800	Kitchen Hood Ventilation System
234323	Air Cleaning System
235100	Breeching, Chimneys, and Stacks
235213	Electric Boilers
235216	Flue Gas Condensing Boilers

TABLE OF CONTENTS (cont.)

235223	Cast Iron Boilers
235225	Steel Firebox Boilers
235233	Flexible Water Tube Boilers
235239	Packaged Firetube Boilers
235700	Heat Exchangers
236213	Refrigerant Condensing Units
236215	Multiple-Compressor Refrigerant Condensing Units
236416	Packaged, Centrifugal Water Chiller
236423	Packaged, Scroll Water Chiller
236426	Packaged, Rotary Screw Water Chiller
236440	Refrigerant Monitoring Systems
236500	Packaged Cooling Towers
236533	Closed Circuit Fluid Coolers
237119	Ice Storage System
237200	Air to Air Energy Recovery Equipment
237313	Modular Indoor Air Handling Units
237323	Custom Indoor Air Handling Units
238113	Unitary Air Conditioning Equipment
238123	Computer Room Air Conditioners
238146	Water Source Heat Pumps
238156	Ground Source Heat Pumps (Geothermal)
238219	Fan Coil Units – Four Pipe
238223	Unit Ventilators – Four Pipe
238233	Convectors
238239	Cabinet Unit Heaters
238240	Propeller Unit Heaters
238316	Radiant Heating Hydronic System
9126	<u>Electrical</u>
260513	Medium Voltage Cables 2001 to 35,000 v
260519	Low Voltage Electrical Power Conductors and Cables
260526	Grounding and Bonding of Electrical Systems
260529	Hangers and Supporting Devices
260533	Raceway and Boxes for Electrical Systems
260536	Cable Tray for Electrical Systems
260543	Underground Ducts and Raceways for Electric Systems
260923	Lighting Control Devices
261200	Medium Voltage Transformers
261300	Medium Voltage Switchgear
262200	Low Voltage Transformers
262413	Switchboards
262416	Panelboards
262419	Motor Control Centers
262726	Wiring Devices
262813	Fuses and Fuse Holders
262816	Enclosed Switches and Circuit Breakers
262913	Enclosed Controllers
263213	Package Engine Generators
263600	Transfer Switches
264313	Transient Voltage Suppression for Low-Voltage Electrical Power Circuits
265100	Interior Lighting
265561	Theatrical Dimming System
265600	Exterior Lighting

TABLE OF CONTENTS (cont.)

9127	<u>Communications</u> 270526 Grounding and Bonding for Communications Systems 271100 Communications Equipment Room Fittings 271313 Communications Copper Backbone Cabling 271323 <i>Communications Optical Fiber Backbone Cabling</i> 271333 Communications Coaxial Backbone Cabling 271513 Communications Copper Horizontal Cabling 271533 Coaxial Communications Horizontal Cabling 271543 Audio-Video Communications Horizontal Cabling 272100 <i>Data Communications Network Equipment</i> 272133 <i>Data Communications Wireless Access Points</i> 273113 IP-Enabled PABX System 273123 IP Only PABX System 274117 Broadband Video RF Distribution System 274119 <i>Video Display Equipment</i> 274120 <i>Interactive Audio-Video Equipment</i> 274125 Digital On-Demand Instruction Delivery System 275121 <i>Student Dining / Auditoria Sound Reinforcement System – High School</i> 275122 <i>Student Dining / Cafeteria Sound Reinforcement System</i> 275123 Central Sound and Paging System 275124 <i>Gymnasium Sound Reinforcement System</i> 275125 Music Room Audio Program Playback System - Middle School 275126 <i>Music Room Audio Recording/Playback System - High School</i> 275127 <i>Classroom Sound Reinforcement System</i> 275313 Clock Systems
9128	<u>Electronic Safety and Security</u> 281300 <i>Access Control System</i> 281600 Intrusion Detection System 282300 Video Surveillance System 282600 Area of Refuge Intercommunication System 283111 Digital, Addressable Fire-Alarm System
9131	<u>Earthwork</u> 311000 Site Clearing 312000 Earth Moving
9132	<u>Exterior Improvements</u> 321216 Asphalt Paving 321313 Concrete Paving 321314 <i>Pervious Concrete Pavement</i> 321443 Porous Unit Paving 321816 Playground Surfacing 323113 Fences and Gates 329200 Turf and Grasses
9133	<u>Utilities</u> 330513 Manholes and Structures 331000 Water Utilities 333000 Sanitary Sewerage Utilities 334000 Storm Drainage Utilities 334600 Subdrainage

TABLE OF CONTENTS (cont.)

Chapter 9: Specifications (Career-Technical)

9200	Introduction
9203	<u>Concrete</u> 033516 Concrete Floor Hardener/Sealer
9206	<u>Wood, Plastics, and Composites</u> 060565 Slatwall Paneling 068200 Glass Fiber-Reinforced Plastic
9208	<u>Openings</u> 083416 Bottom Roll Slide Hanger Doors 083436 Revolving Darkroom Doors
9209	<u>Finishes</u> 096000 Wood Dance Floor 099600 High Performance Coatings
9211	<u>Equipment</u> 112713 Dark Room Equipment 113100 Residential Appliances 116135 Pipe Grid 116615 Ballet Bars 116800 Play Field Equipment and Structures
9213	<u>Special Construction</u> 131900 Kennels and Animal Shelter Equipment 133413 Glazed Structures (Greenhouses) 133419 Metal Building Systems
0923	<u>Heating, Ventilating, and Air Conditioning</u> 233500 Vehicle Fume Exhaust Equipment
0941	<u>Material Processing and Handling Equipment</u> 412223 Hoists and Cranes

Chapter 10: Miscellaneous

10010	Color Materials
10020	Loose Furnishings
10030	Food Service Equipment

Chapter 10: Miscellaneous (Career-Technical)

10100	Loose Furnishings
-------	-------------------

© Ohio School Facilities Commission 1997

(Revised 7/1/99, 7/1/00, 7/1/01, 4/1/02, 4/1/03, 4/1/04, 4/1/05, 2006, 2007, 2008, 2009, and **2010**)

27

DIVISION

COMMUNICATIONS

TABLE OF CONTENTS

DIVISION 27: COMMUNICATIONS

270526	Grounding and Bonding for Communications Systems
271100	Communications Equipment Room Fittings
271313	Communications Copper Backbone Cabling
271323	Communications Optical Fiber Backbone Cabling
271333	Communications Coaxial Backbone Cabling
271513	Communications Copper Horizontal Cabling
271533	Coaxial Communications Horizontal Cabling
271543	Audio-Video Communications Horizontal Cabling
272100	Data Communications Network Equipment
272133	Data Communications Wireless Access Points
273113	IP-Enabled PABX System
273123	IP Only PABX System
274117	Broadband Video RF Distribution System
274119	Video Display Equipment
274120	Interactive Audio-Video Equipment
274125	Digital On-Demand Instruction Delivery System
275121	Student Dining / Auditoria Sound Reinforcement System – High School
275122	Student Dining / Cafeteria Sound Reinforcement System
275123	Central Sound and Paging System
275124	Gymnasium Sound Reinforcement System
275125	Music Room Audio Program Playback System - Middle School
275126	Music Room Audio Recording/Playback System - High School
275127	Classroom Sound Reinforcement System
275313	Clock Systems

SECTION 270526

GROUNDING AND BONDING FOR COMMUNICATIONS SYSTEMS

GENERAL GUIDELINES

1.1 SUMMARY

- A. This Section defines the general design requirements for a uniform Telecommunications Grounding and Bonding infrastructure that shall be followed for all OSFC Technology construction projects.
 - 1. Figure 1 describes the Telecommunications Bonding System
 - 2. Refer to Section 8500, Technology Systems, and Section 8600, Electrical Systems, for additional information.

1.2 SECTION INCLUDES

- A. Telecommunications Main Grounding Busbar (TMGB)
- B. Telecommunications Grounding Busbar (TGB)
- C. Telecommunications Bonding Backbone (TBB) – **optional**.

1.3 QUALITY ASSURANCE

- A. All equipment shall be UL listed.
- B. All equipment and Installation Practices shall comply with the latest ANSI/NFPA-70 National Electric Code.
- C. All equipment Installation Practices shall comply with the Local Electric Code.
- D. All equipment Installation Practices shall comply with the latest ANSI/TIA/EIA-758 Customer Owned Outside Plant Standard.
- E. All equipment shall comply with the latest ANSI-J-STD-607 Commercial Building Grounding (Earthing) and Bonding Requirements for Telecommunications Standard.
- F. All equipment and Installation Practices shall comply with the latest BICSI Telecommunications Distribution Methods Manual (TDMM).

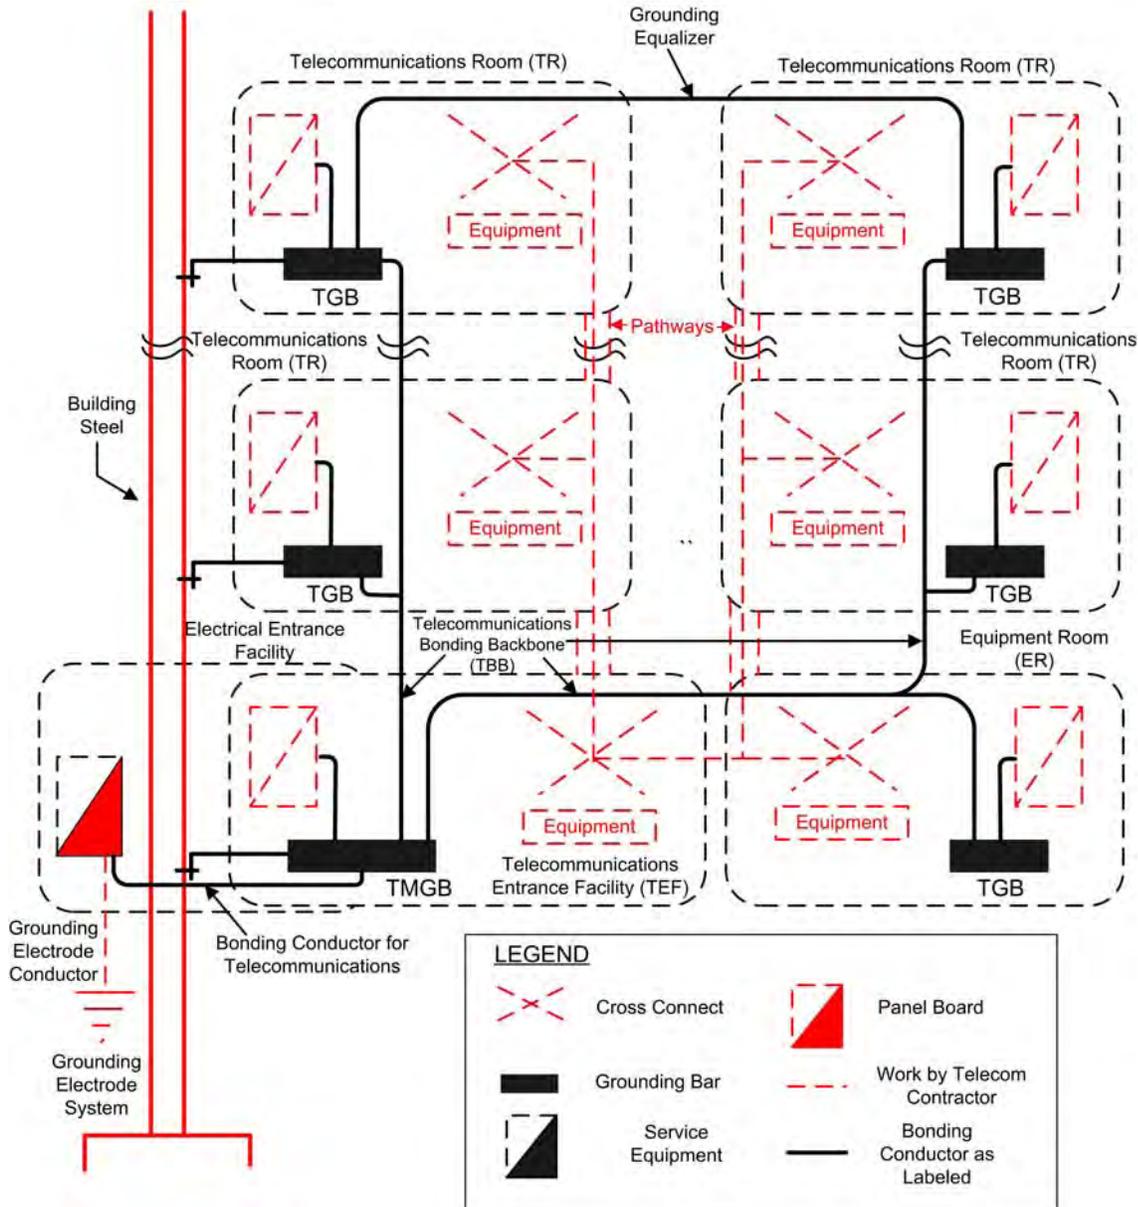


Figure 1 – Telecommunications Bonding System

1.4 TELECOMMUNICATIONS MAIN GROUNDING BUSBAR (TMGB)

- A. Provide Telecommunications Main Grounding Busbar (TMGB) in Main Equipment Room (ER) and Telecommunications Room (TR).
- B. All TMGB Connections to be made with double-bolted, Compression style, Grounding Lugs.

1.5 TELECOMMUNICATIONS GROUNDING BUSBAR (TGB)

- A. Provide Telecommunications Grounding Busbar (TGB) in all Telecommunications Rooms (TRs) and AV Equipment Cabinets.
- B. All TGB Connections to be made with double-bolted, Compression style, Grounding Lugs.

1.6 TELECOMMUNICATIONS BONDING BACKBONE (TBB) - **OPTIONAL**

- A. Provide Telecommunications Bonding Backbone (TBB) between all TGBs and the TMGB.
- B. All TBB Connections to be made with double-bolted, Compression style, Grounding Lugs.
- C. The TBB shall be a minimum of No. 2 AWG insulated copper bonding conductor.

Sizing of TBB

TBB Length in Feet	TBB Size (AWG)
0 -- 14	6
14 -- 20	4
21 -- 26	3
27 -- 33	2
34 -- 41	1
42 -- 52	1/0
53 -- 66	2/0
66 +	3/0

Figure 2 – Sizing of TBB

1.7 GROUNDING/BONDING CONDUCTORS

- A. All Grounding and bonding conductors shall be copper and may be insulated. When Conductors are insulated, they shall be listed for the application. The minimum bonding conductor shall be No. 6 AWG.

1.8 INSTALLATION

- A. As a minimum, Bond TMGB to following:
 1. Building Steel, (minimum No. 2 AWG insulated copper bonding conductor). CAD Weld Bonding Conductors to Building Steel.
 2. Main Electrical Service Grounding Electrode System (minimum No. 2 AWG insulated copper bonding conductor).
 3. Local Service Panel Ground (minimum No. 6 AWG insulated copper bonding conductor).
 4. Telecommunications Bonding Backbone (TBB) that connects TMGB to other TGBs (minimum No. 2 AWG insulated copper bonding conductor) – **optional**.
 5. Associated Telecommunications Cable Tray(s) (continuous No. 6 AWG bare copper bonding conductor connecting all Cable Tray Sections).

COMMUNICATIONS

CHAPTER 9: SPECIFICATIONS

6. Telecommunications Conduit(s) Entering TR (minimum No. 6 AWG insulated copper bonding conductor).

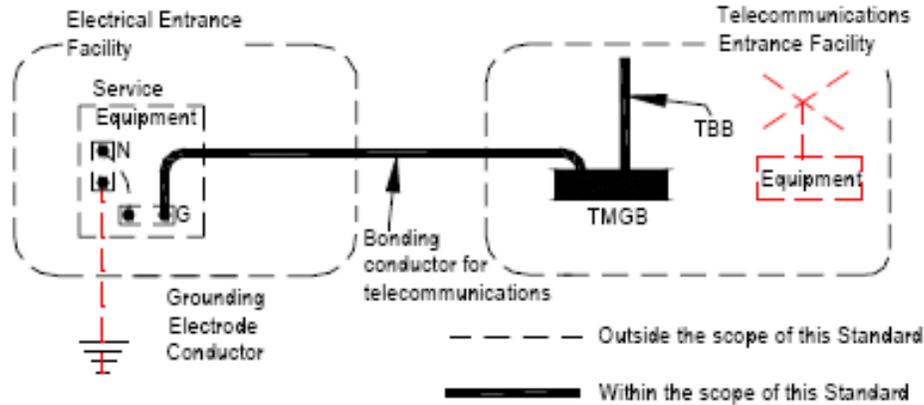


Figure 3 – Connection to Grounding Electrode

- B. As a minimum, Bond TGB to following:
1. Building Steel, (minimum No. 2 AWG insulated copper bonding conductor).
CAD Weld Bonding Conductors to Building Steel.
 2. Local Service Panel Ground (minimum No. 6 AWG insulated copper bonding conductor).
 3. Telecommunications Bonding Backbone (TBB) that connects TGB to other TGBs and TMGB (minimum No. 2 AWG insulated copper bonding conductor) - **Optional**.
 4. Associated Telecommunications Cable Tray(s) (continuous No. 6 AWG bare copper bonding conductor connecting all Cable Tray Sections).
 5. Telecommunications Conduit(s) Entering TR (minimum No. 6 AWG insulated copper bonding conductor).
- C. As a minimum, the Technology Contractor shall bond the following devices to the associated TMGB and TGBs using a minimum No. 6 AWG insulated copper bonding conductor using compression style lugs:
1. Antenna Cable Shields
 2. Backbone Cable Shields
 3. CATV Equipment
 4. Coupled Bonding Conductors (CBCs)
 5. Equipment Racks and Cabinets
 6. Lightning and Surge Protectors
 7. PABX Equipment
 8. Raised Floors
 9. Telecommunication and Fiber Cable Shields
 10. Telecommunications Devices
 11. TR Cable Ladder and Tray

END OF SECTION

SECTION 271100

COMMUNICATIONS EQUIPMENT ROOM FITTINGS

GENERAL GUIDELINES**1.1 GENERAL**

- A. This Section defines the general design requirements for a uniform Communications Room Infrastructure that shall be followed for all OSFC Technology construction projects.
 - 1. Communications Rooms consist of:
 - a. Main Equipment Room (ER)
 - b. Telecommunication Rooms (TR)
 - 2. Figure 1 describes a typical Communications Room
 - 3. Refer to Section 8500, Technology Systems, and Section 8600, Electrical Systems, for additional information.

1.2 SECTION INCLUDES

- A. Equipment Room (ER)
- B. Telecommunication Rooms (TR)
- C. Equipment Backboards
- D. Equipment Racks and Cabinets
- E. Cable Ladder and Cable Tray

1.3 QUALITY ASSURANCE

- A. All equipment shall be UL listed.
- B. All equipment and Installation Practices shall comply with the latest ANSI/NFPA-70 National Electric Code.
- C. All equipment Installation Practices shall comply with the Local Electric Code.
- D. All equipment shall comply with the latest ANSI-J-STD-607 Commercial Building Grounding (Earthing) and Bonding Requirements for Telecommunications Standard.
- E. All equipment and Installation Practices shall comply with the latest BICSI Telecommunications Distribution Methods Manual (TDMM).
- F. All equipment Racks and Cabinets shall comply with the latest ANSI/EIA-310 Cabinets, Racks, Panels and Associated Equipment Standard.

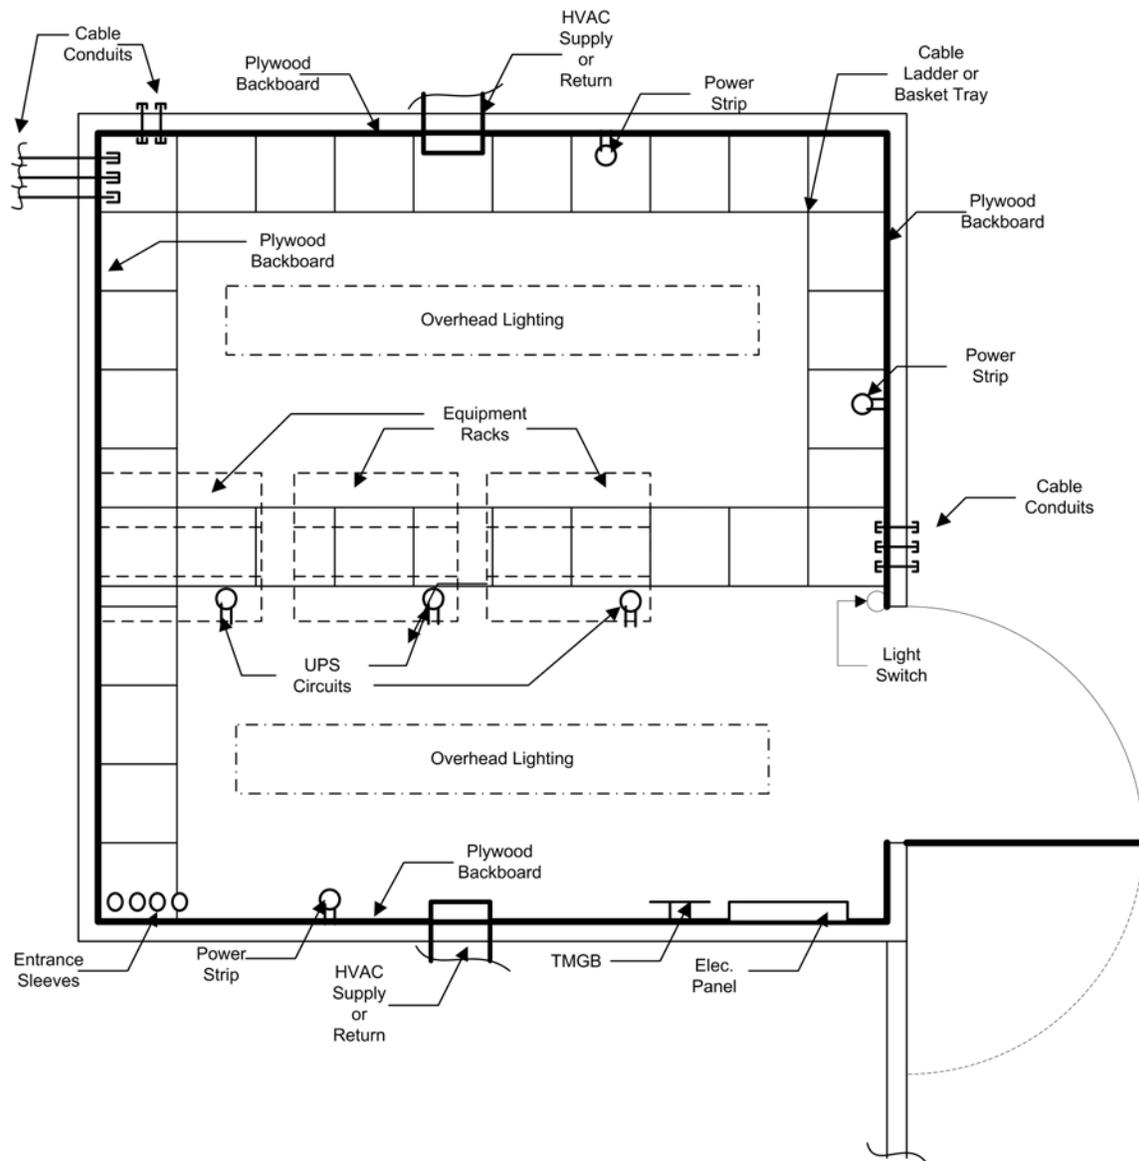


Figure 1 - Typical 10 ft x 10 ft Communications Room

1.4 EQUIPMENT ROOM (ER) GENERAL

- A. Each Building shall be equipped with at least 1 ER
- B. Locate the ER in a Central area of the Building.
- C. For multiple story buildings, consider centrally locating the ER so it can serve multiple floors.
- D. Extend Service Entrance Conduits to the ER
- E. The ER typically contains the following equipment:

1. ACTIVE EQUIPMENT
 - a. Access Control Systems
 - b. CATV Systems
 - c. CCTV Systems
 - d. Clock Systems
 - e. Intercom Systems
 - f. Network Electronics
 - g. Paging Systems
 - h. PBX Equipment
 - i. Security Electronics
 - j. UPS Systems
 - k. Video Systems
 - l. Voice Mail Systems
 - m. Wireless Electronics

2. CROSS-CONNECT EQUIPMENT
 - a. Racks
 - b. Cabinets
 - c. Patch Panels
 - d. Backboards
 - e. 110 Blocks

3. BUILDING FACILITIES EQUIPMENT
 - a. Associated HVAC Equipment
 - b. Associated Electrical Equipment

1.5 TELECOMMUNICATION ROOM (TR) GENERAL

- A. When more than one Equipment Room (ER) is required, additional satellite Telecommunications Rooms (TRs) shall be provided.

- B. Centrally locate the TRs in the areas being served.

- C. For multiple story buildings, consider centrally locating the TRs so they can serve multiple floors.

- D. The TR typically contains the following equipment:
 1. ACTIVE EQUIPMENT
 - a. CATV Systems
 - b. Network Electronics
 - c. UPS Systems
 2. CROSS-CONNECT EQUIPMENT
 - a. Racks
 - b. Cabinets
 - c. Patch Panels
 - d. Backboards
 - e. 110 Blocks
 3. BUILDING FACILITIES EQUIPMENT
 - a. Associated HVAC Equipment
 - b. Associated Electrical Equipment

- E. Fiber and Copper Backbone cables shall be provided to interconnect the TR(s) with the ER.

COMMUNICATIONS

CHAPTER 9: SPECIFICATIONS

1.6 ER AND TR REQUIREMENTS

- A. The minimum ER and TR minimum ceiling heights shall be 8 feet (2.4 m) above finished floor (AFF). Consideration should be given to 10 ft (3 m) ceilings.
- B. The ER and TR shall be rectangular in shape.
- C. Consolidate multiple floors and serving areas into a single TR whenever possible. For example, a centrally located TR on the 2nd floor could also serve the 1st and 3rd floor.
- D. The minimum ER dimensions shall be 10 feet (3.0 m) x 15 feet (4.6 m).
- E. The minimum TR dimensions shall be 10 feet (3.0 m) x 10 feet (3.0 m).
- F. The ER and TR shall have tiled floors.
- G. The ER and TR shall have at least one lockable door that opens outward and has minimum dimensions of 3 feet (0.91 m) wide by 6.7 feet (2.0 m) tall.
- H. Provide each ER and TR with an HVAC system that maintains continuous environmental control 24 hours per day, 365 days per year.
- I. Maintain temperature between 64° F (18° C) to 75° F (24° C).
- J. Maintain relative humidity between 30% and 55% -- non-condensing.
- K. Provide Telecommunications Grounding Systems
- L. Provide the following minimum clearances:
 - 1. Minimum of 40 in. (1 m) between equipment racks and the front of cross-connect fields.
 - 2. Allow a minimum of 6 in. (150 mm) from the wall for wall-mounted equipment.
 - 3. Minimum of a 40 in. (1 m) aisle in front of and behind all equipment racks and cabinets.
 - 4. Minimum of 36 in. (0.91 m) floor area depth for equipment racks and cabinets.
- M. Provide sufficient Generator Electrical circuits to service the associated UPS units.
- N. Power all active devices from UPS units, which are connected to the Building generator.
- O. Provide a minimum of 500 lux (50-foot candles of uniform lighting when measured at 3 feet AFF.
- P. Use light colored walls to enhance lighting.

1.7 EQUIPMENT BACKBOARDS

- A. Cover at least two (2) walls with AC grade or better, void free ¾ in. (19 mm) plywood at least 8 feet (2.4 m) high.
- B. Place the grade C surface towards the wall and coat the plywood with two coats of fire-retardant white paint.

1.8 EQUIPMENT RACKS

- A. Place equipment racks or cabinets in a continuous row.
- B. Equipment racks shall be black, 84 inches high, have 19 inch EIA, pre-tapped, mounting rails and shall have integral, 5 inch minimum, vertical cable organizers on both the left and right of the rack.
- C. Equipment racks shall be provided with rear vertical cable organizers on both the left and right side of the rack.
- D. Provide at least one 4-posted rack or equipment cabinet in the ER for placing file servers and other equipment requiring four-corner mounting.
- E. Equipment racks are the preferred equipment-mounting device.
- F. When equipment cabinets are furnished, they shall be black, have vented side panels and lockable front and back doors. Cabinets shall be a minimum of 22-1/2 inches (572 mm) wide by a minimum of 27 in. (686 mm) deep and 84 in. (2.15 m) high.
- G. All equipment racks and cabinets shall be of the same manufacturer and model type.

1.9 CABLE LADDER AND CABLE TRAY

- A. Line the walls of the ER and TR with a minimum of 12 in (305 mm) wide cable ladder or wire basket cable tray for cable management.
- B. Provide a minimum of 12 in (305 mm) wide cable ladder or wire basket cable tray over the tops of racks and cabinets for cable management.



Figure 2 -- Typical Communications Room Cable Conduits



Figure 3 -- Typical Communications Room Overhead Cable Ladder and Backboard

1.10 GENERAL

- A. All racks, patch panels, cables, jacks, system components, etc. shall be labeled according to ANSI/EIA/TIA-606 specifications and in coordination with the District/architect.
- B. Coordinate the location of lighting equipment so that fully loaded cable trays and ladder do not impede or obstruct the lighting.

END OF SECTION

SECTION 271313**COMMUNICATIONS COPPER BACKBONE CABLING****GENERAL GUIDELINES****1.1 GENERAL**

- A. This Section defines the general design requirements for a uniform Intra and Inter-Building Communications Copper Backbone Cabling Infrastructure that shall be followed for all OSFC Technology construction projects.
 - 1. Figures 1, 2 and 3 describe a typical Intra-Building Communications Copper Backbone Cabling Systems
 - 2. Figure 4 describes a typical Inter-Building Communications Copper Backbone Cabling System
 - 3. Refer to Section 8500, Technology Systems, and Section 8600, Electrical Systems, for additional information.

1.2 SECTION INCLUDES

- A. INTRA-BUILDING COPPER BACKBONE CABLE SYSTEMS
 - 1. Main Equipment Room (ER) to Telecommunication Rooms (TR) Voice Backbone Cable System.
 - 2. Main Equipment Room (ER) to Telecommunication Rooms (TR) Data Backbone Cable System.
 - 3. Entrance Facility (EF) to Main Equipment Room (ER) Voice Backbone Cable System.
 - 4. Entrance Facility (EF) to Main Equipment Room (ER) Data Circuit Backbone Cable System.
- B. INTER-BUILDING COPPER BACKBONE CABLE SYSTEMS
 - 1. Main Equipment Room (ER) to Main Equipment Room (ER) Voice Backbone Cable System.

1.3 QUALITY ASSURANCE

- A. All equipment shall be UL listed.
- B. All equipment and Installation Practices shall comply with the latest ANSI/NFPA-70 National Electric Code.
- C. All equipment Installation Practices shall comply with the Local Electric Code.

COMMUNICATIONS

CHAPTER 9: SPECIFICATIONS

- D. All equipment shall comply with the latest ANSI-J-STD-607 Commercial Building Grounding (Earthing) and Bonding Requirements for Telecommunications Standard.
- E. All equipment and Installation Practices shall comply with the latest BICSI[®] Telecommunications Distribution Methods Manual (TDMM) and BICSI[®] Customer-Owned Outside Plant Design Manual.
- F. All equipment shall comply with the latest ANSI TIA/EIA-568, 569, 606, 607, Standards.
- G. All Inter-Building cabling shall comply with the latest ANSI/TIA/EIA-758. Customer-Owned Outside Plant Telecommunications Cabling, Standard, as applicable.
- H. All Inter-Building cabling shall comply with the latest ANSI/ICEA S-98-688. Broadband Twisted-Pair, Telecommunications Cable Aircore, Polyolefin Insulated Copper Conductors, Standard, as applicable.
- I. All Inter-Building cabling shall comply with the latest ANSI/ICEA S-99-689. Broadband Twisted-Pair, Telecommunications Cable Filled, Polyolefin Insulated Copper Conductors, Standard, as applicable.

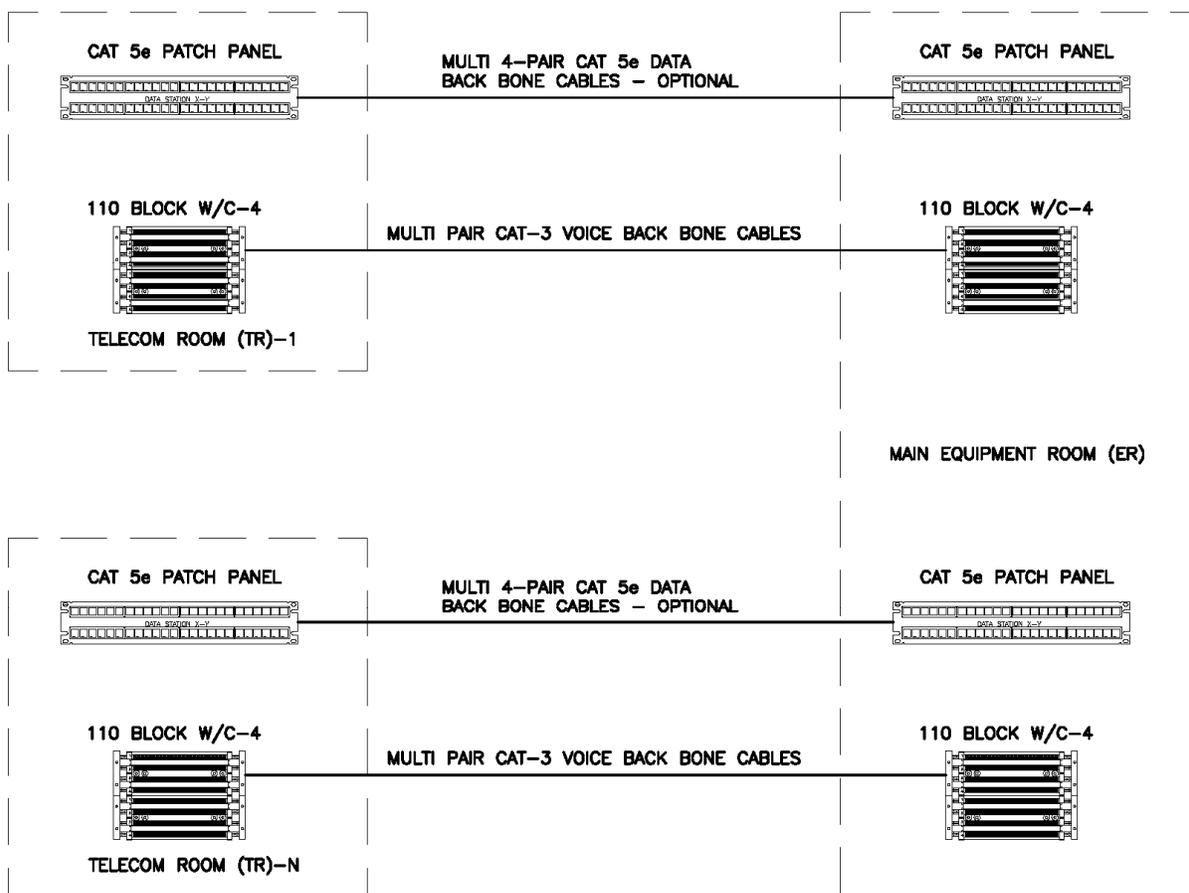


Figure 1 – Main Equipment Room (ER) to Telecommunication Rooms (TRs) Data and Voice Backbone Cable System, Option - 1

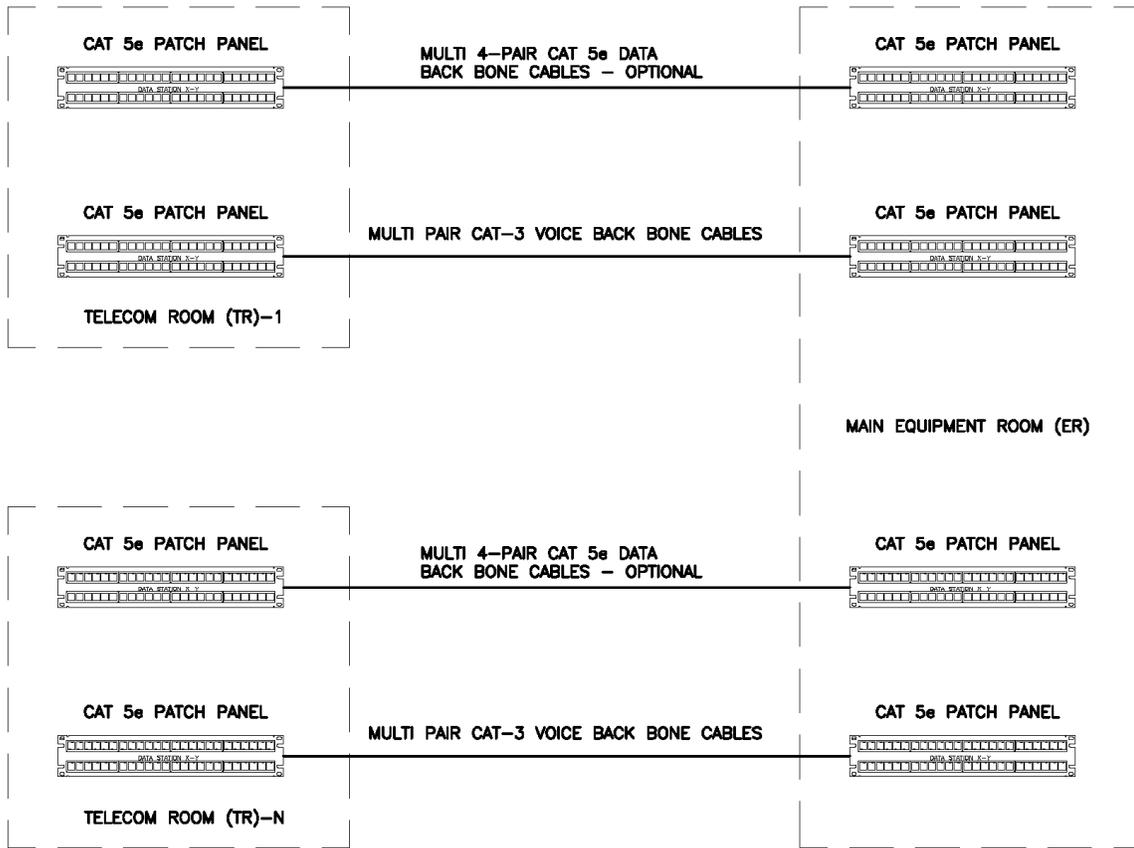


Figure 2 – Main Equipment Room (ER) to Telecommunication Rooms (TRs) Data and Voice Backbone Cable System, Option – 2

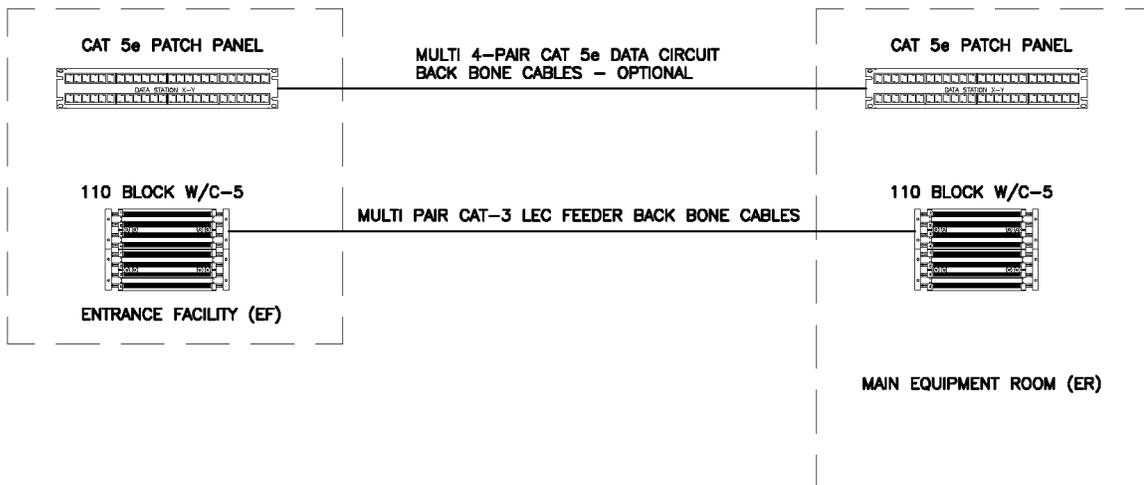


Figure 3 – Entrance Facility (EF) to Main Equipment Room (ER) Data Circuit and Voice Backbone Cable System

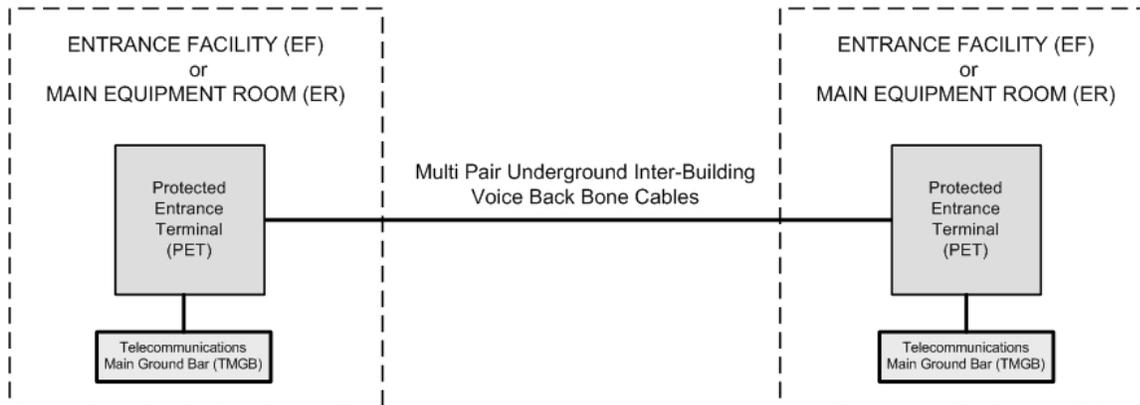


Figure 4 – Main Equipment Room (ER) to Main Equipment Room (ER) Inter-Building Voice Backbone Cable System

1.4 INTRA-BUILDING COPPER BACKBONE CABLE SYSTEMS

A. MAIN EQUIPMENT ROOM (ER) TO TELECOMMUNICATION ROOMS (TR) VOICE BACKBONE CABLE SYSTEM

1. When the School has a Traditional IP-Enabled PBX Phone System, provide a multi-pair CAT-3 Voice Backbone system between the ER and the associated TRs, sufficient to serve all voice stations with 2 pairs in the backbone.
2. When the School has an all-IP Phone System, a minimal 25-pair CAT-3 Voice Backbone is recommended by not required.
3. Provide a minimum of one (1) 100-pair cable between the ER and each associated TR. Equip cables in increments of 100 pairs. **For TE/TR serving less than 24 users, provide a minimum 50 pair cable.**
4. Provide a minimum of **one (1) pair** per associated TR telephone outlet **with 50% spare capacity**.
5. Terminate 100-pair cables on 110 Blocks using C-4 Clips or Cat-5e, rack-mounted, patch panels as minimum 2-pair circuits – See figures 1 and 2 above.

B. MAIN EQUIPMENT ROOM (ER) TO TELECOMMUNICATION ROOMS (TR) DATA CIRCUIT BACKBONE CABLE SYSTEM - **OPTIONAL**

1. Provide a minimum of six (6) four-pair, Cat-5e/6 cables to match category rating of data cables between the ER and each associated TR.
2. Terminate the cables on Cat-5e/6, rack-mounted, Patch panels at each end. – See figures 1 and 2 above.

C. ENTRANCE FACILITY (EF) TO MAIN EQUIPMENT ROOM (ER) VOICE BACKBONE CABLE SYSTEM

1. Separate Entrance Facilities (EF) are generally encountered during renovations to existing buildings and are not recommended for new construction. For new construction, co-locate the Entrance Facility (EF) in the Main Equipment Room (ER).
2. When the Entrance Facility is not co-located in the Main Equipment Room (ER), provide a multi-pair CAT-3 Voice Backbone system between the EF and the ER, for the extension of voice, FAX and alarm circuits provided by the Service Provider (SP).
3. Provide a minimum of one (1) 100-pair cable between the EF and each associated ER. Equip cables in increments of 100 pairs.
4. Terminate LEC Feeder, 100-pair cables on 110 Blocks using C-5 Clips at both ends. – See figure 3 above.

D. ENTRANCE FACILITY (EF) TO MAIN EQUIPMENT ROOM (ER) DATA CIRCUIT BACKBONE CABLE SYSTEM

1. When the Entrance Facility is not co-located in the Main Equipment Room (ER) provide a minimum of six (6) four-pair, Cat-5e cables between the EF and the ER for the extension of special circuits (T-1, PRI, etc.) provided by the Service Provider (SP) - **Optional**.
2. Terminate the cables on a Cat-5e, wall-mounted, Patch panel at the EF end and on a Cat-5e, wall-mounted or rack-mounted patch panel at the ER end. – See figure 3 above.
3. Terminate LEC Feeder, 100-pair cables on 110 Blocks using C-5 Clips at both ends. – See figure 4 above.

1.5 INTER-BUILDING COPPER BACKBONE CABLE SYSTEMS

A. MAIN EQUIPMENT ROOM (ER) TO MAIN EQUIPMENT ROOM (ER) VOICE BACKBONE CABLE SYSTEM

1. When multiple School Buildings are located on the same campus, and served by a common IP-Enabled Phone System, provide a multi-pair, underground or aerial telecommunications cable between the ER or EF of the building containing the common Phone System and the ER or EF of each of the associated satellite buildings.
2. Provide a minimum of 25 pairs.
3. Provide a minimum of one pair for each active telephone outlet in the associated satellite building.
4. Provide a minimum of 25 % spare pairs for growth.

COMMUNICATIONS

CHAPTER 9: SPECIFICATIONS

5. When the School has an all-IP Phone System, the multi-pair inter-building Voice Backbone is optional. In cases where only one Service Provider DEMARC is provided per campus, provide an inter-building Voice Backbone cable for 911 backup and alarm circuits.
6. Terminate the inter-building cables on Protected Entrance Terminals (PETs) at both ends. – See figure 4 above.
7. Provide Gas-Tube Protector Modules for all pairs at both ends.
8. Ground the Cable sheath and the PET to the associated Telecommunications Main Grounding Bus (TMGB) at both ends.
9. Depending on the application, provide metal protective sheaths and appropriate rodent protection devices for aerially installed Telecommunications cables.

1.6 INSTALLATION

- A. All cabling shall be installed according to ANSI/EIA/TIA specifications and BISC1 standards.
- B. All Cat-5e cabling shall be terminated on Cat-5e (minimum) patch panels and jacks as noted above.
- C. All system multi-pair voice backbone cabling shall be terminated on Cat-5e (minimum) patch panels or 110 style punch blocks as noted above.
- D. Provide designated space on Telecommunications Backboard for location of Access Provider's (AP's) Service Entrance Cable Termination and Protection Point.

1.7 LABELING

- A. All racks, patch panels, cables, jacks, system components, etc. shall be labeled according to ANSI/EIA/TIA-606 specifications and in coordination with the District/architect.
- B. All cables shall be equipped with a self-laminating, wrap-around, machine printed label at both ends of the cable.
- C. All Patch Panels shall be equipped with pre-printed, cable identification designation strips installed behind clear plastic label holders on the front of the patch panel.

1.8 TESTING

- A. All Cat-5e (or Cat-6) backbone cables shall be tested to Cat-5e (or Cat-6) performance levels in accordance with ANSI/TIA/EIA-568-B.2 (or latest) specifications, using a Level III compliant tester.
- B. All multi-pair, backbone cables shall be tested to Cat-3 (minimum) performance levels in accordance with ANSI/TIA/EIA-568-B.2 (or latest) specifications, using a Level III compliant tester.

- C. All multi-pair, inter-building backbone cables shall be tested to Cat-3 (minimum) performance levels in accordance with ANSI/TIA/EIA-568-B.2 (or latest) specifications, using a Level III compliant tester.
- D. All Cable test results shall be stored and presented to the Architect in both hard copy and electronic format for approval.
- E. All Cable Tester record designations shall match the associated cable label, and associated patch panel or 110-block label designation.

END OF SECTION

SECTION 271323

COMMUNICATIONS OPTICAL FIBER BACKBONE CABLING

GENERAL GUIDELINES**1.1 GENERAL**

- A. This Section defines the general design requirements for a uniform Intra and Inter-Building Communications Optical Fiber Backbone Cabling Infrastructure that shall be followed for all OSFC Technology construction projects.
 - 1. Figure 1 describes a typical Intra-Building Communications Optical Fiber Backbone Cabling System
 - 2. Figure 2 describes a typical Inter-Building Communications Copper Backbone Cabling System
 - 3. Refer to Section 8500, Technology Systems, and Section 8600, Electrical Systems, for additional information.

1.2 SECTION INCLUDES

- A. INTRA-BUILDING OPTICAL FIBER BACKBONE CABLE SYSTEMS
 - 1. Main Equipment Room (ER) to Telecommunication Rooms (TR) Fiber Optic Backbone Cable System
- B. INTER-BUILDING OPTICAL FIBER BACKBONE CABLE SYSTEMS
 - 1. Main Equipment Room (ER) to Main Equipment Room (ER) Fiber-Optic Backbone Cable System
- C. OPTICAL FIBER PATCH PANEL SYSTEMS
 - 1. Fiber-Optic Patch Panels
 - 2. Fiber-Optic Connectors
 - 3. Fiber-Optic Splice Trays

1.3 QUALITY ASSURANCE

- A. All equipment shall be UL listed.
- B. All equipment and Installation Practices shall comply with the latest ANSI/NFPA-70 National Electric Code.
- C. All equipment installation practices shall comply with the local electric code.
- D. All equipment shall comply with the latest ANSI-J-STD-607 Commercial Building Grounding (Earthing) and Bonding Requirements for Telecommunications Standard.
- E. All equipment and Installation Practices shall comply with the latest BICSI[®] Telecommunications Distribution Methods Manual (TDMM) and BICSI[®] Customer-Owned Outside Plant Design Manual.

- F. All equipment shall comply with the latest ANSI TIA/EIA-568, 569, 606, 607, standards.
- G. All 62.5 micron, multi-mode fiber equipment shall comply with the latest American National Standards Institute/Telecommunications Industry Association/Electronic Industries Alliance Specification ANSI/TIA/EIA-492AAAA. Detail Specification for 62.5- μ m Core Diameter/125- μ m Cladding Diameter Class 1a Graded-Index Multimode Optical Fibers.
- H. All 50 micron, multi-mode equipment shall comply with the latest American National Standards Institute/Telecommunications Industry Association/Electronic Industries Alliance Specification ANSI/TIA/EIA-492AAAB. Detail Specification for 50- μ m Core Diameter/ 125- μ m Cladding Diameter Class 1a Multimode Graded-Index Optical Waveguide Fibers. 50 micron fiber shall be laser optimized with support for 10 GB serial at 500m.
- I. All single-mode equipment shall comply with the latest American National Standards Institute/Telecommunications Industry Association/Electronic Industries Alliance Specification ANSI/TIA/EIA-492CAA. Detail Specification for Class IVa Dispersion—Unshifted Single-Mode Optical Fibers.

1.4 SYSTEM WARRANTY

- A. System shall carry an industry standard, performance based warranty, by the manufacturer and contractor, for a period of at least 20 years on the fiber-optic cabling; including patch panels, patch cables, terminations and labor. The remaining portions of the system shall be warranted for a period of one (1) year from date of substantial completion.

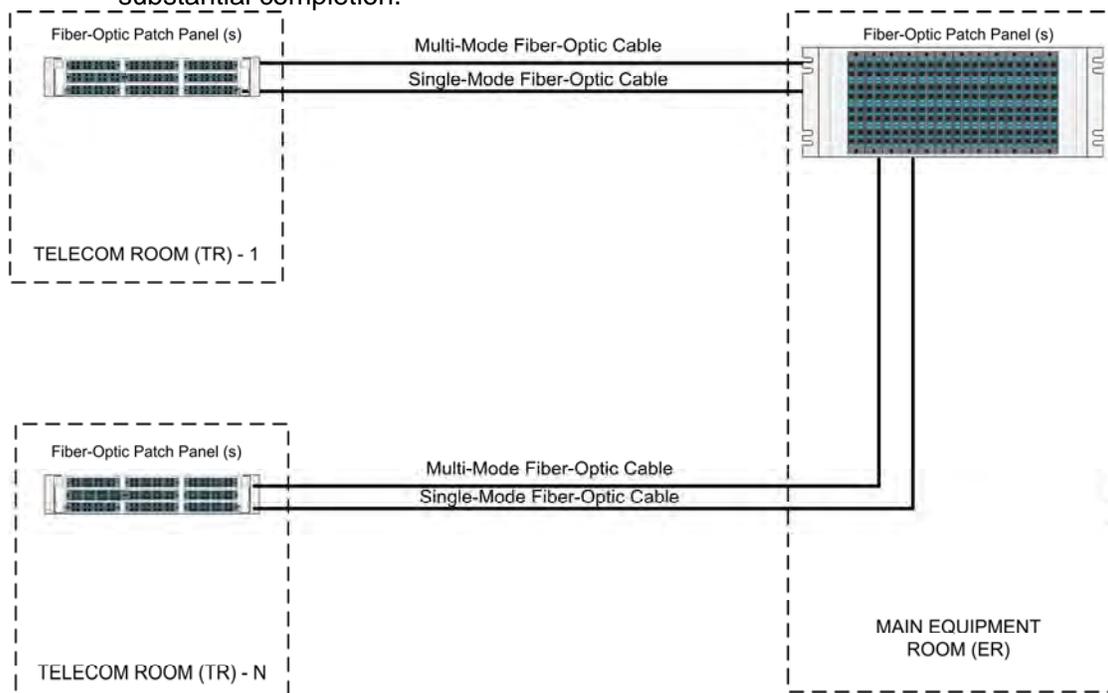


Figure 1 – Main Equipment Room (ER) to Telecommunication Rooms (TRs) Fiber-Optic Backbone Cable System

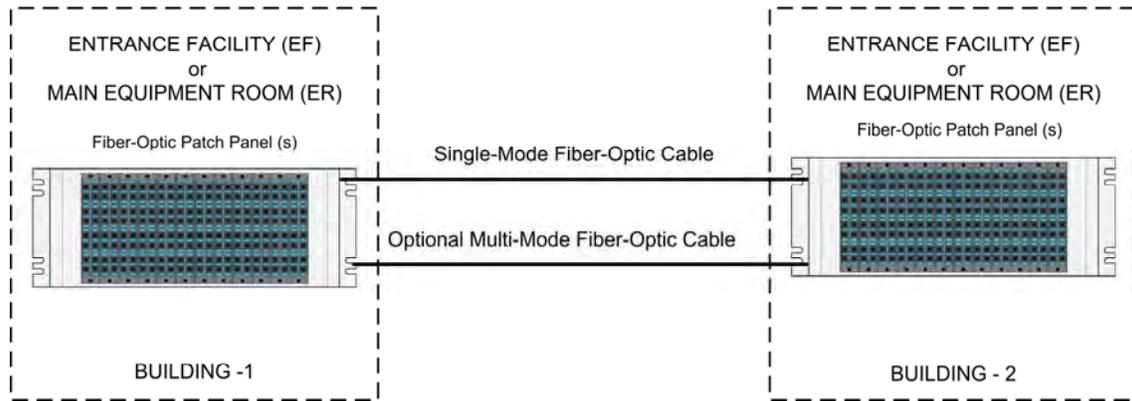


Figure 2 – Main Equipment Room (ER) to Main Equipment Room (ER) Inter-Building Fiber-Optic Backbone Cable System

1.5 INTRA-BUILDING OPTICAL FIBER BACKBONE CABLE SYSTEMS

A. MAIN EQUIPMENT ROOM (ER) TO TELECOMMUNICATION ROOMS (TR) FIBER-OPTIC BACKBONE CABLE SYSTEM

1. GENERAL

- a. Provide a multi-mode and single-mode Optical Fiber Backbone System for all new and renovated Buildings when the building contains more than one (1) Telecommunications Closet.
- b. Upgrade existing Optical Fiber Backbone Systems to the following requirements.
- c. Ground the Cable sheath of aerial fiber-optic cables to the associated Telecommunications Main Grounding Bus (TMGB) at both ends.
- d. Depending on the application, provide metal protective sheaths and appropriate rodent protection devices for aerially installed fiber-optic cables.

2. MULTI-MODE FIBER-OPTIC CABLE

- a. Provide a Multi-Mode, Fiber-Optic Cable between the Main Equipment Room and each associated Telecommunications Room (TR).
- b. The Multi-Mode, Fiber-Optic cable shall be 50/125 micron laser optimized fiber. (62.5/125 is acceptable for legacy systems)
- c. The entire District must utilize either 62.5/125 OR 50/125 micron fibers. A combination of both types is not recommended.
- d. The Multi-Mode, Fiber Optic cable shall be OFNP rated, tight-buffered and installed in plenum rated inner-duct.
- e. The Multi-Mode, Fiber-Optic cable shall be **sized per the following formula; # strands: 6 strands per 48 ports**. TE/TR serving less than 96 users shall be minimum 12 strands.
- f. Provide spare fibers after initial Network Configuration Design.
- g. The Multi-Mode fibers shall be terminated with fusion-spliced, factory-polished, SC or LC Pigtails.

- i. Classroom fibers are not supplied for new construction; however, for existing construction (renovations), the fibers may be terminated with epoxy cured, field-terminated, SC or LC Connectors.

3. SINGLE-MODE FIBER-OPTIC CABLE

- a. Provide a Single-Mode, Fiber-optic Cable between the Main Equipment Room (ER) and each associated Telecommunications Room (TR).
- b. The Single-Mode, Fiber Optic cable shall be 8.7/125 micron fiber.
- c. The Single-Mode, Fiber Optic cable shall be OFNP rated, tight-buffered and installed in plenum rated inner-duct.
- d. The Single-Mode, Fiber Optic cable shall be a minimum 6 strands per TR to MC.
- e. The Single-mode fibers shall be terminated with fusion-spliced, factory-polished, SC or LC Pigtails capable of 10 Gbps operation.
- f. Angle-Polished Connectors (APC) shall be utilized on all Single-mode fibers used to support AM Video (CATV, etc.) applications.

1.6 INTER-BUILDING OPTICAL FIBER BACKBONE CABLE SYSTEMS

A. MAIN EQUIPMENT ROOM (ER) TO MAIN EQUIPMENT ROOM (ER) INTER-BUILDING FIBER-OPTIC BACKBONE CABLE SYSTEM

1. GENERAL

- a. Provide a single-mode Optical Fiber Backbone System between all buildings on the same campus.
- b. Provide an optional, multi-mode Optical Fiber Backbone System between all buildings on the same campus that are less than 250 meters between building ERs.
- c. Upgrade existing Optical Fiber Backbone Systems to the following requirements.

2. MULTI-MODE FIBER-OPTIC CABLE - OPTIONAL

- a. Provide an optional Multi-Mode, Fiber-Optic Cable between the Main Equipment Room (ER) of the Network Center and each associated Building's Main Equipment Room (ER).
- b. The Multi-Mode, Fiber-Optic cable shall be 50/125 micron laser optimized fiber. (62.5/125 is acceptable for legacy systems.)
- c. The entire District must utilize either 62.5/125 OR 50/125 micron fibers. A combination of both types is not recommended.
- d. The Multi-Mode, Fiber Optic cable shall be gel-filled or indoor/outdoor rated, tight-buffered cable installed in underground duct banks or aerially between buildings.
- e. If the fiber-optic cable shares the duct bank with other cables, install an inner-duct.
- f. The Multi-Mode, Fiber-Optic cable shall be a minimum 12 strands between buildings -- ER to ER.
- g. Provide a minimum of 25% spare fibers after initial Network Configuration Design.
- h. The Multi-Mode fibers shall be terminated with fusion-spliced, factory-polished, SC or LC Pigtails.

COMMUNICATIONS

CHAPTER 9: SPECIFICATIONS

3. SINGLE-MODE FIBER-OPTIC CABLE
 - a. Provide a Single-Mode, Fiber-optic Cable between the Main Equipment Room (ER) of the Network Center and each associated Building's Main Equipment Room (ER).
 - b. The Single-Mode, Fiber Optic cable shall be an 8.7/125 micron fiber.
 - c. The Single-Mode, Fiber Optic cable shall be gel-filled or indoor/outdoor rated, tight-buffered cable installed in underground duct banks or aerially between buildings.
 - d. If the fiber-optic cable shares the duct bank with other cables, install an inner-duct.
 - e. The Single-Mode, Fiber-Optic cable shall be a minimum 12 strands between buildings -- ER to ER.
 - f. The Single-mode fibers shall be terminated with fusion-spliced, factory-polished, SC **or LC** Pigtails capable of 10 Gbps operation.
 - g. Angle-Polished Connectors (APC) shall be utilized on all Single-mode fibers used to support AM Video (CATV, etc.) applications.

1.7 OPTICAL FIBER PATCH PANEL SYSTEMS

- A. FIBER-OPTIC PATCH PANELS
 1. Fiber-Optic patch panels shall be mounted in equipment racks.
 2. Fiber-Optic patch panels shall be rack-mounted and shall be 24/48/72/144 port, or as required.
 3. Provide "Dual SC **or LC**" type couplers for multi-mode and single-mode cables.
- B. FIBER-OPTIC CONNECTORS
 1. Terminate Multi-Mode fibers with factory-terminated SC **or LC** multi-mode pigtails. Match fiber cable type provided.
 2. Terminate Single-Mode fibers with factory-terminated SC **or LC** single-mode pigtails. Match fiber cable type provided.
- C. FIBER-OPTIC SPLICE TRAYS
 1. Provide Fiber-Optic Fusion Splice Trays for connecting the factory-terminated, SC **or LC** pigtails to the associated Multi-Mode and Single-Mode fibers.

1.8 INSTALLATION

- A. All cabling shall be installed according to ANSI/EIA/TIA specifications and BISC standards.
- B. All fiber-optic cabling shall be terminated on rack-mounted patch panels using fusion-spliced, pigtails, as noted above.
- C. Provide space in rack (min 3 units) for possible District or DA-Site-provided, inter-building Fiber-Optic Cable Patch Panel.

1.9 LABELING

- A. All racks, patch panels, cables, jacks, system components, etc. shall be labeled according to ANSI/EIA/TIA-606 specifications and in coordination with the District/architect.

- B. All Fiber-Optic cables shall be equipped with a self-laminating, wrap-around, machine printed label at both ends of the cable.
- C. All Fiber-Optic Patch Panels shall be equipped with pre-printed, cable identification designation strips installed behind clear plastic label holders on the front of the patch panel.

1.10 TESTING

- A. All Cable test results shall be stored and presented to the Architect in both hard copy and electronic format for approval.
- B. All Cable Tester, Record designations shall match the associated cable label, and associated patch panel label designation.
- C. All Fiber-Optic Cables shall be tested with both a power meter and an OTDR.

END OF SECTION

SECTION 271333

COMMUNICATIONS COAXIAL BACKBONE CABLING

GENERAL GUIDELINES**1.1 GENERAL**

- A. This Section defines the general design requirements for a uniform Intra-Building Coaxial CATV Backbone Cabling Infrastructure that shall be followed for all OSFC Technology construction projects.
 - 1. Figure 1 describes a typical Intra-Building Coaxial Backbone Cabling Systems.
 - 2. Refer to Section 8500, Technology Systems, and Section 8600, Electrical Systems, for additional information.

1.2 SECTION INCLUDES

- A. INTRA-BUILDING COAXIAL CABLE BACKBONE CABLE SYSTEMS
 - 1. Main Equipment Room (ER) to Telecommunication Rooms (TR) Coaxial Backbone Cable System.
- B. COAXIAL CABLE PATCH PANEL SYSTEMS
 - 1. Coaxial Backbone Cable
 - 2. Coaxial Cable Connectors
 - 3. Coaxial Cable Patch Panels

1.3 QUALITY ASSURANCE

- A. All equipment shall be UL listed.
- B. All equipment and Installation Practices shall comply with the latest ANSI/NFPA-70 National Electric Code.
- C. All equipment Installation Practices shall comply with the Local Electric Code.
- D. All equipment shall comply with the latest ANSI-J-STD-607 Commercial Building Grounding (Earthing) and Bonding Requirements for Telecommunications Standard.
- E. All equipment and Installation Practices shall comply with the latest BICSI[®] Telecommunications Distribution Methods Manual (TDMM) and BICSI[®] Customer-Owned Outside Plant Design Manual.
- F. All equipment shall comply with the latest ANSI TIA/EIA-568, 569, 606, 607, standards.

1.4 SYSTEM WARRANTY

- A. System shall carry an industry standard, performance based warranty, by the manufacturer and contractor, for a period of at least 20 years on the cabling; including patch panels, patch cables, terminations and labor. The remaining portions of the system shall be warranted for a period of one (1) year from date of substantial completion.

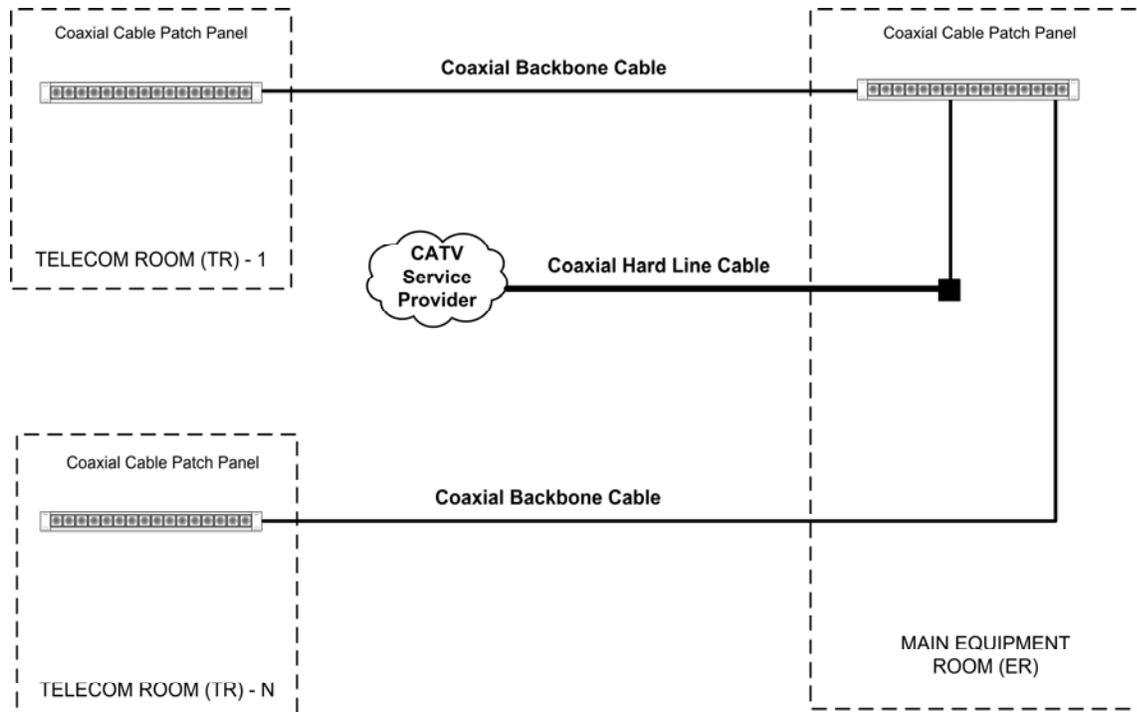


Figure 1 – Main Equipment Room (ER) to Telecommunication Rooms (TRs) Coaxial Cable Backbone Cable System

1.5 INTRA-BUILDING COAXIAL CABLE BACKBONE CABLE SYSTEMS

- A. MAIN EQUIPMENT ROOM (ER) TO TELECOMMUNICATION ROOMS (TR) COAXIAL BACKBONE CABLE SYSTEM
1. GENERAL
 - a. When a building is not supplied with an MPEG, CATV, Head-End System, a Coaxial Cable, CATV System is required.
 - b. Provide a Coaxial Cable Backbone System for all new and renovated Buildings.
 - c. Buildings served with a MPEG CATV Head end do not require a Coaxial Cable Backbone System.
 - d. For most buildings, a star-wired, Coaxial Cable, CATV System can be served from one closet (the Main Equipment Room – ER) – drops up to 450 feet.

COMMUNICATIONS

CHAPTER 9: SPECIFICATIONS

- e. For large buildings that cannot be served only from the Main Equipment Room, a CATV Coaxial Cable Backbone is required to connect the ER to the associated TRs.
 - f. The CATV Backbone System shall have a minimum frequency bandwidth between 5MHz and 750MHz.
2. COAXIAL BACKBONE CABLE
- a. Provide a plenum-rated, quad shield RG-11 or PIII .500 Hard Line,, CATV, Coaxial Cable between the Main Equipment Room (ER) and each of the associated Telecommunications Rooms (TRs).
 - b. Extend CATV Backbone Coaxial Cables from the wall-field to the associated Coaxial Cable Patch Panel with RG-6 male-male, pig-tails.
 - c. Extend CATV Service Provider Coaxial Cables from the wall-field to the associated Coaxial Cable Patch Panel with RG-11 male-male, pig-tails.
 - d. **Extend the** CATV service from the Service Provider's DEMARC to the Main Equipment Room (ER).
 - e. The Coaxial RG-6 and RG-11 cables shall be CATVP rated.
 - f. The Coaxial backbone cables shall be sweep tested to 1000 MHz and shall meet the following minimum performance values listed in dB/100 feet:

Mhz	Series 6	Series 11	500 Hard Line
55	1.50	0.95	0.55
450	4.28	2.69	1.63
750	5.82	3.58	2.16
1000	6.54	4.23	2.53

Figure 2 –Coaxial Backbone Cable Minimal Parameters

3. COAXIAL CABLE CONNECTORS
- a. Provide two-part, crimp-style, Coax Cable, Male F-Connectors at each end of the RG-11, Coaxial Backbone Cables.
 - b. Provide two-part, Coax Cable, Female F-Connectors at each end of the Hard-Line, Coaxial Backbone Cables.
 - c. Match the connectors to the Coaxial Cable Manufacturer.
4. COAXIAL CABLE PATCH PANELS
- a. Provide F-Connector Bulkheads in the User Coax Drop Patch Panel for the termination of the RG-11 Coaxial Backbone Cables.

1.6 INSTALLATION

- A. All cabling shall be installed according to ANSI/EIA/TIA specifications and BISC standards.
- B. All coaxial cabling shall be terminated on rack-mounted patch panels using F-Connectors, as noted above.

1.7 LABELING

- A. Patch panels, cables, jacks, system components, etc. shall be labeled according to ANSI/EIA/TIA-606 specifications and in coordination with the District/architect.
- B. All Coaxial Cables shall be equipped with a self-laminating, wrap-around, machine printed label at both ends of the cable.
- C. All Coaxial Cable Patch Panels shall be equipped with pre-printed, cable identification designation strips installed behind clear plastic label holders on the front of the patch panel.

1.8 TESTING

- A. All Cable test results shall be stored and presented to the Architect in both hard copy and electronic format for approval.
- B. All Cable Tester, Record designations shall match the associated cable label, and associated patch panel label designation.
- C. All Coaxial Cables shall be tested with a hand held cable tester.

END OF SECTION

SECTION 271513

COMMUNICATIONS COPPER HORIZONTAL CABLING

GENERAL GUIDELINES**1.1 GENERAL**

- A. This Section defines the general design requirements for a uniform Communications Copper Horizontal Cabling System Infrastructure that shall be followed for all OSFC Technology construction projects.
 - 1. Refer to Section 8500, Technology Systems, and Section 8600, Electrical Systems, for additional information.

1.2 SECTION INCLUDES

- A. COMMUNICATIONS COPPER HORIZONTAL CABLING SYSTEM SYSTEMS
 - 1. Modular Jacks
 - 2. Modular Cover Plates
 - 3. Horizontal Cable
 - 4. Modular Patch Panels

1.3 QUALITY ASSURANCE

- A. All equipment shall be UL listed.
- B. All equipment and Installation Practices shall comply with the latest ANSI/NFPA-70 National Electric Code.
- C. All equipment Installation Practices shall comply with the Local Electric Code.
- D. All equipment shall comply with the latest ANSI-J-STD-607 Commercial Building Grounding (Earthing) and Bonding Requirements for Telecommunications Standard.
- E. All equipment and Installation Practices shall comply with the latest BICSI[®] Telecommunications Distribution Methods Manual (TDMM).
- F. All equipment shall comply with the latest ANSI TIA/EIA-568, 569, 606, 607, 862, standards.
- G. As a minimum, all equipment shall meet Category 5e transmission performance standards.
- H. All connecting equipment shall be from the same manufacturer.

1.4 SYSTEM WARRANTY

- A. System shall carry an industry standard, performance based warranty, by the manufacturer and contractor, for a period of at least 20 years on the horizontal cabling; including patch panels, patch cables, terminations and labor. The remaining portions of the system shall be warranted for a period of one (1) year from date of substantial completion.

1.5 MODULAR JACKS

- A. Each 4-pair 100-ohm UTP data cable shall be terminated in an eight position, modular jack at the Work Area (WA).
- B. The data cable shall be terminated directly to the modular jack with insulation displacement connectors.
- C. The modular jack shall be a minimum of Category 5e compliant.
- D. The modular jack pair/pin assignments shall be T568B.

1.6 COVER PLATES

- A. Plates shall be modular, front-loading and colored to match the video/data wall plates.
- B. All plate colors shall be coordinated with the architect to match furnishings and fixtures.
- C. Wall mounted phones shall utilize 630 style faceplates.

1.7 HORIZONTAL CABLE

- A. In accordance with ANSI/EIA/TIA 568B.2 all horizontal data cable shall be:
 - 1. UL listed, 4-pair 100 ohm, UTP, Category 5e (**350 MHz rated**) compliant
 - 2. Conductors shall be 24 AWG, solid bare annealed copper.
 - 3. Cable shall be insulated with FEP material.
 - 4. Cable shall be NEC CMP rated.
- B. Cable shall be sequentially marked at 2-foot intervals.
- C. Cable pairs shall be color coded:
 - 1. Pair 1- White/Blue and Blue.
 - 2. Pair 2- White/Orange and Orange
 - 3. Pair 3- White/Green and Green
 - 4. Pair 4- White/Brown and Brown
- D. Provide horizontal Category-5e (minimum) cable drops for:
 - 1. Administrative Computers
 - 2. Bulletin Board System
 - 3. CCTV Cameras (as required)
 - 4. Classroom and Lab Computers
 - 5. Desk top phones
 - 6. Distance Learning Systems
 - 7. Door Phones (as required)
 - 8. Electrical Closets
 - 9. Elevator Phones
 - 10. Energy Management Systems (EMS)
 - 11. Fax Machines
 - 12. Fire Alarm Systems
 - 13. HVAC Equipment

COMMUNICATIONS**CHAPTER 9: SPECIFICATIONS**

14. LCD TVs
 15. Master Clock System (as required)
 16. Mechanical Closets
 17. Miscellaneous Network Attached Devices
 18. Pay Station Phones (as required)
 19. Point of Sale Terminals (as required)
 20. Printers
 21. Projectors
 22. Security and Access Control Systems
 23. Set Top Boxes (as required)
 24. Teacher Technology Centers
 25. Video Conference Units
 26. Wall mounted phones
 27. Wireless Access Points (APs)
- E. Telecommunication outlet/connectors that serve an individual work area may be located in multiple faceplates.

1.8 MODULAR PATCH PANELS

- A. All patch panels shall be in accordance with ANSI/EIA/TIA 568B.2 (or latest) and shall be equipped with eight position, modular jacks with insulation displacement connectors, rear cable-management bars/standoffs and front label designation strips.
- B. Provide 24 or 48 port, Category 5e (minimum) rated patch panels for termination of all horizontal cabling. When the Equipment Room (ER) or Telecommunications Room (TR) serves more than one floor, sequentially group the cables by floor on separate patch panels.
- C. Provide color-coded, Category 5e (minimum) rated patch cords for all connections (plus 10% spare).

1.9 INSTALLATION

- A. All cabling shall be installed according to ANSI/EIA/TIA specifications and BISC standards.
- B. All horizontal telephone cabling shall be terminated on Category 5e (minimum) patch panels and jacks as noted above.
- C. Consider providing cable slack at both ends of the horizontal cables to accommodate future cabling system changes.

1.10 LABELING

- A. All patch panels, cables, jacks, system components, etc. shall be labeled according to ANSI/EIA/TIA-606 specifications and in coordination with the owner/architect.
- B. All horizontal cables shall be equipped with a self-laminating, wrap-around, machine printed label at both ends of the cable.

- C. All Patch Panels shall be equipped with pre-printed, cable identification designation strips installed behind clear plastic label holders on the front of the patch panel.
- D. All Modular Plates shall be equipped with a pre-printed, cable identification strip, installed behind a clear plastic label holder.

1.11 TESTING

- A. All horizontal cabling shall be tested to Category 5e (or Category 6) performance levels in accordance with ANSI TIA/EIA-568-B.2 (or latest) specifications, using a Level III compliant tester.
- B. All Cable test results shall be stored and presented to the Architect in both hard copy and electronic format for approval.
- C. All Cable Tester Record designations shall match the associated cable label, patch panel label and faceplate label.

END OF SECTION

SECTION 271533**COAXIAL COMMUNICATIONS HORIZONTAL CABLING****GENERAL GUIDELINES****1.1 GENERAL**

- A. This Section defines the general design requirements for a uniform Coaxial Communications Cabling System Infrastructure that shall be followed for all OSFC Technology construction projects.
 - 1. Figure 1 describes a Typical Coaxial Communications Cabling System – ER Serves all Locations.
 - 2. Figure 2 describes a Typical Coaxial Communications Cabling System – Multiple TRs.
 - 3. Refer to Section 8500, Technology Systems, and Section 8600, Electrical Systems, for additional information.

1.2 SECTION INCLUDES

- A. COAXIAL COMMUNICATIONS HORIZONTAL CABLING
 - 1. Coaxial Cable

1.3 QUALITY ASSURANCE

- A. All equipment shall be UL listed.
- B. All equipment and Installation Practices shall comply with the latest ANSI/NFPA-70 National Electric Code.
- C. All equipment Installation Practices shall comply with the Local Electric Code.
- D. All equipment shall comply with the latest ANSI-J-STD-607 Commercial Building Grounding (Earthing) and Bonding Requirements for Telecommunications Standard.
- E. All equipment and Installation Practices shall comply with the latest BICSI[®] Telecommunications Distribution Methods Manual (TDMM).
- F. All equipment shall comply with the latest ANSI TIA/EIA-568, 569, 606, 607, 862, standards.
- G. As a minimum, all equipment shall meet Category 5e transmission performance standards.

1.4 SYSTEM WARRANTY

- A. System shall carry an industry standard, performance based warranty, by the manufacturer and contractor, for a period of at least 20 years on the fiber-optic cabling; including patch panels, patch cables, terminations and labor. The remaining portions of the system shall be warranted for a period of one (1) year from date of substantial completion.

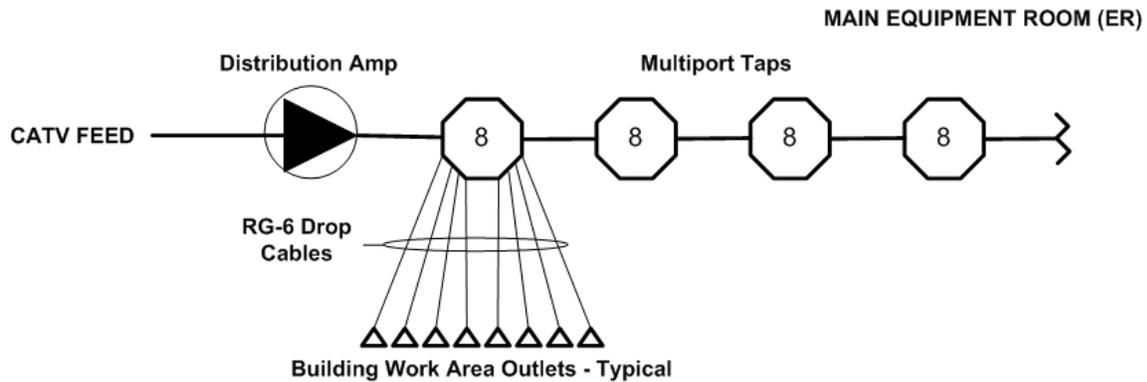


Figure 2 - Typical Coaxial Communications Cabling System – ER serves all Locations

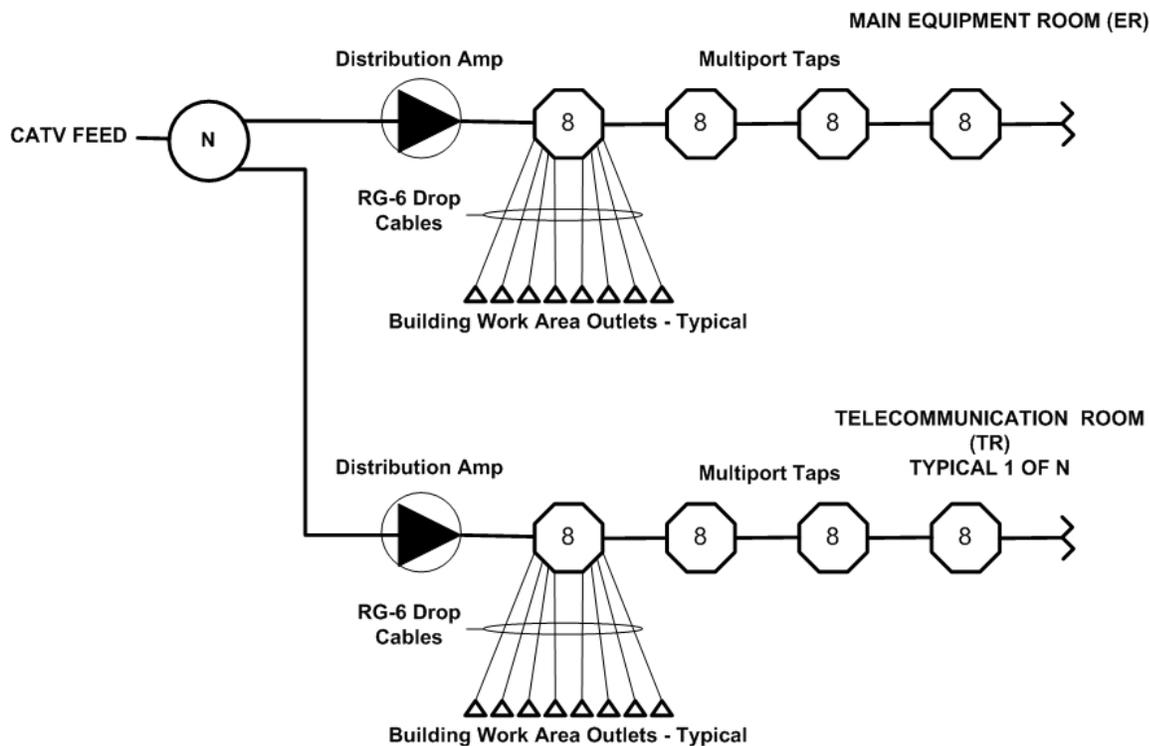


Figure 2 - Typical Coaxial Communications Cabling System – Multiple TRs

1.5 COAXIAL CABLE

A. GENERAL

1. When a building is not supplied with an MPEG, CATV, Head-End System, a Coaxial Cable based CATV System is required.
2. Provide a Horizontal Coaxial Cable System for all new and renovated Buildings.

COMMUNICATIONS

CHAPTER 9: SPECIFICATIONS

3. Buildings served with a MPEG CATV Head end do not require a Horizontal Coaxial Cable System.
 4. For most buildings, a star-wired, Coaxial Cable, CATV System can be served from one closet (the Main Equipment Room – ER) – drops up to 450 feet.
 5. For large buildings that cannot be served only from the Main Equipment Room (ER), the horizontal coaxial cables connect to the associated TRs.
 6. The CATV Horizontal Coaxial Cable System shall have a minimum frequency bandwidth between 5MHz and 750MHz and support for HDTV.
- B. HORIZONTAL COAX CABLE
1. The Broadband Wiring System shall be a bi-directional, star-wired, home-run, coaxial distribution system using Quad Shielded RG-6/RG-11 Coax Cable.
 2. The RG-6 coaxial cables shall be CATVP rated.
 3. The coaxial cables shall be sweep tested to 1000 MHz and shall meet the following minimum performance values listed in dB/100 feet:

Mhz	Series 6
55	1.50
450	4.28
750	5.82
1000	6.54

Figure 3 – RG-6 Coaxial Cable Minimal Parameters

1.6 COAXIAL CABLE CONNECTORS

- A. Provide two-part, crimp-style, Coax Cable, Male F-Connectors at each end of the RG-6, Horizontal Coaxial Cables.
- B. Match the connectors to the Coaxial Cable Manufacturer.

1.7 MODULAR FACEPLATES

- A. Terminate the Horizontal Coax Cable on a dual female F-Connector Bulkhead installed in the Work Area Outlet.

1.8 COAXIAL CABLE PATCH PANELS

- A. Provide 16, 24, 32 or 48 port F-Connector User Coax Drop Patch Panels for the termination of the RG-6 Horizontal Coaxial Cables.

1.9 INSTALLATION

- A. All cabling shall be installed according to ANSI/EIA/TIA specifications and BISC1 standards.
- B. All coaxial cabling shall be terminated on rack-mounted patch panels using F-Connectors, as noted above.

1.10 LABELING

- A. Patch panels, cables, jacks, system components, etc. shall be labeled according to ANSI/EIA/TIA-606 specifications and in coordination with the District/architect.
- B. All Coaxial Cables shall be equipped with a self-laminating, wrap-around, machine printed label at both ends of the cable.
- C. All Coaxial Cable Patch Panels shall be equipped with pre-printed, cable identification designation strips installed behind clear plastic label holders on the front of the patch panel.

1.11 TESTING

- A. All Cable test results shall be stored and presented to the Architect in both hard copy and electronic format for approval.
- B. All Cable Tester, Record designations shall match the associated cable label, and associated patch panel label designation.
- C. All Coaxial Cables shall be tested with a hand held cable tester.

END OF SECTION

SECTION 271543

AUDIO-VIDEO COMMUNICATIONS HORIZONTAL CABLING

GENERAL GUIDELINES**1.1 GENERAL**

- A. This Section defines the general design requirements for a uniform Audio-Video Horizontal Cabling System Infrastructure that shall be followed for all OSFC Technology construction projects.
- B. Figure 1 describes a Typical Classroom Audio-Video System.
- C. Refer to Section 8500, Technology Systems, and Section 8600, Electrical Systems, for additional information.

1.2 SECTION INCLUDES

- A. AUDIO-VIDEO COMMUNICATIONS HORIZONTAL CABLING
 - 1. Instructor HI-LO Stations
 - 2. Instructor HI-LO Cables
 - 3. Monitor/TV HI-LO Stations
 - 4. Monitor/TV HI-LO Cables
 - 5. Public Monitor/TV Stations
 - 6. Public Monitor/TV Cables
 - 7. Video Cover Plates

1.3 QUALITY ASSURANCE

- A. All equipment shall be UL listed.
- B. All equipment and Installation Practices shall comply with the latest ANSI/NFPA-70 National Electric Code.
- C. All equipment Installation Practices shall comply with the Local Electric Code.
- D. All equipment shall comply with the latest ANSI-J-STD-607 Commercial Building Grounding (Earthing) and Bonding Requirements for Telecommunications Standard.
- E. All equipment and Installation Practices shall comply with the latest BICSI[®] Telecommunications Distribution Methods Manual (TDMM).
- F. All equipment shall comply with the latest ANSI TIA/EIA-568, 569, 606, 607, 862, standards.

1.4 SYSTEM WARRANTY

- A. System shall carry an industry standard, performance based warranty, by the contractor, for a period of at least 20 years on the cabling; including patch panels, patch cables, terminations and labor. The remaining portions of the system shall be warranted for a period of one (1) year from date of substantial completion.

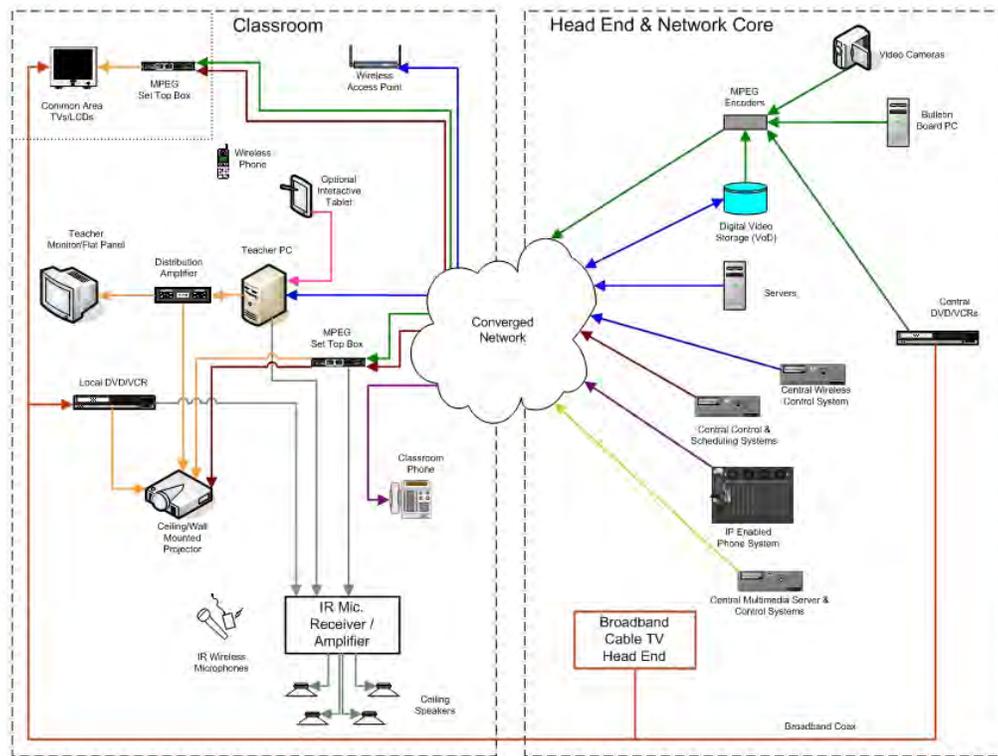


Figure 1 – Typical Classroom Audio Visual System

1.5 INSTRUCTOR HI-LO STATIONS

- A. The classroom and lab instructor's Technology Station shall be equipped with a Video HI/LO station.
- B. The video cabling system for the overhead mounted **or wall mounted** projector shall also include a HI-LO system for connecting the projector to local and central programming sources.
- C. The Instructor's PC shall be connected to the Video LO XGA-IN **via a local XGA Splitter**. The Instructor's Monitor shall be connected to the local XGA Splitter **output**. The PC Audio output shall be connected to the associated classroom Audio Enhancement Amplifier inputs.
- D. When an optional Interactive Tablet is supplied, it shall be connected to the Instructor's PC **via the supplied wireless interface**.
- E. The Instructor's DVD Player S-Video or Component Video Output shall be connected to the LO S-Video or LO Component-Video. The DVD Audio Outputs shall be connected to the associated classroom Audio Enhancement Amplifier inputs.
- F. The Instructor's VHS Player Composite Video Output shall be connected to the LO Composite Video. The VHS Audio Outputs shall be connected to the associated classroom Audio Enhancement Amplifier inputs.
- G. The XGA Video output from the MPEG Set-Top-Box shall be connected to the second XGA input on the Projector. The Set-Top-Box audio output shall be connected to the associated classroom Audio Enhancement Amplifier inputs.

COMMUNICATIONS

CHAPTER 9: SPECIFICATIONS

- H. Provide additional XGA splitters, A/B switches, and Distribution amplifiers as required.
- I. The HI video outlets at the Projector shall have as a minimum the following:
1. **HD-15 Female Jack connected to LO Station for XGA-IN.**
 2. S-Video Female Jack connected to LO Station.
 3. RCA Female Composite-Video Jack (Yellow) connected LO Station.
 4. RJ-45 Female Jack for Connection of Projector to Central Projector Control System via the Local Area IP Network.
 5. RJ-45 Female Jack for Connection of optional MPEG Set Top Box to the Local Area IP Network.
 6. RCA L/R Audio Jacks (White/Red) for connection of MPEG Set Top Box to LO Station.
- J. The LO video outlets at the Instructor's Technology Center shall have as a minimum the following:
1. **HD-15 Female Jack connected to HI Station for XGA-Out.**
 2. S-Video Female Jack connected to HI Station for connection of the Instructor's DVD player output to the Projector.
 3. RCA Female Composite-Video Jack (Yellow) connected HI Station for connection of the Instructor's VHS player output to the Projector.
 4. RJ-45 Female Jack for Connection of Instructor's PC to the Local Area IP Network.
 5. RCA L/R Audio Jacks (White/Red) for connection of MPEG Set Top Box to the associated classroom Audio Enhancement Amplifier inputs.
 6. Optional Female "F" Connector for connection of Instructor's DVD/VHS Player to Broadband Network, as required when no MPEG CATV Head End is provided.

1.6 INSTRUCTOR HI-LO CABLES

- A. XGA CABLES
1. **Provide five-conductor mini-coaxes connected to HD-15 female connectors.**
- B. S-VIDEO CABLE
1. Provide **coaxial** cable connected to S-Video female connectors.
- C. COMPOSITE-VIDEO CABLE
1. Provide **coaxial** cable connected to Female RCA connector (Yellow).
- D. AUDIO CABLE
1. Provide **shielded twisted pair** cable connected to Female RCA connectors (White/Red).
- E. PROJECTOR NETWORK CABLE
1. Provide one (1) Category-5e UTP cable connected to Category-5e patch panel in associated Telecommunications room.

- F. SET-TOP-BOX NETWORK CABLE
 1. Provide one (1) Category-5e UTP cable connected to Category-5e patch panel in associated Telecommunications room.
- G. INSTRUCTOR TECHNOLOGY CENTER NETWORK CABLE
 1. Provide two (2) Category-5e UTP cables connected to the Category-5e patch panel in associated Telecommunications room.
- H. VHS CATV CABLE
 1. Provide one (1) optional RG-6 Broadband CATV cable connected to User CATV Patch Panel in associated Telecommunications room.

1.7 MONITOR/TV HI-LO STATIONS

- A. The Monitor/TV Station, typically located in Conference Rooms and Small Self-Contained Classrooms, shall be equipped with a Video HI/LO station.
- B. The Monitor/TV Station, typically located in Reading Rooms, is in addition to the Instructor's Technology Station and shall be equipped with a Video HI/LO station. This unit is optional depending on the size of the room.
- C. The video cabling system for the wall-mounted, monitor/TV unit shall also include a HI-LO system for connecting the monitor/TV unit to local and central programming sources.
- D. The local XGA programming source shall be connected to the Video LO XGA-IN and the associated L/R audio outputs shall be connected to the monitor/TV inputs.
- E. Local DVD programming source S-Video Output shall be connected to the LO S-Video. The DVD Audio Outputs shall be connected to the monitor/TV audio inputs.
- F. Local VHS programming source Composite Video Output shall be connected to the LO Composite Video. The VHS Audio Outputs shall be connected to the monitor/TV audio inputs.
- G. The XGA Video output from the associated MPEG Set-Top-Box shall be directly connected to a XGA input on the Monitor/TV. The Set-Top-Box audio output shall be directly connected to the monitor/TV audio inputs.
- H. The HI video outlets at the Monitor/TV shall have as a minimum the following:
 1. HD-15 Female Jacks connected to LO Station for XGA-IN.
 2. S-Video Female Jack connected to LO Station.
 3. RCA Female Composite-Video Jack (Yellow) connected LO Station.
 4. RCA L/R Audio Jacks (White/Red) connected to LO station.
 5. RJ-45 Female Jack for Connection of Monitor/TV to Central Control System via the Local Area IP Network.
 6. RJ-45 Female Jack for Connection of optional MPEG Set Top Box to the Local Area IP Network.
 7. Optional Female "F" Connector for connection of Monitor/TV to Broadband Network, as required when no MPEG CATV Head End is provided.

COMMUNICATIONS

CHAPTER 9: SPECIFICATIONS

- I. The LO video outlets shall have as a minimum the following:
 1. HD-15 Female Jacks connected to HI Station for XGA-IN.
 2. S-Video Female Jack connected to HI Station for connection of the local DVD player output to the Monitor/TV.
 3. RCA Female Composite-Video Jack (Yellow) connected HI Station for connection of the local VHS player output to the Monitor/TV.
 4. RJ-45 Female Jack for Work Area Connection to the Local Area IP Network.
 5. RCA L/R Audio Jacks (White/Red) for connection of local DVD and VHS units to the Monitor/TV audio inputs.

1.8 MONITOR/TV HI-LO CABLES

- A. XGA CABLES
 1. Provide one (1) five-conductor mini-coax connected to HD-15 female connectors.
- B. S-VIDEO CABLE
 1. Provide **coaxial** cable connected to S-Video female connectors.
- C. COMPOSITE-VIDEO CABLE
 1. Provide **coaxial** cable connected to Female RCA connector (Yellow).
- D. AUDIO CABLE
 1. Provide **shielded twisted pair** cable connected to Female RCA connectors (White/Red).
- E. MONITOR/TV NETWORK CABLE
 1. Provide one (1) Category-5e UTP cable connected to Category-5e patch panel in associated Telecommunications room.
- F. SET-TOP-BOX NETWORK CABLE
 1. Provide one (1) Category-5e UTP cable connected to Category-5e patch panel in associated Telecommunications room.
- G. WORK AREA NETWORK CABLE
 1. Provide one (1) Category-5e UTP cable connected to Category-5e patch panel in associated Telecommunications room.
- H. MONITOR/TV CATV CABLE
 1. Provide one (1) optional RG-6 Broadband CATV cable connected to User CATV Patch Panel in associated Telecommunications room.

1.9 PUBLIC MONITOR/TV HI-LO STATIONS

- A. The Public Monitor/TV Station, typically located in Entrances, Corridors and/or Reception areas, and Small Self-Contained Classrooms, shall be equipped with a Video HI station.
- B. The video cabling system for the wall-mounted, monitor/TV unit shall also include a HI system for connecting the monitor/TV unit to local and central programming sources.

- C. The XGA Video output from the associated MPEG Set-Top-Box shall be directly connected to a XGA input on the Monitor/TV. The Set-Top-Box audio output shall be directly connected to the monitor/TV audio inputs.
- D. The HI video outlets at the Monitor/TV shall have as a minimum the following:
 1. RJ-45 Female Jack for Connection of Monitor/TV to Central Control System via the Local Area IP Network.
 2. RJ-45 Female Jack for Connection of optional MPEG Set Top Box to the Local Area IP Network.
 3. Optional Female "F" Connector for connection of Monitor/TV to Broadband CATV Network, as required when no MPEG CATV Head End is provided.

1.10 PUBLIC MONITOR/TV HI-LO CABLES

- A. MONITOR/TV NETWORK CABLE
 1. Provide one (1) Category-5e UTP cable connected to Category-5e patch panel in associated Telecommunications room.
- B. SET-TOP-BOX NETWORK CABLE
 1. Provide one (1) Category-5e UTP cable connected to Category-5e patch panel in associated Telecommunications room.
- C. MONITOR/TV CATV CABLE
 1. Provide one (1) RG-6 Broadband CATV cable connected to User CATV Patch Panel in associated Telecommunications room.

1.11 VIDEO COVER PLATES

- A. Plates shall be modular to fit all video jack components and shall match the associated voice/data plates.

1.12 INSTALLATION

- A. Contractor shall provide and install Video HI-LO Wiring System.
- B. Cables and associated connectors shall be terminated in accordance with industry standards.
- C. Route the classroom Audio Enhancement Amplifier IR sensor coax and associated speaker cables through the LO faceplate to the Amplifier.

1.13 LABELING

- A. Cables, jacks, system components, etc. shall be labeled according to ANSI/EIA/TIA-606 specifications and in coordination with the District/architect.
- B. All Audio-Video Cables shall be equipped with a self-laminating, wrap-around, machine printed label at both ends of the cable.

1.14 TESTING

- A. Video Wiring system and associated systems shall be tested end-to-end complete.

END OF SECTION

SECTION 272100**DATA COMMUNICATIONS NETWORK EQUIPMENT****GENERAL GUIDELINES****1.1 GENERAL**

- A. This Section defines the general design requirements for a uniform Data Communications Network Infrastructure that shall be followed for all OSFC Technology construction projects.
 - 1. Figure 1 describes a Typical Data Communications Network System – Single Building.
 - 2. Figure 2 describes a Typical Data Communications Network System – Multiple Buildings on Same Campus.
 - 3. Figure 3 describes a Typical Data Communications Network System – District Wide.
 - 4. Refer to Section 8500, Technology Systems, and Section 8600, Electrical Systems, for additional information.

1.2 SECTION INCLUDES

- A. DATA COMMUNICATIONS NETWORK EQUIPMENT
 - 1. File/Building Server.
 - 2. Network Switches.
 - 3. Network Core Switch.
 - 4. Network Security Equipment.
 - 5. Uninterruptible Power Supplies (UPSs).

1.3 QUALITY ASSURANCE

- A. All equipment shall be UL listed.
- B. All equipment and Installation Practices shall comply with the latest ANSI/NFPA-70 National Electric Code.
- C. All equipment Installation Practices shall comply with the Local Electric Code.
- D. All equipment shall comply with the latest ANSI-J-STD-607 Commercial Building Grounding (Earthing) and Bonding Requirements for Telecommunications Standard.
- E. All equipment and Installation Practices shall comply with the latest BICSI[®] Telecommunications Distribution Methods Manual (TDMM).
- F. All equipment shall comply with the latest ANSI TIA/EIA-568, 569, 606, 607, 862, standards.

1.4 SYSTEM WARRANTY

- A. The Local Area Network Electronics and software shall be warranted by the contractor for a period of one (1) year from date of substantial completion. Provide advanced replacement for all Network Electronics for the one (1) year-period.

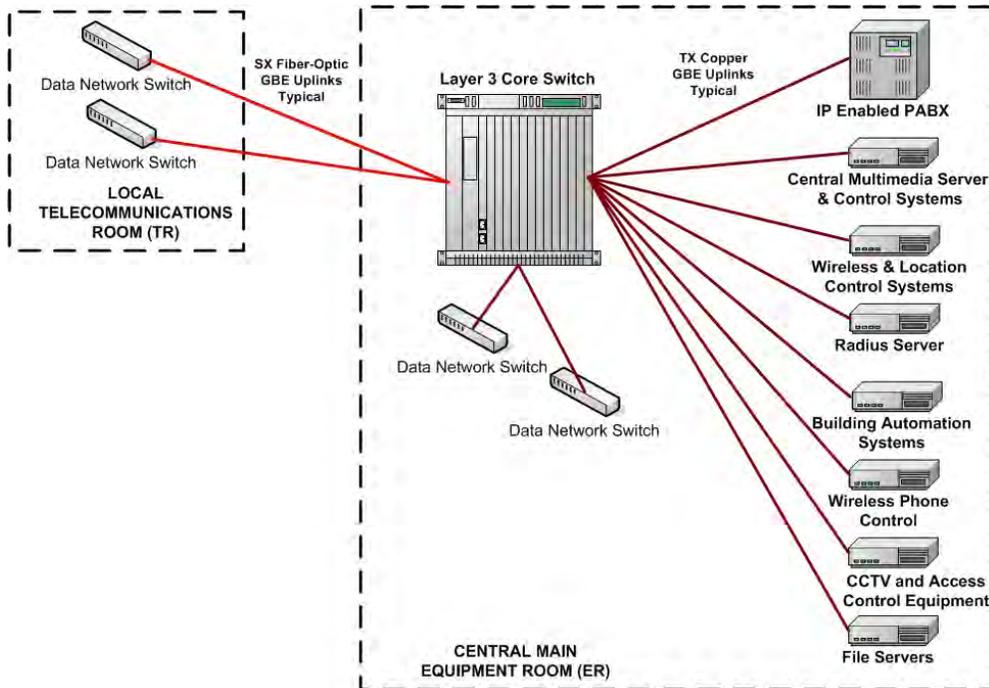


Figure 1 - Typical Data Communications Network System – Single Building

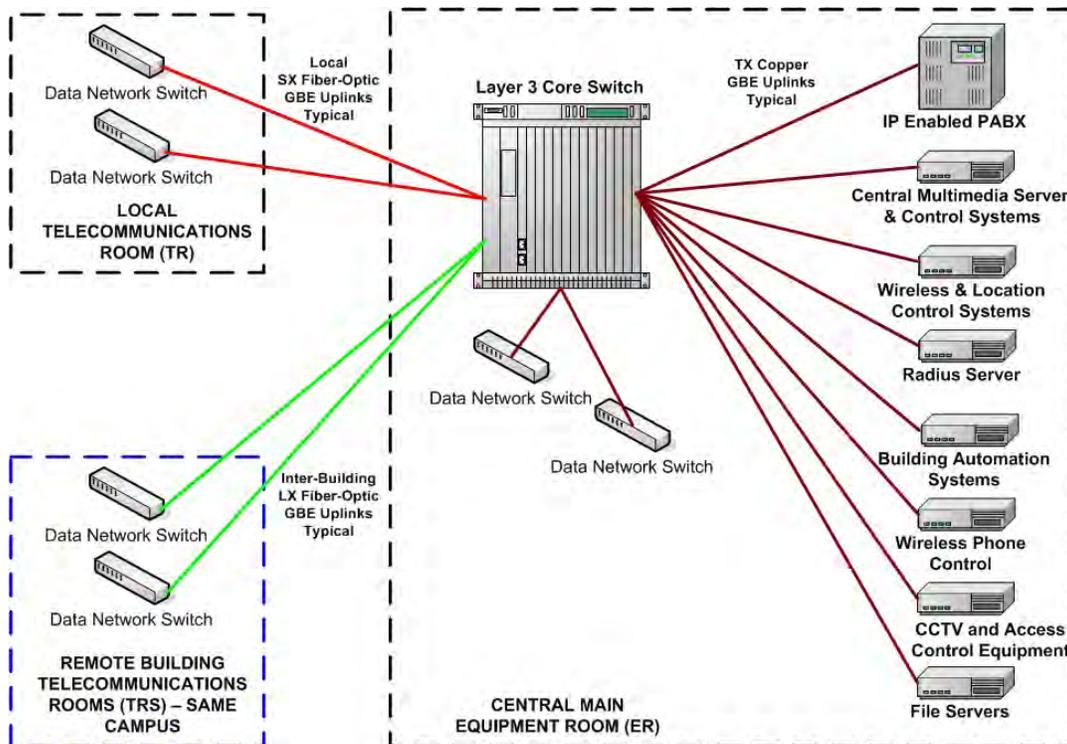


Figure 2 - Typical Data Communications Network System – Multiple Buildings on Same Campus

COMMUNICATIONS

CHAPTER 9: SPECIFICATIONS

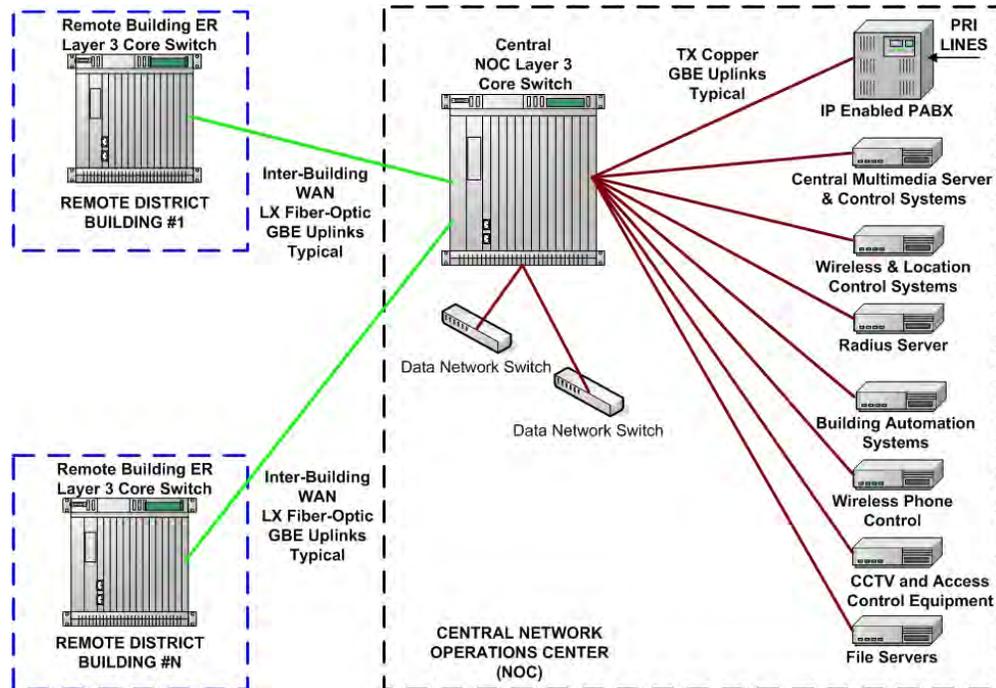


Figure 3 - Typical Data Communications Network System – District Wide

1.5 GENERAL

- A. Each Building shall be provided with a Local Area Network (LAN) System.
- B. Existing Facilities that are being remodeled shall be upgraded to the current requirements stated herein.
- C. Single Building projects shall be compatible with the existing District Network infrastructure.
- D. Wide Area Network (WAN) Interfaces shall be provided to interface the District's WAN provider. Coordinate WAN requirement with the District's fiber provider or DA-Site as applicable.
- E. Buildings shall be designed as to minimize the quantity of Telecommunications Rooms and to centralize as much of the Data Network Equipment as possible.
- F. Multiple buildings on the same campus should be designed to share common Data Network Electronics and equipment wherever possible.
- G. Districts should design their Data Networks to take advantage of Centralization of Common Network Equipment at a Network Operations Center(s).

- H. Items that should be centralized include:
 1. File/Building Servers.
 2. L-3 Routing Devices.
 3. Network Management Equipment.
 4. Security Devices, Radius Servers, etc.
 5. WAN access equipment.
 6. Wireless Management Equipment.

- I. As a minimum, the Network may be used to support the following applications on a Local and Wide Area basis:
 1. Automation Systems.
 2. Clock Systems.
 3. Control Systems.
 4. Data Networking
 5. Security Systems.
 6. Video Conferencing.
 7. Video Streaming/Media Retrieval.
 8. VoIP Telecommunications.
 9. Wireless Access Points.

1.6 FILE/BUILDING SERVER

- A. Provide Network File/Building Server for the central administration and storage of computer files and information. The Networked Server shall be of a current design criteria, utilizing dual Processor Architecture, 100/1000 Ethernet NIC, Minimum 3.0 GHz, 4GB RAM, 15 inch color monitor, rack-mounted and RAID level hard drive storage (minimum 160 GB).

- B. Provide Operating System based on District requirements.

1.7 NETWORK SWITCHES

- A. Provide **10/100/1000 BaseT** Layer 2 Manageable Ethernet Switches for all Horizontal connections with a minimum of one (1) full duplex Gigabit uplink for every 24 **10/100/1000** Ethernet Ports.

- B. Optional **10/100 switches can be utilized with approved OSFC variance.**

- C. The **10/100/1000** switches shall support a minimum forwarding bandwidth of **32 Gbps.**

- D. Chassis mounted units are acceptable for Edge Switches, provided that dual power supplies are provided and one Gigabit Uplink, per each group of 24 **10/100/1000** ports, is furnished for connection to the Central Layer-3 Core Switch.

- E. The Network switches shall support advanced services such as:
 1. IP Telephony.
 2. Wireless Access Points.
 3. Building Management Systems.
 4. Video Streaming.

- F. Power Over Ethernet (POE) Switches shall be IEEE 802.3.af compliant.
 1. **1 Gbps switch ports shall be provided for 802.11n Wireless Access Points(WAP).**

COMMUNICATIONS

CHAPTER 9: SPECIFICATIONS

-
- G. Limit POE port loading to 50% of the active ports for 48 port switches to minimize heat rise.
- H. The **10/100/1000** switches shall support the following features and specifications:
1. 1000BASE-LX/LH.
 2. 1000BASE-SX.
 3. 1000BASE-X (SFP).
 4. 1000BASE-ZX.
 5. Access Control Lists (ACL).
 6. Advanced QoS.
 7. IEEE 802.1s.
 8. IEEE 802.1D Spanning Tree Protocol.
 9. IEEE 802.1p CoS Prioritization.
 10. IEEE 802.1Q VLAN.
 11. IEEE 802.1s.
 12. IEEE 802.1w.
 13. IEEE 802.1x.
 14. IEEE 802.3 10BASE-T specification.
 15. IEEE 802.3ab 1000BASE-T specification.
 16. IEEE 802.3ad.
 17. IEEE 802.3af POE.
 18. IEEE 802.3u 100BASE-TX specification.
 19. IEEE 802.3x full duplex on 10BASE-T, 100BASE-TX, and 1000BASE-T ports.
 20. IEEE 802.3z 1000BASE-X specification.
 21. IPv6.
 22. Rapid Spanning Tree.
 23. Rate Limiting.
 24. RMON I and II standards.
 25. SNMPv1, SNMPv2c, and SNMPv3.
- I. Provide sufficient **10/100/1000** ports to accommodate, as a minimum, the following devices as required:
1. Access Control System.
 2. Admin PCs.
 3. Classroom PC Devices.
 4. Clock Systems.
 5. Distant Learning Systems.
 6. Instructor PCs.
 7. IP Phones, as required.
 8. IP Cameras, as required.
 9. Monitor/TVs, as required.
 10. MPEG Encoders.
 11. PABX System.
 12. Printers.
 13. Projectors.
 14. Set Top Boxes, as required.
 15. UPS Units.
 16. Wireless Access Points.

1.8 NETWORK CORE SWITCH

- A. Provide a Central Layer-3, Ethernet Routing Switch with advanced QoS and a minimum 256 Gigabit backbone capacity to service the entire building or campus.
- B. Equip the Central Layer-3 switch with a minimum of two (2) Power Supplies and two (2) Redundant Central Control/Supervisor Units.
- C. All Core switch Gigabit Port Blades must support full line speed and shall not be over-subscribed.
- D. Provide sufficient Gigabit (SX, LX and TX) Ports and 10/100/1000 Ports on the Layer-3 Core Switch, as a minimum, for the following devices:
 - 1. **10/100/1000** Network Switch Up-Links – one link per 24 **10/100/1000** ports -- typically SX or LX based on distance). Distribute pairs of uplinks across multiple blades.
 - 2. Building Automation Systems, as required (typically TX).
 - 3. CCTV DVR System (typically TX).
 - 4. File Servers (typically TX).
 - 5. Firewall, as required (typically TX).
 - 6. Media Distribution Servers & Controllers (typically TX).
 - 7. Radius Authentication Server, as required, (typically TX).
 - 8. WAN Connectivity (typically LX or CWDM).
 - 9. Wireless Controllers (typically TX).
 - 10. Wireless Phone Controller (typically TX).
 - 11. Wireless Control Console (typically TX).
- E. In addition to the above listed features and specifications for the Network Switches, the Network Core Switch shall support the following Features and Specifications:
 - 1. 10 Gbps Support capabilities.
 - 2. BGP4 and Multicast Border Gateway Protocol (MBGP).
 - 3. Full Internet Control Message Protocol (ICMP) support.
 - 4. Hot Standby Router Protocol (HSRP).
 - 5. ICMP Router Discovery Protocol.
 - 6. IGMP filtering.
 - 7. IGMP v1, v2, and v3.
 - 8. IP Multicast routing protocols.
 - 9. IP routing protocols: EIGRP, OSPF, Routing Information Protocol (RIP), and RIP2.
 - 10. Non-Blocking GBE Ports.
 - 11. NSF awareness.
 - 12. Policy-based routing (PBR).
 - 13. Virtual Router Redundancy Protocol (VRRP).
- F. Attach Data Network 10/100 or 10/100/1000 switches to the Network Core Switch with one GBE Uplink per 24 Data Network Switch Ports.

1.9 NETWORK SECURITY EQUIPMENT

- A. **RADIUS SERVER**
 - 1. If the District does not have a Central Radius Server, provide a Radius Server for Network Authentication, VLAN Assignment and Policy Assignment for IP Network Attached Devices.

COMMUNICATIONS

CHAPTER 9: SPECIFICATIONS

B. FIRE WALL

1. If the District does not have a Central Firewall and Intrusion Detection Device for connection to the Wide Area Network and Internet, provide a Firewall and Intrusion Detection Device for Protection and Security. Establish all Internet Connections via a Firewall.
2. Size the Firewall based on planned Network throughput, available WAN bandwidth and attached IP Devices.
3. Provide VPN services in the Firewall for remote access and network maintenance services.
4. Coordinate requirements with District Technology Department.

1.10 UNINTERRUPTIBLE POWER SUPPLIES (UPSs)

- A. Provide Dual Conversion UPS units for ER and TR Local area Network Electronics and File Server, providing sufficient protection from power anomalies.
- B. Provide Power strips, connected to the UPS Unit via twist-lock plugs. Locate the power strips in the equipment racks and on the equipment backboards for powering all electronics systems in the ER and TRs.
- C. Provide multiple UPS Units based on expected power load or a single large UPS Unit. Locate the multiple UPS units in the associated equipment racks or locate a larger central UPS unit in the Room.
- D. Connect the UPS Units to Building Emergency Generator when available.
- E. For buildings without a Generator, supply a two-hour (2) standby.
- A. Provide shutdown connections from the UPS to servers for graceful power down in the event of a power failure.
- G. Equip the UPS Units with a twist-Lock Power cable and SNMP Management Card.
- H. Connect the UPS SNMP Management to the Management VLAN.
- I. Coordinate UPS voltage, circuit size, and connection requirements with the Electrical Design Professional.

1.11 INSTALLATION

- A. Install File Server and setup basic user accounts and network configuration.
- B. Install Data Network Ethernet Switches and validate connectivity throughout. Establish all VLANs, QoS, IP Routing and IP Subnets.
- C. Consult with the District and consider providing the following VLANs as a minimum:
 1. Administration.
 2. HVAC.
 3. Management.
 4. Point of Sale.
 5. Student.

- 6. Video.
 - 7. Voice.
 - 8. Wireless.
- D. Coordinate network installation and integration with other systems connected to the network with District's and applicable DA-Site's technical and operational requirements.
 - E. Install and setup UPS units and establish power down procedures.
 - F. Connect System to DA-Site WAN Links and configure as per DA-Site requirements, when applicable.
 - G. Program and configure any State of Ohio Educational Network ATM switches required to access the DA-Site or the State of Ohio IVDL Network.
- 1.12 LABELING AND MARKING
- A. Provide a typed schedule of all data ports according to each related room jack designation for all TRs, and ER, in accordance with District's requirements.
- 1.13 TESTING
- A. Test the system "end-to-end" (from TR to ER, and from TR to station jack) at the direction of the Design Professional and verify, in writing, that the data network system is in proper working condition.
 - B. Verify and demonstrate proper operation of all switches, Access Points, VLANs, Routing, WAN Connectivity and possible ATM Connectivity with District and DA-Site representative, if applicable.
- 1.14 TRAINING
- A. Provide a minimum of twenty-four (24) hours of training to the District's personnel **and/or designated representative. Plan for multiple training trips to the site. Training session(s) shall cover the following topics at a minimum:**
 - 1. **System Equipment Connectivity**
 - 2. **Device Configurations**
 - 3. **Operation, maintenance, and upgrade procedures.**
 - B. **Trainer must be certified by the manufacturer.**
 - C. **Provide a copy of a sign off sheet (signed by District staff) for the completed training with the close-out documents.**
 - D. Provide two (2) video copies of the training **sessions.**

END OF SECTION

SECTION 272133

DATA COMMUNICATIONS WIRELESS ACCESS POINTS

GENERAL GUIDELINES**1.1 GENERAL**

- A. This Section defines the general design requirements for a uniform Data Communications Network Infrastructure that shall be followed for all OSFC Technology construction projects.
- B. Figure 1 describes Typical AP placement to insure proper coverage.
- C. Figure 2 describes Improper AP placement in narrow areas.
- D. Figure 3 describes Proper AP placement in narrow areas.
- E. Refer to Section 8500, Technology Systems, and Section 8600, Electrical Systems, for additional information.

1.2 SECTION INCLUDES

- A. DATA COMMUNICATIONS WIRELESS ACCESS POINTS
 - 1. Wireless Controllers and Network Tracking
 - 2. Wireless Access Points

1.3 QUALITY ASSURANCE

- A. All equipment shall be UL listed.
- B. All equipment and Installation Practices shall comply with the latest ANSI/NFPA-70 National Electric Code.
- C. All equipment Installation Practices shall comply with the Local Electric Code.
- D. All equipment shall comply with the latest ANSI-J-STD-607 Commercial Building Grounding (Earthing) and Bonding Requirements for Telecommunications Standard.
- E. All equipment and Installation Practices shall comply with the latest BICSI[®] Telecommunications Distribution Methods Manual (TDMM).
- F. All equipment shall comply with the latest ANSI TIA/EIA-568, 569, 606, 607, 862, standards.
- G. All equipment shall provide protection and containment of unwanted wireless signals and prevent student access to unwanted networks and content, in accordance with CIPA requirements.

1.4 SYSTEM WARRANTY

- A. The Wireless Network Electronics and software shall be warranted by the contractor for a period of one (1) year from date of substantial completion. Provide advanced replacement for all Network Electronics for the one (1) year-period.

1.5 WIRELESS NETWORKING**A. GENERAL**

1. Provide Centrally Powered, 802.11n Wireless Access Points and associated Wireless Network Controller(s), to support wireless Network Devices and Phones throughout the building and the associated campus.
2. Provide a Category-5e (minimum) cable drop for each AP. Terminate the AP Cable drop on a Category-5e Patch Panel at the associated Telecommunication Room (TR).
3. Connect the AP to the IP Network via an IEEE 802.3af Power Over Ethernet (POE) **1 Gbps** Switch Port or via a Mid-Span IEEE 802.3af POE Injector connected to the IP Network.
4. Coordinate 802.31x, VLAN and Security Settings/Requirements with the District.
5. Provide Wireless coverage for the entire building and associated perimeter area.
6. Provide minimum of -75 dB signal level at all locations in building for 802.11n coverage.
7. Supply sufficient Access Points to provide for expected throughput and load sharing.
8. For labs and other high-density areas, make sure that the users can “see” at least 3 Access points to provide for load sharing and balancing.
9. Perform an RF Survey to verify coverage.
10. Coordinate with local Law Enforcement and Safety Forces regarding their requirements for remote and wireless access into building Security and Energy Management Systems.
11. Law Enforcement and Safety Forces shall be responsible for providing their own remote access equipment.

B. WIRELESS CONTROLLERS AND LOCATION TRACKING

1. Equip each Building with a Wireless Controller(s). Provide Location Tracking as an option. This may be a separate appliance or software upgrade to wireless controller(s).
2. These devices shall be directly attached to the associated L-3 Network Core Switch via Gigabit interfaces as required.
3. These devices shall provide shall provide dynamic channel assignment, interference detection and avoidance, load balancing across multiple access points, guest networking, Voice over WLAN (VoWLAN) Support, layer-2 and layer-3 roaming support, coverage hole detection and avoidance, dynamic power control, user location and tracking services, and real-time rogue access point detection and containment.
4. The Wireless Network Controllers and Associated Location Tracking devices shall be controlled via a centrally located Wireless Control System Console. Typically, only one Wireless Control Console is required per District.

COMMUNICATIONS

CHAPTER 9: SPECIFICATIONS

- C. WIRELESS ACCESS POINTS
1. Provide centrally powered IEEE 802.11n Wireless Access Points (APs) for each new and remodeled building.
 2. The APs shall provide for rapid traffic forwarding capabilities that will enable the Access Points to support real-time voice, video and data services.
 3. Each AP shall be aware of neighboring access points, enabling effective real-time, and air traffic-management through load balancing.
 4. This feature shall be used to ensure maximum network uptime – clients shall be routed around a failed access point to the closest available alternative on a real-time basis without manual intervention.
 5. Each Access Point shall support a minimum of 14 VoWLAN Phones and dynamically throttle back non-VoIP traffic.
 6. Place and dimension the number of Access Points based on required throughput, load balancing and location tracking.
 7. ***The specifications for the AP's shall conform to the IEEE 802.11n standard.***
- 1.6 INSTALLATION
- A. Contractor shall provide and install Wireless System and associated cabling, POE devices, Central Controllers and Console.
 - B. The Building Floor Plans and Site Plans shall be entered into the Central Wireless Control Console.
 - C. The Central Wireless Control Console floor and site plans shall be calibrated after the installation has been performed.
 - D. Access Point cables and associated connectors shall be terminated in accordance with industry standards.
 - E. Balance Wireless Access Points to insure complete coverage with minimal service degradation.
 - F. Setup Wireless Access Security and provide for CIPA Compliance.
 - G. Determine the optimum location of all devices in the wireless LAN coverage areas and consider the access point density and location.
 - H. Locate all internal Access Points above the ceiling tile grid wherever possible.
 - I. Ensure that no fewer than 3 access points, and preferably 4 or 5, provide coverage to every area where device location is required. The more access points that detect a device, the better. This high level guideline translates into the following best practices, ordered by priority:
 1. Most importantly, access points should surround the desired location.
 2. Roughly, one access point should be placed every 43-53 linear feet (~13-16 meters). This translates into one access point every 1,800 to 2,800 square feet (~170-260 square meters).

3. Place access points along the periphery of coverage areas to help locate devices close to the exterior of rooms and buildings and to provide the best possible coverage (see figure 1)

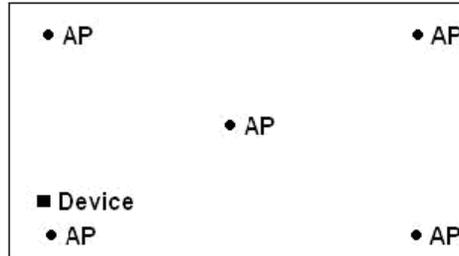


Figure 1 – Typical AP placement to insure proper coverage

4. In long and narrow coverage areas, refrain from placing access points in a straight line. Instead, attempt to stagger them (see figures 2 and 3).

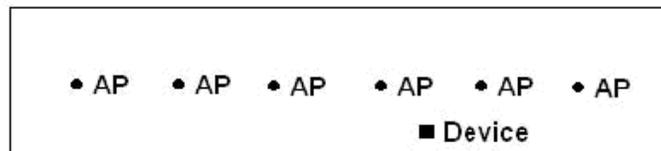


Figure 2 – Improper AP placement in narrow areas

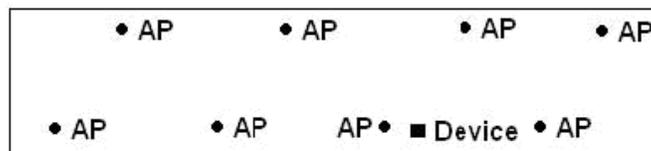


Figure 3 – Proper AP placement in narrow areas

5. Provide Antennas mounted external to the building for coverage of areas surrounding the building such as: playgrounds, parking lots, athletic fields, etc.
6. Connect the external antennas to APs mounted inside of the building.

1.7 LABELING

- A. Cables, jacks, system components, etc. shall be labeled according to ANSI/EIA/TIA-606 specifications and in coordination with the District/architect.
- B. All AP Cables shall be equipped with a self-laminating, wrap-around, machine printed label at both ends of the cable.

1.8 TESTING

- A. Perform complete site survey after system placement and verify coverage and throughput.

1.9 TRAINING

- A.** *Provide a minimum of eight (8) hours of training to the District's personnel and/or designated representative. Plan for multiple training trips to the site. Training session(s) shall cover the following topics at a minimum:*
- 1.** *System Equipment Connectivity*
 - 2.** *Device Configurations*
 - 3.** *Operation, maintenance, and upgrade procedures.*
- B.** *Trainer must be certified by the manufacturer.*
- C.** *Provide a copy of a sign off sheet (signed by District staff) for the completed training with the close-out documents.*
- D.** *Provide two (2) video copies of the training sessions.*

END OF SECTION

SECTION 273113

IP-ENABLED PABX SYSTEM

GENERAL GUIDELINES

1.1 GENERAL

- A. This Section defines the general design requirements for a uniform IP-Enabled PABX System that shall be followed for all OSFC Technology construction projects.
- B. Refer to Section 8500, Technology Systems for additional information.

1.2 SECTION INCLUDES

- A. Central IP-Enabled PABX.
- B. Attendant Console Terminal.
- C. Executive Display Digital Voice Terminal.
- D. Standard Display Digital Voice Terminal.
- E. Single Line Voice Terminal.
- F. Voice Mail with Automated Attendant.
- G. E-911 Console.
- H. Uninterruptible Power Supply (UPS)

1.3 QUALITY ASSURANCE

- C. All equipment shall be UL listed.
- D. Compliance with the National Electric Code.
- E. Compliance with FCC rules.
- F. Comply with latest NENA E-911 requirements.

1.4 SYSTEM WARRANTY

- A. The telephone components, software, parts etc. shall carry a ONE (1) year full warranty, including labor and material.

1.5 **GENERAL REQUIREMENTS**

- A. Each Building's telephone system **must provide the following minimum requirements:**
 - 1) **Support for E-911.**
 - 2) **Support for the following carrier and Inter-switch interfaces:**
 - a) **Digital (T-1, PRI).**

COMMUNICATIONS

CHAPTER 9: SPECIFICATIONS

- b) **Session Initiation Protocol (SIP).**
 - c) **Analog (POTS) lines.**
 - d) **Provide carrier circuit interfaces adequate to handle ALL incoming and outgoing calls.**
 - 3) **Support for Direct inward Dialing (DID).**
 - 4) **Support for the following endpoints (phones/devices):**
 - a) **Digital (TDM)**
 - b) **IP (must support non proprietary H.323 and SIP compliant devices).**
 - c) **Analog (phones/faxes etc.)**
 - d) **Endpoints that provide "full duplex speakerphone" capability must be provided in specific rooms.**
 - e) **Provide system with capacity for all endpoints required plus 10% spare.**
 - 5) **Provide support for a minimum of two (2) fax stations per building.**
 - 6) **Provide UPS.**
- B.** System to have maintenance and administration terminal and remote access capabilities.
- C.** A common Telephone Switching Platform shall be used across the District to insure inter-operability. In the event that the District already has an established Telephone System that meets OSFC requirements, additional buildings may be added to the District, specifying existing Vendor's system.
- D.** In the event that no standard system exists for the District, then the OSFC PA shall decide if the first systems bid establish a critical mass and if the multiple vendor requirement can be waived.

1.6 WORK BY LOCAL UTILITIES

- A. Coordinate all work with the local and long-distance Service Providers (SPs).

1.7 IP-ENABLED PABX

- A. The Central Switching Exchange shall be a fully-digital, IP-Enabled (minimum) PBX Telephone Switch. **Key Systems and** hybrid intercom/telephone systems will NOT be acceptable.
- B. The IP-ENABLED PABX shall be Digital Signal Processing based to provide the flexibility to adapt to the changes in communications.
- C. The IP-ENABLED PABX must be modular in design.
- D. The IP-ENABLED PABX shall be sized according to student population and traffic requirements and shall be equipped with **carrier circuit interfaces** for incoming/outgoing call lines. The minimum circuits shall be as follows:
 - 1) One PRI **or equivalent SIP trunk** for up to 100 stations.
 - 2) Two PRIs **or equivalent SIP trunks** for greater than 100 stations.
 - 3) **Additional PRIs or equivalent SIP trunks** based on traffic requirements.

-
- 4)** *The use of analog central office (CO) line interface is acceptable if system is supporting existing analog phone service and as long as adequate line capacity is provided to support call traffic. System must still include digital carrier interface for future growth.*
- E.** The IP-ENABLED PABX shall be equipped with full Name and Number Caller ID functions for incoming and outgoing calls.
- F.** The IP-ENABLED PABX must be equipped with a minimum of three (3) analog lines to the local Service Provider for E-911 services and PRI backup.
- G.** Connect the Analog Lines to a Power Failure Transfer (PFT) Unit and supply a minimum of three (3) analog phones, located in the Central Office Area for emergency operation.
- H.** The telephone system must have the following minimum features:
- 1) Access Codes.
 - 2) Attendant's Console.
 - 3) Automatic Location Identifier (ALI).
 - 4) Automatic Number Identification Support (ANI).
 - 5) Call Accounting Software and Hardware.
 - 6) Call Conferencing.
 - 7) Call Forwarding on Busy.
 - 8) Call Forwarding External Calls
 - 9) Call Forwarding Internal Calls.
 - 10) Call Hold.
 - 11) Call Pickup.
 - 12) Call Screening.
 - 13) Dialed Number Identification Service (DNIS).
 - 14) Direct Inward Dialing (DID).
 - 15) Distinctive ring tones.
 - 16) Do Not Disturb
 - 17) E-911 and latest NENA support.
 - 18) E-911 Call Recording and Bridging to E-911 Central Console.
 - 19) FCC Registration.
 - 20) Full Caller ID – Incoming/Outgoing.
 - 21) Full duplex, Digital Display, Speaker Phones.
 - 22) Hands Free Intercom – Phone-to-Phone.
 - 23) IEEE 802.3af compliant VoIP Power
 - 24) Least Cost Routing.
 - 25) Maintenance and Administration Terminal.
 - 26) Malicious Call Trace/Hold.
 - 27) Message Waiting Lamp.
 - 28) Paging Interface (minimum 6 zones).
 - 29) Minimum of eight (8) Pre-program buttons.
 - 30) PRI/T-1 Trunking.
 - 31) Remote diagnostics.
 - 32) SIP Signaling Protocol
 - 33) Standards Based, VoIP Phone Support.
 - 34) Support wireless 802.11 VoWLAN phones
 - 35) System Speed Dial.
 - 36) Unified Messaging.
 - 37) VoIP Trunking – H.323 and SIP.
-

COMMUNICATIONS

CHAPTER 9: SPECIFICATIONS

- I.** Inter-Building Trunks (Links) between Systems shall be designed using T-1 Lines, PRI Lines or VoIP Trunking. A minimum capacity of 23 inter-building links shall be provided. Dimension all Trunks based on a minimum of P=0.01 Grade of Service.
- J.** When a high-speed WAN connection exists, use a VoIP connection between buildings.
- K.** Design the District-Wide system to provide for Least-Cost Routing and Toll-Bypass when applicable. Supply additional PRI circuits as required.
- L.** Provide IEEE 802.3af compliant Power Injectors/switches for all VoIP Phone instruments.
- M.** Each District Building's IP-ENABLED PABX shall be capable of complete stand-alone operation (with the exception of centralized voicemail) in the event that the Inter-Building Trunks (Links) are not operational.
- N.** District-Wide Systems shall function as a single system with Common Features, Centralized Voice Mail, and Centralized Call Detail Recording with a single record per call and the ability for Centralized Attendant Service for the entire District.
- O.** When more than one building per District is involved, all incoming and outgoing calls **may** be routed over **carrier circuits** connected to a Central IP-Enabled PABX. The Central IP-ENABLED PABX capacity shall be dimensioned to handle all current and planned District buildings.
- P.** IP-ENABLED PABX units shall employ a hardened Operating System that is not susceptible to Internet Computer Viruses.
- Q.** IP-ENABLED PABX units shall be provided with a minimum of 10% spare line/station capacity at initial installation.
- R.** The PABX shall be an IP-Enabled PABX or an IP Based PABX. The all IP Based system shall maintain the same high level of functionality, redundancy and programmable features as originally specified. Any all-IP system shall employ standards based signaling, instrument powering and redundant call servers in each District Building served by the system. See Section 273123 for additional details.
- S.** Provide centralized PABX and phone instrument power with a minimum of two (2) Busy-Hour standby capabilities for all PABX equipment. IP Based systems shall also be provided with two (2) Busy-Hour standby capabilities for all powered Switches or Patch Panels located in each Telecommunications Room (TR). Connect the Central Power Supplies to Building Emergency Power when available.
- T.** All IP Instruments and power sources shall be IEEE 802.3af compliant.
- U.** All PABX systems shall support IP Inter-building trunking (H.323 or SIP) and the attachment of IP Instruments such as IP Phones, PDAs, Soft Phones and 802.11 Phones.
- V.** As a minimum, the Call Accounting shall include date, time, duration of call, extension number, account code (if applicable) and number dialed along with software export features to standard spread sheets.

1.8 ATTENDANT CONSOLE TERMINAL

- A. Minimum of 32 Character LCD Display.
- B. Display day, date and time.
- C. Display call durations.
- D. Display caller name and extension/telephone number and incoming caller-ID information.
- E. Hands free, Full-Duplex, Speakerphone.
- F. Shall have a system display panel capable of showing all system extension numbers and their status and capable of extending calls via single touch operation.
- G. Provide a minimum of two (2) consoles per building for load sharing and redundancy.

1.9 ADMINISTRATIVE DISPLAY DIGITAL VOICE TERMINAL

- A. Provide one administrative phone for all administrative areas, conference rooms, small group rooms, **nurse/health office, and special needs rooms.**
- B. At least sixteen characters display window.
- C. At least sixteen programmable keys.
- D. Hands free, **Full-Duplex** Speakerphone.
- E. Display caller name and extension/telephone number.
- F. Message Waiting Lamp.
- G. Pre-programmed E-911 button that automatically puts the phone into a hands-free mode, and initiates a 3-way conference call with the central console, as well as the local 911 center.

1.10 **STANDARD DISPLAY** DIGITAL VOICE TERMINAL

- A. Provide one standard 8 button phone for all classrooms, labs, **general offices**, and other areas not covered above in section **1.9**.
- B. At least sixteen characters display window.
- C. At least eight (8) programmable keys.
- D. Hands free, Speakerphone. **Full Duplex required if One Way Paging Variance is utilized.**

COMMUNICATIONS

CHAPTER 9: SPECIFICATIONS

- E. Display caller name and extension/telephone number.
- F. Message Waiting Lamp.
- G. Pre-programmed E-911 button that automatically puts the phone into a hands-free mode, and initiates a 3-way conference call with the central console, as well as the local 911 center.

1.11 CONFERENCE PHONE

- A. *As a minimum, provide Multi-User, Full-Duplex conference Speakerphone for Conference Rooms and/or Principal's Office.***

1.12 VoWLAN PHONES

- A. Provide a minimum of **two** Wireless VoIP (VoWLAN) Phone instruments, with carrying case and charger units.
- B. Provide integral VoWLAN 802.11e QoS capability or SVP server for VoWLAN QoS.

1.13 VOICE MAIL SYSTEM

- A. System shall have the following number of voice ports:
 - 1)** Minimum of 4 ports (450 students).
 - 2)** Minimum of 8 ports (650 students).
 - 3)** Minimum of 12 ports (850 students).
- B. System shall have the following capacity:
 - 1)** One voice mail box per station plus 20% minimum spares.
- C. System shall have an automated attendant.
- D. System shall be fully integrated with IP-Enabled PABX.
- E. System shall activate telephone station "message waiting" light.
- F. System shall have Integrated Messaging capability. Supply based on District's requirements. Verify E-Mail Server compatibility (Exchange, Notes, Groupwise, etc.)

1.14 E-911 CONSOLE

- A. System shall support Call Bridging at Console for all E-911 calls.
- B. System shall provide Call Recording for E-911 Calls.
- C. System shall support full NENA Compliant ANI and ALI data transmission from local Data Base to PSAP.

1.15 UNINTERRUPTIBLE POWER SUPPLIES (UPS)

- A. Provide Dual Conversion UPS units for Main Telephone Switch, providing sufficient protection from power anomalies for two (2) busy hours.
- B. Provide multiple UPS Units based on expected power load or a single large UPS Unit. Locate the multiple UPS units in the associated equipment racks or locate a larger central UPS unit in the Room.

- C. Connect the UPS Units to Building Emergency Generator.
- D. For buildings without a Generator, supply a four-hour (4) standby.
- E. Provide shutdown connections from the UPS for graceful power down in the event of a power failure.
- F. Equip the UPS Units with a twist-Lock Power cable and SNMP Management Card.
- G. Connect the UPS SNMP Management to the Management VLAN.
- H. Coordinate UPS voltage, circuit size, and connection requirements with the Electrical Design Professional.

1.16 INSTALLATION

- A. Coordinate complete system installation, and Technology Head End Integration with District and other Technology Trades.
- B. Coordinate installation and interconnect with local and long-distance Service Provider (SP). Contractor shall be responsible for all final cross connects and system Data Base loading and verification.
- C. Contractor shall connect to, and interface with the in-house paging system and provide paging from any telephone handset.
- D. Connect system to IP Data Network and program required VLANs and 803.11e support.
- E. Interconnect with existing systems via VoIP trunking.
- F. Integrate system with District's Numbering Plan.

1.17 SYSTEM PROGRAMMING

- A. Contractor shall provide the District/architect with a complete set of forms for the entire system and extension features for final programming.
- B. Final programming of the system shall be co-developed between the District/architect and the contractor and must be approved prior to being implemented for system start-up.
- C. Contractor shall supply the "latest" software updates as part of the system configuration or two (2) years after system acceptance.

1.18 TRAINING

- A. Contractor shall provide a minimum of four (4) 2-hour, user system training classes, sixteen hours (16) of attendant Console Training and forty hours (40) of system programming and administration training to the District. Training shall be provided to all staff and shall be scheduled in advance with the District.
 - 1) Contractor shall provide two (2) video copies of all training.

END OF SECTION

SECTION 273123

IP ONLY PABX SYSTEM

GENERAL GUIDELINES

1.1 GENERAL

- A. This Section defines the general design requirements for a uniform IP ONLY PABX System that shall be followed for all OSFC Technology construction projects.
- B. Refer to Section 8500, Technology Systems, 27 13 13, Copper Back Bone Systems and 27 31 13, IP-Enabled PABX System for additional information.

1.2 SECTION INCLUDES

- A. Central IP PABX.
- B. Attendant Console Terminal.
- C. Executive Display Voice Terminal.
- D. Standard Display Voice Terminal.
- E. Single Line Voice Terminal.
- F. Voice Mail with Automated Attendant.
- G. E-911 Console.
- H. Uninterruptible Power Supply (UPSs).

1.3 QUALITY ASSURANCE

- A. All equipment shall be UL listed.
- B. Compliance with the National Electric Code.
- C. Compliance with FCC rules.
- D. Comply with latest NENA E-911 requirements.

1.4 SYSTEM WARRANTY

- A. The telephone components, software, parts etc. shall carry a ONE (1) year full warranty, including labor, software and material.

1.5 **GENERAL REQUIREMENTS**

- A. ***Each Building's telephone system must provide the following minimum requirements:***
 - 1) ***Support for E-911.***

- 2) **Support for the following carrier and Inter-switch interfaces:**
 - a) **Digital (T-1, PRI)**
 - b) **Session Initiation Protocol (SIP)**
 - c) **Analog (POTS) lines**
 - d) **Provide carrier circuit interfaces adequate to handle ALL incoming and outgoing calls.**
 - 3) **Support for Direct Inward Dialing (DID).**
 - 4) **Support for the following endpoints (phones/devices):**
 - a) **Digital (TDM)**
 - b) **IP (must support non-proprietary H.323 and SIP-compliant devices)**
 - c) **Analog (phones/faxes etc.)**
 - d) **Endpoints that provide "full duplex speakerphone" capability must be provided in specific rooms.**
 - e) **Provide system with capacity for all endpoints required plus 10% spare.**
 - 5) **Provide support for a minimum of two (2) fax stations per building.**
 - 6) **Provide UPS.**
- B. System to have maintenance and administration terminal and remote access capabilities.
- C. A common Telephone Switching Platform shall be used across the District to insure inter-operability. In the event that the District already has an established Telephone System that meets OSFC requirements, additional buildings may be added to the District, specifying existing Vendor's system.
- D. In the event that no standard system exists for the District, then the OSFC PA shall decide if the first systems bid establish a critical mass and if the multiple vendor requirement can be waived.

1.6 WORK BY LOCAL UTILITIES

- A. Coordinate all work with the local and long-distance Service Providers (SPs).

1.7 IP PABX

- A. The Central Switching Exchange shall be a fully-digital, IP Based PBX Telephone Switch.
- B. The IP PABX must be modular in design.
- C. The IP PABX shall be sized according to student population and traffic requirements and shall be equipped with **carrier circuit interfaces** for incoming/outgoing call lines. The minimum circuits shall be as follows:
 - 1) One PRI **or equivalent SIP trunk** for up to 100 stations.
 - 2) Two PRIs **or equivalent SIP trunks** for greater than 100 stations.
 - 3) Additional PRIs **or equivalent SIP trunks** based on traffic requirements.
 - 4) **The use of an analog central office (CO) line interface is acceptable if system is supporting existing analog phone service and as long as adequate line capacity is provided to support call traffic. System must still include digital carrier interface for future growth.**

COMMUNICATIONS

CHAPTER 9: SPECIFICATIONS

- D.** The IP PABX shall be equipped with full Name and Number Caller ID functions for incoming and outgoing calls.
- E.** With few exceptions, the IP Only PABX system shall provide the same basic features and functionality as an IP-Enabled PABX.
- F.** The IP PABX must be equipped with a minimum of three (3) analog lines to the local Service Provider for E-911 services and PRI backup.
- G.** Connect the Analog Lines to a Power Failure Transfer (PFT) Unit and supply a minimum of three (3) analog phones, located in the Central Office Area for emergency operation.
- H.** The common control units for the IP PABX shall be fully duplicated.
- I.** The media gateways and other ancillary devices shall be distributed across a minimum of at least two (2) units for redundancy. For example, analog interfaces, PRI interfaces, etc. shall be duplicated.
- J.** For single building configurations, the duplicate Common Control Units, media gateways and other common devices shall all be located in the Main Equipment Room.
- K.** For multiple building configurations, consideration shall be given to distributing the common control units and media gateways between two buildings.
- L.** When an IP PABX system is deployed across the District, all **carrier circuits** and Voice mail and other common Services shall be centralized – a minimum of two central locations is required.
- M.** Design the District-Wide system to provide for Least-Cost Routing and Toll-Bypass when applicable. Supply additional PRI circuits as required.
- N.** All buildings shall be equipped with a survivable remote unit that shall continue to provide basic call processing for users via the back-up analog lines. Voice mail will not be required during a WAN Link cut between a remote building and a Core Building.
- O.** When the Wide Area Network permits, remote buildings shall be configured in such a fashions as to “dual-home” on the two, distributed Central Processing units.
- P.** With few exceptions, all IP station devices shall be served by a dedicated Work Area Cable and Voice traffic shall be segregated from standard data traffic by providing dedicated 802.3af Power Over Ethernet (POE) Switches for the Voice Network.
- Q.** The POE switches shall follow the same design rules as the Data Network Switches, namely, one (1) dedicated GBE link to the Data Network Layer-3 Core switch per 24 10/100 ports.
- R.** The designer shall adjust the quantity of L-3 Core switch ports and associated fiber and UPS units to accommodate the additional POE switches.

- S.** All IP Phone instruments shall be 802.3af powered from POE Ethernet switches.
- T.** Due to the advanced features available on some IP Phones, consideration shall be given to locating selected IP instruments on desktops rather than wall mounting the units.
- U.** Consideration shall be given to supplying additional call processing software to enable user desk-top PCs to interoperate with the IP PABX advanced SIP based presence features (audio and video conferencing, integrated messaging, etc.).
- V.** Connections between the Data Network and the voice network shall be made via a vendor supplied firewall device.
- W.** As a minimum, the Call Accounting shall include date, time, duration of call, extension number, account code (if applicable) and number dialed along with software export features to standard spread sheets.
- X.** The IP PABX telephone system must have the following minimum features:
- 1) Access Codes.
 - 2) Attendant's Console.
 - 3) Automatic Location Identifier (ALI).
 - 4) Automatic Number Identification Support (ANI).
 - 5) Call Accounting Software and Hardware.
 - 6) Call Conferencing.
 - 7) Call Forwarding on Busy.
 - 8) Call Forwarding External Calls
 - 9) Call Forwarding Internal Calls.
 - 10) Call Hold.
 - 11) Call Pickup.
 - 12) Call Screening.
 - 13) Dialed Number Identification Service (DNIS).
 - 14) Direct Inward Dialing (DID).
 - 15) Distinctive ring tones.
 - 16) Do Not Disturb
 - 17) E-911 and latest NENA support.
 - 18) E-911 Call Recording and Bridging to E-911 Central Console.
 - 19) FCC Registration.
 - 20) Full Caller ID – Incoming/Outgoing.
 - 21) Full duplex, Digital Display, Speaker Phones.
 - 22) Hands Free Intercom – Phone-to-Phone.
 - 23) IEEE 802.3af compliant VoIP Power
 - 24) Least Cost Routing.
 - 25) Maintenance and Administration Terminal.
 - 26) Malicious Call Trace/Hold.
 - 27) Message Waiting Lamp.
 - 28) Paging Interface (minimum 6 zones).
 - 29) Minimum of eight (8) Pre-program buttons.
 - 30) PRI/T-1 Trunking.
 - 31) Remote diagnostics.
 - 32) SIP Signaling Protocol
 - 33) Standards Based, VoIP Phone Support.
 - 34) Support wireless 802.11 VoWLAN phones

COMMUNICATIONS

CHAPTER 9: SPECIFICATIONS

- 35)** System Speed Dial.
- 36)** Unified Messaging.
- 37)** VoIP Trunking – H.323 and SIP.
- Y.** The IP PABX shall be dimensioned to support a minimum ABH traffic capacity of 7.0 ccs per line.
- Z.** Inter-Building Trunks (Links) between Systems shall be designed using T-1 Lines, PRI Lines or VoIP Trunking. A minimum capacity of 23 inter-building links shall be provided. Dimension all Trunks based on a minimum of P=0.01 Grade of Service.
- AA.** When a high-speed WAN connection exists, use a VoIP connection between buildings.
- BB.** Provide IEEE 802.3af compliant Power Injectors/switches for all VoIP Phone instruments.
- CC.** Each District Building's IP PABX shall be capable of complete stand-alone operation (with the exception of centralized voicemail) in the event that the Inter-Building Trunks (Links) are not operational. Calling operation shall be limited only by the external links (trunks) available,
- DD.** District-Wide Systems shall function as a single system with Common Features, Centralized Voice Mail, and Centralized Call Detail Recording with a single record per call and the ability for Centralized Attendant Service for the entire District.
- EE.** When more than one building per District is involved, all incoming and outgoing calls shall be routed over PRI Line(s) connected to a Central IP-Enabled PABX. The Central IP-ENABLED PABX capacity shall be dimensioned to handle all current and planned District buildings.
- FF.** IP PABX units shall employ a hardened Operating System that is not susceptible to Internet Computer Viruses.
- GG.** IP PABX units shall be provided with a minimum of 10% spare line/station capacity at initial installation.
- HH.** The all IP Based system shall maintain the same high level of functionality, redundancy and programmable features as originally specified. Any all-IP system shall employ standards based signaling, instrument powering and redundant call servers in each District Building served by the system.
- II.** Provide centralized PABX and phone instrument power with a minimum of two (2) Busy-Hour standby capabilities for all PABX equipment. IP Based systems shall also be provided with two (2) Busy-Hour standby capabilities for all powered Switches or Patch Panels located in each Telecommunications Room (TR). Connect the Central Power Supplies to Building Emergency Power when available.
- JJ.** All IP Instruments and power sources shall be IEEE 802.3af compliant.
- KK.** All PABX systems shall support IP Inter-building trunking (H.323 or SIP) and the attachment of IP Instruments such as IP Phones, PDAs, Soft Phones and 802.11 Phones.

1.8 ATTENDANT CONSOLE TERMINAL

- A. Minimum of 32 Character LCD Display.
- B. Display day, date and time.
- C. Display call durations.
- D. Display caller name and extension/telephone number and incoming caller-ID information
- E. Hands free, Full-Duplex, Speakerphone.
- F. Shall have a system display panel capable of showing all system extension numbers and their status and capable of extending calls via single touch operation.
- G. Provide a minimum of two (2) consoles per building for load sharing and redundancy.
- H. Optional soft consoles should be considered by the designer for the attendant.

1.9 ADMINISTRATIVE DISPLAY IP VOICE TERMINAL

- A. Provide one administrative phone for all administrative areas, conference rooms, small group rooms, **nurse/health office, and special needs rooms.**
- B. At least sixteen characters display window.
- C. At least sixteen programmable keys.
- D. Hands free, **Full-Duplex** Speakerphone.
- E. Display caller name and extension/telephone number.
- F. Message Waiting Lamp.
- G. Pre-programmed E-911 button that automatically puts the phone into a hands-free mode, and initiates a 3-way conference call with the central console, as well as the local 911 center.
- H. IEEE 802.3af powered.

1.10 STANDARD DISPLAY DIGITAL VOICE TERMINAL

- A. Provide one standard 8-button phone for all classrooms, labs, **general offices**, and other areas not covered in section **1.9** above.
- B. At least sixteen characters display window.
- C. At least eight (8) programmable keys.
- D. Hands free, Speakerphone. **Full Duplex required if One Way Paging Variance is utilized.**

COMMUNICATIONS

CHAPTER 9: SPECIFICATIONS

- E. Display caller name and extension/telephone number.
- F. Message Waiting Lamp.
- G. Pre-programmed E-911 button that automatically puts the phone into a hands-free mode, and initiates a 3-way conference call with the central console, as well as the local 911 center.
- H. IEEE 802.3af powered.

1.11 CONFERENCE PHONE

- A. ***At a minimum, provide Multi-User, Full-Duplex conference Speakerphone for Conference Rooms and/or Principal's Office.***

1.12 VoWLAN PHONES

- A. Provide a minimum of **two** Wireless VoIP (VoWLAN) Phone instruments, with carrying case and charger units.
- B. Provide integral VoWLAN 802.11e QoS capability or SVP server for VoWLAN QoS.

1.13 VOICE MAIL SYSTEM

- A. System shall have the following number of voice ports:
 - 1) Minimum of 4 ports (450 students).
 - 2) Minimum of 8 ports (650 students).
 - 3) Minimum of 12 ports (850 students).
- B. System shall have the following capacity:
 - 1) One voice mailbox per station plus 20% minimum spares.
- C. System shall have an automated attendant.
- D. System shall be fully integrated with the IP PABX.
- E. System shall activate telephone station "message waiting" light.
- F. System shall have Integrated Messaging capability. Supply based on District's requirements. Verify E-Mail Server compatibility (Exchange, Notes, Groupwise, etc.)

1.14 E-911 CONSOLE

- A. System shall support Call Bridging at Console for all E-911 calls.
- B. System shall provide Call Recording for E-911 Calls
- C. System shall support full NENA Compliant ANI and ALI data transmission from local Data Base to PSAP.

1.15 UNINTERRUPTIBLE POWER SUPPLIES (UPS)

- A. Provide Dual Conversion UPS units for call processing equipment, providing sufficient protection from power anomalies for two (2) busy hours.
- B. Provide multiple UPS Units based on expected power load or a single large UPS Unit. Locate the multiple UPS units in the associated equipment racks or locate a larger central UPS unit in the Room.

- C. Connect the UPS Units to Building Emergency Generator when available.
- D. For buildings without a Generator, supply a four-hour (4) standby.
- E. Provide shutdown connections from the UPS for graceful power down in the event of a power failure.
- F. Equip the UPS Units with a twist-Lock Power cable and SNMP Management Card.
- G. Connect the UPS SNMP Management to the Management VLAN.
- H. Coordinate UPS voltage, circuit size, and connection requirements with the Electrical Design Professional.

1.16 INSTALLATION

- A. Coordinate complete system installation, and Technology Headend Integration with District and other Technology Trades.
- B. Coordinate installation and interconnect with local and long-distance Service Provider (SP). Contractor shall be responsible for all final cross connects and system Data Base loading and verification.
- C. Contractor shall connect to, and interface with the in-house paging system and provide paging from any telephone handset.
- D. Connect system to IP Data Network and program required VLANs, Firewall and 803.11e support.
- E. Interconnect with existing systems via VoIP trunking.
- F. Integrate system with District's Numbering Plan.

1.17 SYSTEM PROGRAMMING

- A. Contractor shall provide the District/architect with a complete set of forms for the entire system and extension features for final programming.
- B. Final programming of the system shall be co-developed between the District/architect and the contractor and must be approved prior to being implemented for system start-up.
- C. Contractor shall supply the "latest" software updates as part of the system configuration for two (2) years after system acceptance.

1.18 TRAINING

- A. Contractor shall provide a minimum of four (4) 2-hour, user system training classes, sixteen hours (16) of attendant Console Training and forty hours (40) of system programming and administration training to the District. Training shall be provided to all staff and shall be scheduled in advance with the District.
 - 1) Contractor shall provide two (2) video copies of all training.

END OF SECTION

SECTION 274117

BROADBAND VIDEO RF DISTRIBUTION SYSTEM

GENERAL GUIDELINES**1.1 GENERAL**

- A. This Section defines the general design requirements for a uniform Coaxial Broadband RF Distribution System that shall be followed for all OSFC Technology construction projects.
 - 1. Figure 1 describes a Typical Coaxial Communications Cabling System – ER Serves all Locations.
 - 2. Figure 2 describes a Typical Coaxial Communications Cabling System – Multiple TRs.
 - 3. Refer to Section 8500, Technology Systems, and Section 8600, Electrical Systems, for additional information.

1.2 SECTION INCLUDES

- A. BROADBAND VIDEO RF DISTRIBUTION SYSTEM
 - 1. RF Head End.

1.3 QUALITY ASSURANCE

- A. All equipment shall be UL listed.
- B. All equipment and Installation Practices shall comply with the latest ANSI/NFPA-70 National Electric Code.
- C. All equipment Installation Practices shall comply with the Local Electric Code.
- D. All equipment shall comply with the latest ANSI-J-STD-607 Commercial Building Grounding (Earthing) and Bonding Requirements for Telecommunications Standard.
- E. All equipment and Installation Practices shall comply with the latest BICSI[®] Telecommunications Distribution Methods Manual (TDMM).
- F. All equipment shall comply with the latest ANSI TIA/EIA-568, 569, 606, 607, 862, standards.
- G. As a minimum, all equipment shall meet Category 5e transmission performance standards.

1.4 SYSTEM WARRANTY

- A. System shall carry an industry standard, performance based warranty, by the manufacturer and contractor, for a period of at least 20 years on the coax cabling; including patch panels, patch cables, terminations and labor. The remaining portions of the system shall be warranted for a period of one (1) year from date of substantial completion.

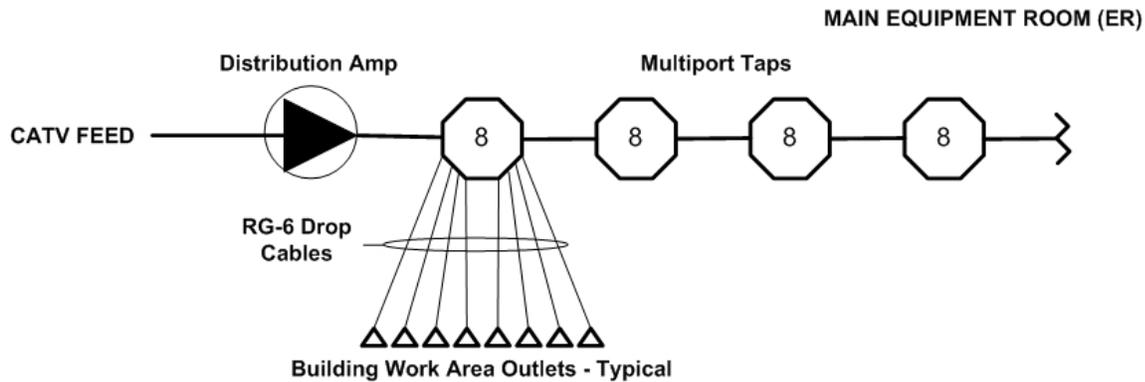


Figure 2 - Typical Coaxial Communications Cabling System – ER serves all Locations

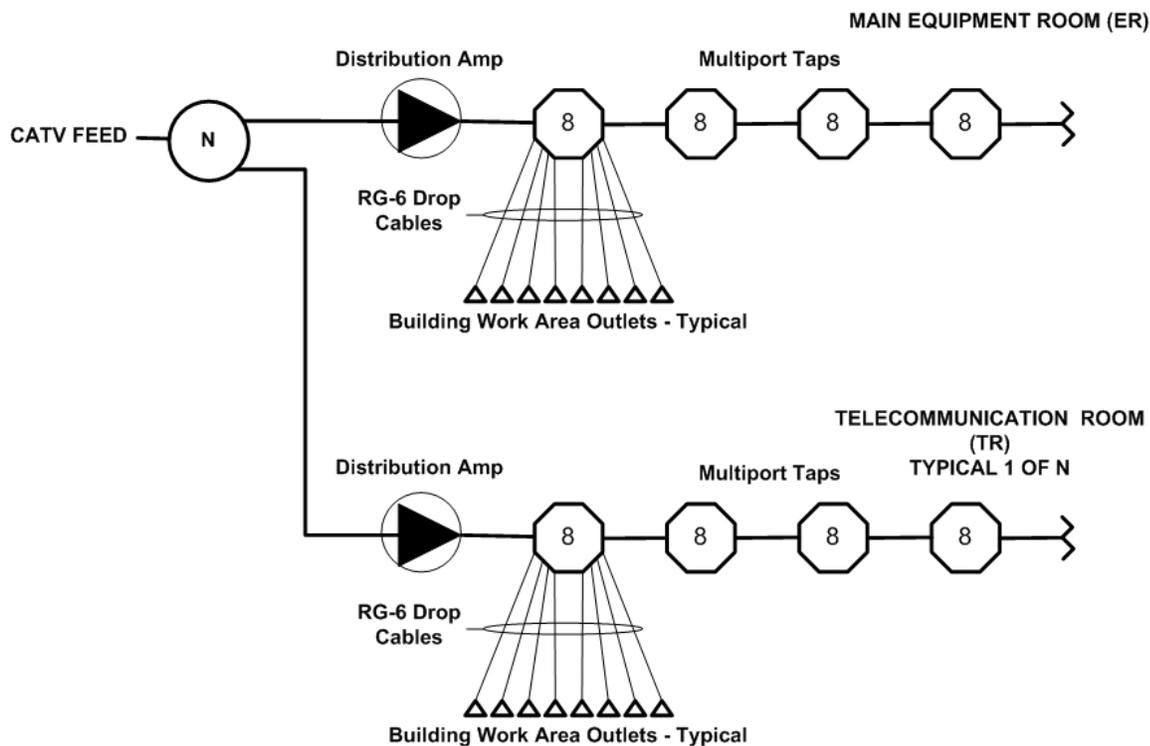


Figure 2 - Typical Coaxial Communications Cabling System – Multiple TRs

1.5 RF HEAD END

A. GENERAL

1. When a building is not supplied with an MPEG, CATV, Head-End System, a Coaxial Cable based CATV RF Broadband System is required.
2. Provide a Horizontal Coaxial Cable RF Broadband System for all new and renovated Buildings.
3. Buildings served with a MPEG CATV Head end do not require a Horizontal Coaxial Cable System.

COMMUNICATIONS

CHAPTER 9: SPECIFICATIONS

4. For most buildings, a star-wired, Coaxial Cable, CATV System can be served from one closet (the Main Equipment Room – ER) – drops up to 450 feet.
 5. For large buildings that cannot be served only from the Main Equipment Room (ER), the horizontal coaxial cables connect to the associated TRs.
 6. The CATV Horizontal Coaxial Cable RF Broadband System shall have a minimum frequency bandwidth between 5MHz and 1000MHz and full support for HDTV.
 7. All RF devices shall be two-way for return video capability.
 8. Provide all combining and splitting devices, as required.
 9. Provide terminating devices and directional couplers, as required.
 10. Provide all video distribution amps, as required.
 11. Provide channel elimination filters, as required.
 12. Provide Agile Channel Modulators, as required.
 13. Provide Cable Equalizers, as required.
- B. HORIZONTAL COAX CABLE
1. The RF Broadband Wiring System shall be a bi-directional, star-wired, home-run, coaxial distribution system using Quad Shielded RG-6 Coax Cable.
 2. The RG-6 coaxial cables shall be CATVP rated.
 3. The coaxial cables shall be sweep tested to 1000 MHz and shall meet the following minimum performance values listed in dB/100 feet:

Mhz	Series 6
55	1.50
450	4.28
750	5.82
1000	6.54

Figure 3 – RG-6 Coaxial Cable Minimal Parameters

1.6 COAXIAL CABLE CONNECTORS

- A. Provide two-part, crimp-style, Coax Cable, Male F-Connectors at each end of the RG-6, Horizontal Coaxial Cables.
- B. Match the connectors to the Coaxial Cable Manufacturer.

1.7 RF DISTRIBUTION AMPLIFIER SYSTEM

- A. Provide a rack-mounted RF Broadband amplifier 49-750 MHz and minimum of 32 dB Gain for the head end.
- B. Connect the RF Amplifier input to the CATV Feed and connect the output to a bank of centrally mounted 8 port taps.
- C. Connect the Work Area Coaxes to the taps as required to provide the required Work Area Outlet signal strength.
- D. Provide multiple tap values based on the coax cable lengths served. Terminate all unused outputs.

- E. Supply equalizers on the amplifier input, as required, to insure a +/- 2 dB flat signal input to the Distribution Amplifier.
- F. The amplifier input should be set 3-6 dB over the amplifier noise factor (sweet spot) – which is usually around 8 dB – yielding a typical input value between +11 -- +14 dBmv.
- G. If the CATV feed is not strong enough install a pre-amplifier on the CATV feed or arrange for the CATV service provider to adjust the incoming signal upwards. The optimum CATV input signal for the case where the ER serves all locations is +11 to +14 dBmv, flat across all input channels.
- H. Adjust the amplifier gain and slope to provide a minimum of a +3 dBmv signal across all channels at each Work Area outlet.
- I. The maximum signal across all channels shall be limited to +10 dBmv.
- J. When the building size requires more than one serving area, split the incoming CATV signal as required based on the number of serving areas and connect the splitter outputs to RG-11 feeder cables for each serving area.
 1. Adjust the CATV feeder signal upwards accordingly to compensate for the additional loss of the head end splitter.
 2. Provide a pre-amplifier on the CATV input signal feed if unable to obtain the required signal levels.
 3. Provide equalizers at the end of long RG-11 feeders to insure a flat input signal level to the far end Distribution amplifiers.
 4. Install attenuators on amplifier inputs as required to keep the input signal within the +11 to +14 dBmv (typical) sweet-spot range.

1.8 INSTALLATION

- A. All cabling shall be installed according to ANSI/EIA/TIA specifications and **BICSI** standards.
- B. All coaxial cabling shall be terminated on rack-mounted patch panels using F-Connectors, as noted above.
- C. Broadband Wiring System shall be designed for signal balance of +3 to +10dBmv signal level at every video outlet location over the entire channel range.
- D. Adjust amplifier tilt and gain as required. Connect User Coax to appropriate multi-port tap based on loss required to balance system. Supply Cable Equalizers as required.

1.9 LABELING

- A. Patch panels, cables, jacks, system components, etc. shall be labeled according to ANSI/EIA/TIA-606 specifications and in coordination with the District/architect.
- B. All Coaxial Cables shall be equipped with a self-laminating, wrap-around, machine printed label at both ends of the cable.

COMMUNICATIONS

CHAPTER 9: SPECIFICATIONS

-
- C. All Coaxial Cable Patch Panels shall be equipped with pre-printed, cable identification designation strips installed behind clear plastic label holders on the front of the patch panel.

1.10 TESTING

- A. All Cable test results shall be stored and presented to the Architect in both hard copy and electronic format for approval.
- B. All Cable Tester, Record designations shall match the associated cable label, and associated patch panel label designation.
- C. All Coaxial Cables shall be tested with a hand held cable tester.

END OF SECTION

SECTION 274119

VIDEO DISPLAY EQUIPMENT

GENERAL GUIDELINES

1.1 GENERAL

- A. This Section defines the general design requirements for uniform Interactive Video Display Equipment that shall be followed for all OSFC Technology construction projects.
- B. Refer to Section 8500, Technology Systems, and Section 8600, Electrical Systems, for additional information.

1.2 SECTION INCLUDES

- A. VIDEO DISPLAY EQUIPMENT
 - 1. **Flat Panel** TV and Projector Mounts
 - 2. **Flat Panel** TV/Monitors
 - 3. Projectors

1.3 QUALITY ASSURANCE

- A. All equipment shall be UL listed.
- B. All equipment and Installation Practices shall comply with the latest ANSI/NFPA-70 National Electric Code.
- C. All equipment **and** Installation Practices shall comply with the Local Electric Code.
- D. All equipment and Installation Practices shall comply with the latest InfoComm International Installation Handbook.**
- E. All equipment and Installation Practices shall comply with the latest BICSI[®] Telecommunications Distribution Methods Manual (TDMM).
- F. All equipment shall comply with the latest ANSI TIA/EIA-568, 569, 606, 607, 862, standards as applicable.

1.4 SYSTEM WARRANTY

- A. The Video Display Equipment Systems and associated software shall be warranted by the contractor for a period of one (1) year from date of substantial completion.

1.5 **FLAT PANEL** TV AND PROJECTOR MOUNTS

- A. Provide wall type **flat panel** mounts with appropriate forward tilt, **or fully articulating arm**, as required.

COMMUNICATIONS

CHAPTER 9: SPECIFICATIONS

- B.** Provide Ceiling *or* Wall Mounts for projectors with appropriate *provisions* for electrical outlet and A/V cables.
- C.** Utilize security/theft-deterrent mounting hardware on all projectors, displays and mounts as required.

1.6 PROJECTORS

- A.** Provide High-Resolution Projectors for each classroom and large venue viewing spaces.
- B.** Projectors are the required classroom display device. Provide Projectors for *large* viewing rooms or conference room, as required.
- C.** Projector shall produce light output that results in a minimum of 10:1 contrast ratio. The projector's lumen output shall be at least 60 foot-candles of full white light on the projection screen when the projected image fills the screen. Example given: Typical 900 to 1000 SF classroom utilizing a screen 60"H x 80"W (**4:3** aspect ratio) screen would require a projected output of \geq 2500 lumen. Projector with native **1024x768** resolution or better for classrooms. Projectors shall have support for 16:9.
- D.** The primary classroom display device shall be *a ceiling-mounted* or wall mounted (integrated with interactive whiteboard), projector with associated permanent mounting and security hardware and associated screen or reflective marker surface (Use an associated device as the TV Tuner when District has a Broadband Head-end).
- E.** *Provide both analog and digital video inputs as required.*
- F.** Provide Projectors with Ethernet connection *or RS-232 to ethernet interface* and central management software.

1.7 Flat Panel TV/MONITOR

- A.** The *Flat Panel TVs/Monitors* shall be equipped with a combination analog and digital 181-channel tuner and shall have minimum native resolution of 1024 x 768 (XGA) and support 1080p without the use of scan-converters or line-doublers.
- B.** The minimum *Flat Panel* TV/Monitor shall be 32 inches.
- C.** Provide *Flat Panel TV/Monitor* for Public viewing in Entrances, Corridors and/or Reception areas, *small conference/meeting* rooms, and Small Self-Contained Classrooms.
- D.** Provide *Flat Panel TV/Monitor* Units with Ethernet connection and central management software.
- E.** Large *CRT-style* monitors may ONLY be supplied to match existing installations or based on specific District requirements and OSFC approval. Connect to associated *Program Source Device*, Instructor PC, optional Set-Top-Box, and to Classroom Sound System.

1.8 LARGE VENUE VIDEO PROJECTOR

- A. Provide a large screen format, 5000 Lumen minimum, projector for the student dining area, auditorium and other large venue areas. Provide Keystone correction as required.
- B. Provide a lift system allowing multiple heights for storage, normal use, and service, as required.
- C. Provide front or rear screen projection based on District's and Architect's requirements.

1.9 OPTIONAL A/V CONTROL SYSTEM

- A. Full user control of **program source device**, projector, **projection screen and lights** through either web-based application or **touch** panel.
- B. System diagnostics and scheduled operation of media devices via web-based application.

1.10 INSTALLATION

- A. Mount Projectors and **Flat Panel** TV/Monitors using manufacturer's recommended hardware.
- B. Connect Devices to IP Network for Central Control.
- C. Adjust all Projectors for proper focus, keystone correction and display size.
- D. Install all associated software monitoring and control programs.

1.11 TESTING

- A. Verify picture **and sound** quality on all A/V inputs.
- B. Test all associated software control programs.

END OF SECTION

SECTION 274120

INTERACTIVE AUDIO-VIDEO EQUIPMENT

GENERAL GUIDELINES

1.1 GENERAL

- A. This Section defines the general design requirements for uniform Interactive Audio-Video Equipment that shall be followed for all OSFC Technology construction projects.
- B. Refer to Section 8500, Technology Systems, and Section 8600, Electrical Systems, for additional information.

1.2 SECTION INCLUDES

- A. Interactive Audio-Video Equipment
 - 1. Interactive White Boards.
 - 2. Interactive Writing Tablets.
 - 3. Student Response System.
 - 4. Document Camera.

1.3 QUALITY ASSURANCE

- A. All equipment shall be UL listed.
- B. All equipment and Installation Practices shall comply with the latest ANSI/NFPA-70 National Electric Code.
- C. All equipment Installation Practices shall comply with the Local Electric Code.
- D. All equipment and installation practices shall comply with the latest InfoComm International Installation Handbook.**
- E. All equipment and Installation Practices shall comply with the latest BICSI[®] Telecommunications Distribution Methods Manual (TDMM).
- F. All equipment shall comply with the latest ANSI TIA/EIA-568, 569, 606, 607, 862, standards as applicable.

1.4 SYSTEM WARRANTY

- A. The Interactive Audio-Video Equipment Systems and software shall be warranted by the contractor for a period of one (1) year from date of substantial completion.

1.5 INTERACTIVE AUDIO-VIDEO EQUIPMENT

- A. Interactive White Board **Technology**
 - 1. Provide Interactive White Boards and Software, refer to Section 8500 for suggested quantities.
 - 2. Consider technologies that utilize passive whiteboards.**
 - 3. Consider wireless controls for units based on cabling requirements.
 - 4. Provide stands for portable units and wall-mounts for permanently installed units.

- B. Interactive Tablet
 - 1. Provide Interactive Tablets (*integrated display type or non-display type*) and Software, refer to Section 8500 for suggested quantities.
- C. Student Response System
 - 1. Wireless response system with:
 - a. Student Response Pads
 - b. Receiver that connects to PC
 - c. Associated Software
 - 2. Each system will include a minimum of 30 pads and one receiver.
 - 3. Refer to Section 8500 for suggested quantities.
- D. Document Camera
 - 1. Includes:
 - a. Camera with minimum resolution of 1042 (h) x 768 (v) pixels and minimum total zoom of 40x (optical and digital).
 - b. 20 fps motion.
 - c. Multiple inputs and outputs.
 - d. Integrated light.
 - e. Capture Software.
 - 2. Refer to Section 8500 for suggested quantities.

1.6 INSTALLATION

- A. Install the Interactive White Boards at the front of the classroom and focus the associated classroom projector so that the image *fits within* the Interactive White Board *borders*.
- B. Connect the Interactive White Board to the Instructor's PC and install the associated Software on the Instructor's PC.
- C. Install the Interactive Tablet at the Instructor's Technology Center. *If the Interactive Tablet is of the integrated display type then* connect the unit *in-line with appropriate video* output from the Instructor's PC to the associated classroom/lab projector.
- D. Connect the Interactive Tablet to the Instructor's PC and install the associated Software on the Instructor's PC.
- E. Connect the Student Response System and Document Camera to the Instructor's PC and install the associated Software on the Instructor's PC as coordinated with the District.

1.7 TESTING

- A. The devices and associated software systems shall be tested end-to-end complete.

1.8 TRAINING

- A. Provide minimum of eight (8) hours training for District personnel on the operation and maintenance of each of the systems.
- B. Provide two (2) video copies of all training.

END OF SECTION

SECTION 274125

DIGITAL ON-DEMAND INSTRUCTIONAL DELIVERY SYSTEM

GENERAL GUIDELINES**1.1 GENERAL**

- A. This Section defines the general design requirements for a uniform Digital-On-Demand Instructional Delivery System that shall be followed for all OSFC Technology construction projects.
- B. Figure 1 describes Typical Digital-On-Demand Instructional Delivery System.
- C. Refer to Section 8500, Technology Systems, and Section 8600, Electrical Systems, for additional information.

1.2 SECTION INCLUDES

- A. DIGITAL-ON-DEMAND INSTRUCTIONAL DELIVERY SYSTEM
 1. Digital Video On-Demand System.
 2. Digital Video Control and Scheduling System.
 3. Video Bulletin Board System.
 4. Video Camera System.
 5. Video DVD/VCR System.

1.3 QUALITY ASSURANCE

- A. All equipment shall be UL listed.
- B. All equipment and Installation Practices shall comply with the latest ANSI/NFPA-70 National Electric Code.
- C. All equipment Installation Practices shall comply with the Local Electric Code.
- D. All equipment shall comply with the latest ANSI-J-STD-607 Commercial Building Grounding (Earthing) and Bonding Requirements for Telecommunications Standard.
- E. All equipment and Installation Practices shall comply with the latest BICSI[®] Telecommunications Distribution Methods Manual (TDMM).
- F. All equipment shall comply with the latest ANSI TIA/EIA-568, 569, 606, 607, 862, standards.

1.4 SYSTEM WARRANTY

- A. The Digital-On-Demand Instructional Delivery System and software shall be warranted by the contractor for a period of one (1) year from date of substantial completion. Provide advanced replacement for all Network Electronics for the one (1) year-period.

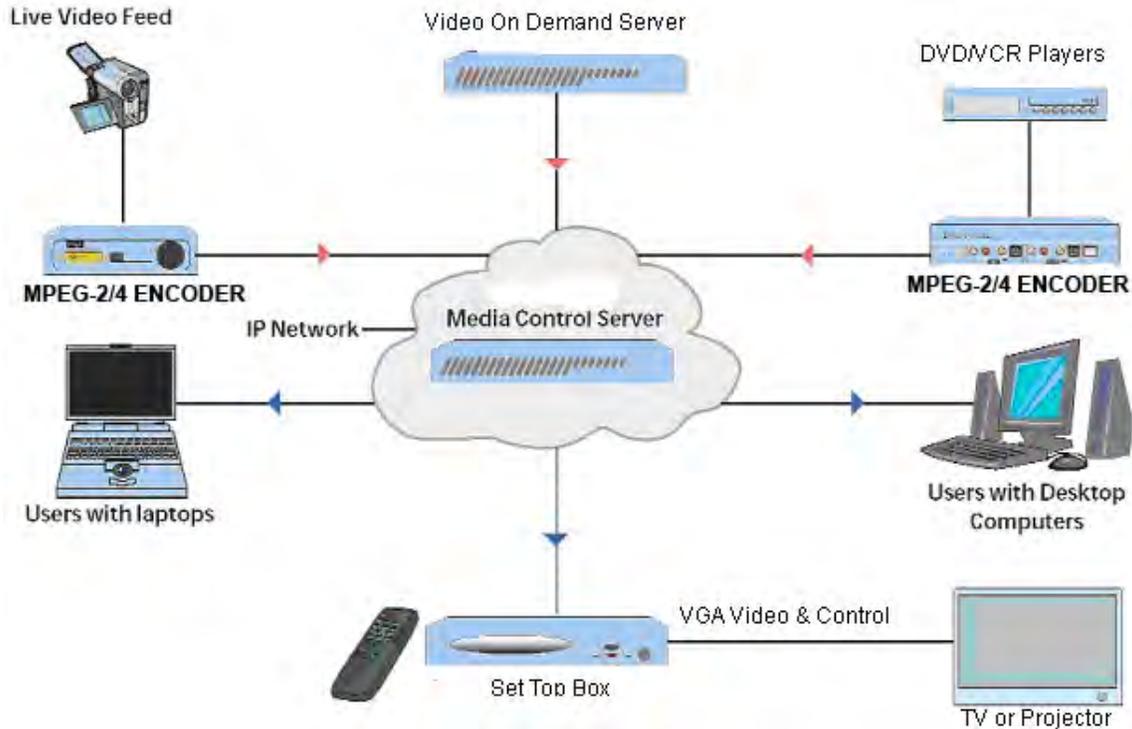


Figure 1 – Typical Digital-On-Demand Instructional Delivery System

1.5 DIGITAL VIDEO ON DEMAND MPEG SERVER

A. GENERAL

1. The system shall include a centrally based media retrieval system consisting of a video server-based, on-demand, MPEG-2, MPEG-1 and MPEG-4 streaming video delivery system.
2. System shall include a video billboard message and information system delivered over the broadband system or via MPEG Decoders.
3. Control of the Central Media System components shall be via a WEB Browser interface from a PC or from a MPEG Set-Top-Box.
4. The Digital On-Demand Instructional Delivery System shall provide remote access to centrally stored digital video sources. The system shall transmit the video as a streaming data file format (MPEG-1, MPEG-2 or MPEG-4) over the Ethernet IP Network.
5. The system shall also be capable of direct access to the Internet (MPEG-4). Program the required VLANs and provide sufficient 10/100 Ethernet Ports for connection of all associated devices.
6. Classrooms shall be equipped with Set-Top-Box (STB) for receiving streamed and pre-recorded MPEG Video Signals. The STB shall be connected to the associated Classroom Projector and Audio System.
7. Provide Central Control System for Projectors for turning units on/off, selecting inputs and streaming scheduled program sources. Unit should turn all Projectors off at end of day
8. Playback of the Videos at classroom and Lab PCs shall be through a standard WEB Browser interface using a standard Media Player such as Windows Media Player, Real Player or Apple Quick-Time.

COMMUNICATIONS**CHAPTER 9: SPECIFICATIONS**

- B. DIGITAL VIDEO SERVER - VOD
 1. Supply a centrally located MPEG-1, 2 and 4 Video Server Unit consisting of a PC based, Digital Video on Demand Server connected to the Network Electronics on a separate Video VLAN.
 2. Consider supplying one large VOD Server per District when WAN bandwidth permits.
 3. The Digital Video Server shall support True Video-on-Demand (VOD), Near-Video-on-Demand (NVOD), and Subscription-Video-on-Demand (SVOD).
 4. The Digital Video Server shall have a scalable output from a minimum of 25 to 200 – 3 Mbps video MPEG streams.
 5. The Digital Video Server shall have fault-tolerant, RAID storage with minimum capacity of 200 hours with hot-swappable drives.
 6. The Digital Video Server shall be connected to the local area network through a minimum of one (1) Gigabit Ethernet connection.
 7. Size the VOD Server based on District Video Storage requirements.

1.6 DIGITAL VIDEO CONTROL AND SCHEDULING SYSTEM

- A. The Video Control and Scheduling System shall provide a simple interface to easily locate available Live and On Demand media assets on Windows PCs, Macs, and Set Top Boxes.
- B. Users shall be able to navigate and search for specific videos, select the video, and it immediately begins playing. For On Demand videos, users shall have full Fast Forward and Rewind capabilities.
- C. The Video Control and Scheduling System shall provide a calendar-based scheduling system that shall allow users to quickly and easily schedule Live Broadcasts from MPEG encoders, Stored Broadcasts from Video on Demand servers, Recordings, and Conferences. Scripting functionality shall also allow users to set up custom schedules.

1.7 VIDEO BULLETIN BOARD SYSTEM

- A. Provide a PC based Bulletin Board system consisting of a Pentium-4 PC, minimum 2.0 GHz, equipped with minimum of 1 Gb of RAM, minimum of a 80 Gb, 7200 RPM Hard Drive, 15 inch Color Monitor/Panel, Multi-output Video Card (VGA and S-video or Composite), Microsoft Windows XP-Pro or later, and Microsoft Office 2003 or later (BBS Software will consist of Power Point Presentations), and PC Anywhere Remote Control Software.
- B. Connect Composite or S-Video and Audio output of Bulletin Board PC to A/V MPEG-2 Encoder input for streaming of Bulletin Board Broadcasts to PCs and Set Top Boxes.
- C. Connect the Bulletin Board PC to Network Electronics via a 100 Mb Ethernet Connection.

1.8 VIDEO CAMERA SYSTEM

- A. Provide 2 digital Video Cameras with a wheeled tripod for remote origination of video broadcasts, and announcements. Equip each camera with a dual MPEG-2/4 Encoder Unit for broadcasting low and high bit rate MPEG streams.
- B. It shall be possible to broadcast the portable camera signal across the IP Network to Monitors, Projectors and/or PCs in the school or any of the other schools within the District, and simultaneously record the signal if desired. The Camera(s) can be used for Video Announcements, recording of lessons and/or events or as a point-to-point link between any two (2) schools.

1.9 VIDEO DVD/VCR SYSTEM

- A. Provide 2 DVD/VCR Combo units located in the Media Center for live streaming and recording. Equip each DVD/VCR combo unit with a dual MPEG-2/4 Encoder Unit for broadcasting low and high bit rate MPEG streams.

1.10 INSTALLATION

- A. Contractor shall install and program all Digital Video Distribution Equipment and establish all necessary VLANs as required.

1.11 LABELING

- A. Cables, jacks, system components, etc. shall be labeled according to ANSI/EIA/TIA-606 specifications and in coordination with the District/architect.
- B. All Video Cables shall be equipped with a self-laminating, wrap-around, machine printed label at both ends of the cable.

1.12 TESTING

- A. Video Wiring system and associated systems shall be tested end-to-end complete.

1.13 TRAINING

- A. Provide minimum of sixteen (16) hours training for District personnel on the operation and maintenance of each of the AV Media systems.
- B. Provide two (2) video copies of all training.
- C. MPEG-2 encode and place a copy of training video on VOD server.

END OF SECTION

SECTION 275121

STUDENT DINING / AUDITERIA SOUND REINFORCEMENT SYSTEM – HIGH SCHOOL

GENERAL GUIDELINES

1.1 GENERAL

- A. Refer to Section 8500, Technology Systems, for additional information.

1.2 SECTION INCLUDES

- A. Sound Reinforcement System
- B. Stage/Production Intercom System
- C. Assistive Listening System
- D. Monitor/Effects Foldback System
- E. Backstage Monitor/Cue System

1.3 QUALITY ASSURANCE

- A. NFPA 70 - National Electrical Code.
- B. Underwriter's Laboratory.
- C. TIA/EIA-607 Telecommunications Grounding.
- D. ***Eleventh*** Edition (or latest) BICSI Telecommunications Distribution Methods Manual (TDMM).
- E. Americans with Disabilities Act (ADA).
- F. Federal Communications Commission Part 15.
- G. Sound System Engineering (Davis & Patronis) – 3rd Edition 2006.
- H. Audio Systems Design and Installation (Giddings) 1990.

1.4 SYSTEM WARRANTY

- A. The Student Dining/Auditeria Sound Reinforcement System shall be warranted by the Contractor for a period of one (1) year from date of substantial completion.

1.5 RELATED SECTIONS

- A. Specification section 271543–Audio-Video Communications Horizontal Cabling
- B. Specification section 274119 – Video Display Equipment

- C. Specification section 274120 – Interactive Audio-Video Equipment
- D. Specification section 274117 – Broadband Video RF Distribution System

1.6 MATERIALS

- A. Stationary Main Equipment Cabinet with the following rack mounted equipment:
 - 1. Mixer/Preamplifier
 - 2. Power Amplifier(s)
 - 3. Digital Signal Processor(s)
 - a. RS-232 Interface for Configuration and Tuning
 - b. Equalization Filters – graphic and/or parametric
 - c. Compressor/Limiter
 - d. Digital Delay for cluster alignment (***if applicable***)
 - e. High and Low Pass and Shelving Filters
 - f. Feedback Suppression (may be incorporated in DSP or a stand-alone unit)
 - g. Crossover (if bi-amplified speaker system is utilized)
 - h. Selectable scene presets
 - 4. AM/FM radio tuner
 - 5. Assistive Listening Transmitter (provide with ADA-compliant quantity of receivers)
 - 6. Monitor/Effects Foldback System amplification and signal processing, including feedback eliminators and equalization
 - 7. Sequencing AC Power Control System
 - 8. Passive or Active thermal control
 - 9. Microphone termination/splitting panel in Main Equipment Cabinet
- B. Program Source Cabinet
 - 1. i-Pod Docking Station
 - 2. Wireless microphone receivers (minimum qty. 4) and antenna distribution system. Provide with handheld and/or lavalier microphones.
 - 3. CD/CD-R/CD-RW/MP3 Player
 - 4. ***Digital audio recording device.***
 - 5. Production Intercom Wireless Base Station – Provide with a minimum of four (4) wireless belt packs and headsets
 - 6. Input/output jack panel
 - 7. AC power distribution panel
- C. House Speaker Options:
 - 1. Point source speaker or speaker cluster suspended from structure.
 - 2. Speaker cluster with delayed satellite speakers.
 - 3. Distributed full range speakers.
 - 4. Sub Woofer(s) – (optional)
- D. Monitor Speakers – floor wedge or stand-mounted – minimum qty. 2. Provide with rubber-jacketed speaker cables.
- E. Distributed Jackplates:
 - 1. Microphone jackplates (XLR-F connectors).
 - 2. Monitor/Effects speaker jackplates (Speakon style).
 - 3. Multi-pin send/return connectors at mixing locations in Control Room and at rear of audience seating area.

COMMUNICATIONS

CHAPTER 9: SPECIFICATIONS

- F. Multi-pair “snake cable” with individually shielded pairs, connectorized at both ends.
- G. Direct box(es) for insertion of line level and laptop sound card signals into microphone jacks.
- H. Mixing Console – Minimum requirements: 24-microphone input channels; 2-stereo line level input channels; stereo and mono output busses; 4-aux output busses
- I. Hanging microphones – for use over stage (minimum qty. 2).
 - 1. Microphones, microphone stands, cords, and connectors.
- J. Handheld, lavalier or boundary microphones. (minimum qty. 2) Include floor or desk stands and cords.

1.7 INSTALLATION


- A. Install and balance system. Adjust all sound levels for desired operation levels and evenness of coverage.
- B. Adjust all wireless equipment and verify coverage areas.
- C. Check polarity of all input jacks, signal chains, and speakers.
- D. Check gain structure.
- E. Connect FM Tuner to external, building mounted FM Antenna Distribution System. Ground antenna in accordance with NEC and TIA/EIA-607.
–OR–
Receive radio reception from Distributed Broadband RF system.
- F. Ground equipment cabinet and associated equipment to cabinet-mounted telecommunications grounding buss bar in accordance with NEC and TIA/EIA-607.
- G. Install in accordance with manufacturer’s installation instructions.

1.8 PERFORMANCE TESTING

- A. Frequency response: 80Hz – 14kHz +/- 3 dB.
- B. Loudness: At least 96dB-SPL program level with an additional 6 dB Crest factor.
- C. Evenness of coverage: Variation of less than +/- 3dB (400Hz to 4000Hz) at all seats.

1.9 TRAINING

- A. Provide eight (8) hours training for District’s personnel on the operation and maintenance of the system.
- B. Provide two (2) video copies of all training

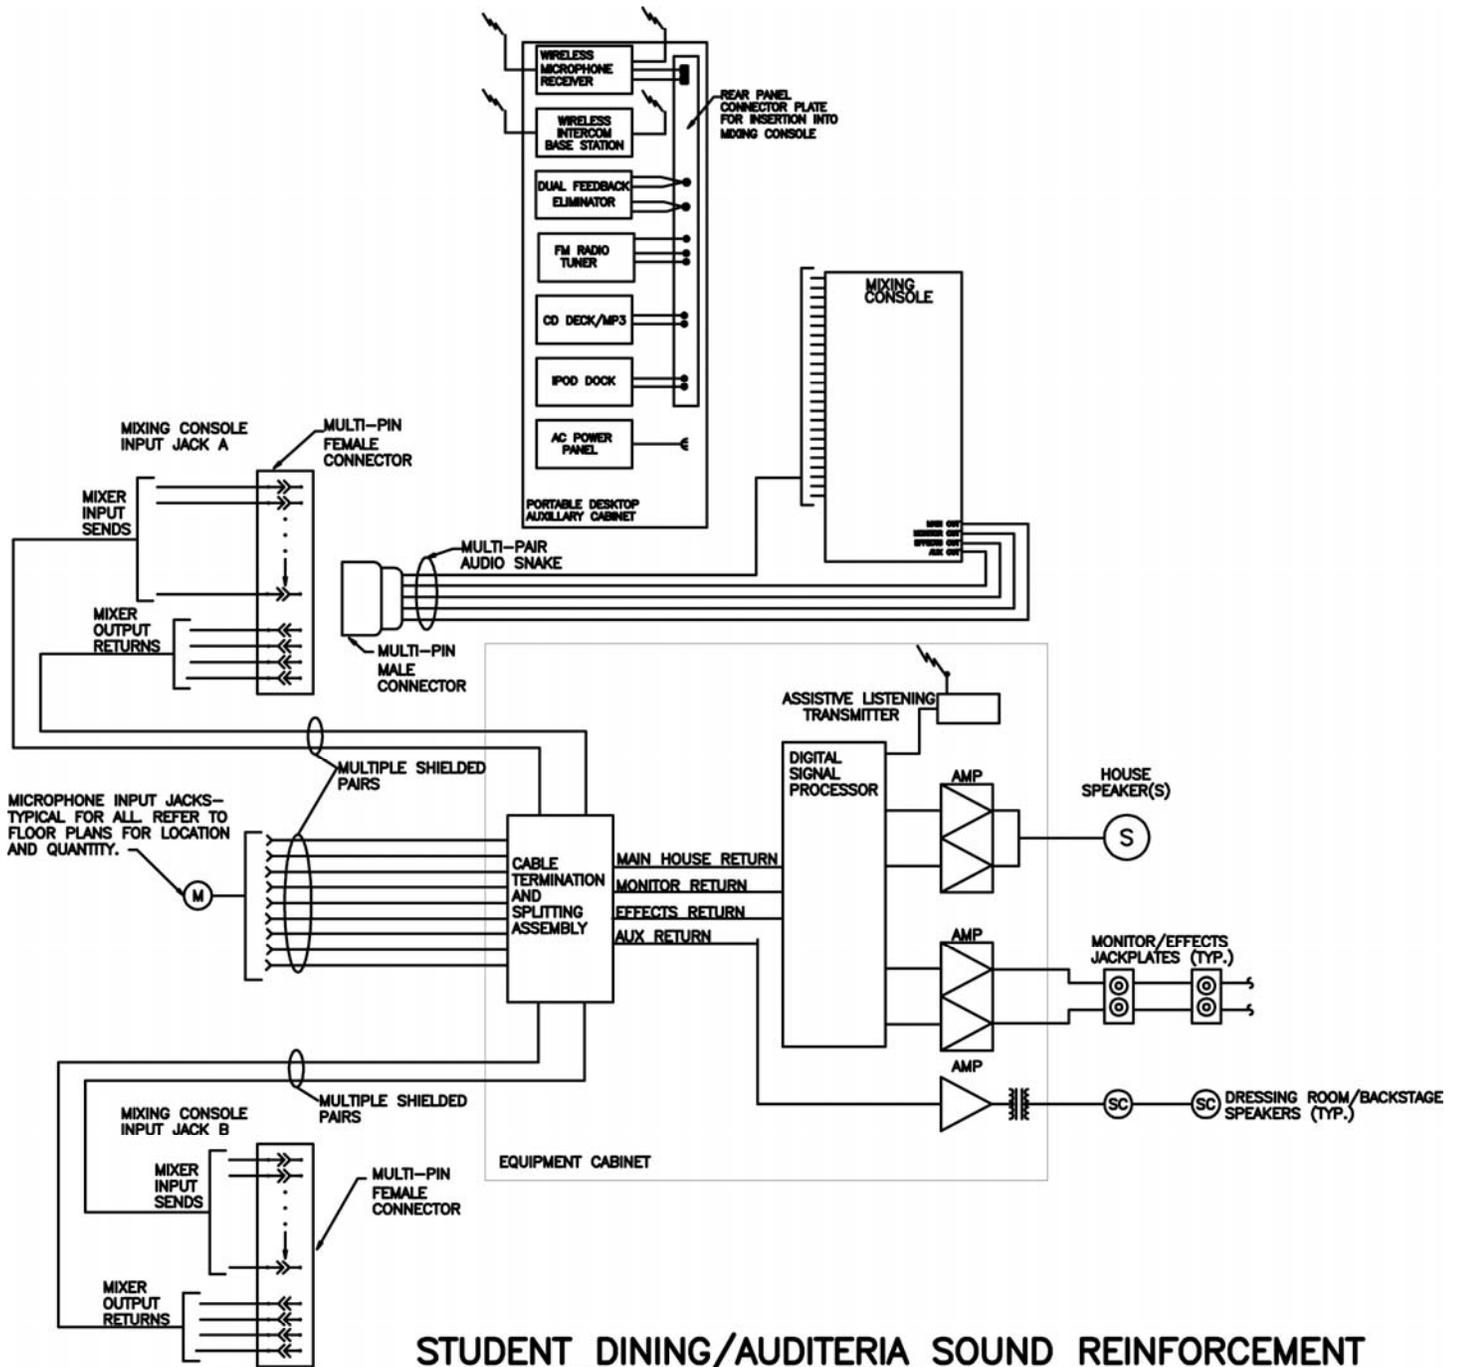

STUDENT DINING/AUDITERIA SOUND REINFORCEMENT SYSTEM DIAGRAM – HIGH SCHOOL

SCALE: NONE (RE: 27 51 21)

NOTE: THIS DIAGRAM IS SCHEMATIC IN NATURE ONLY. IT IS INTENDED TO SHOW GENERAL CONFIGURATION OF THE SYSTEM. MODIFY TO ACCOMMODATE DESIGN PREFERENCES, OWNER NEEDS AND PROJECT CONDITIONS.

END OF SECTION

SECTION 275122

STUDENT DINING / CAFETERIA SOUND REINFORCEMENT SYSTEM

GENERAL GUIDELINES

1.1 GENERAL

- A. Refer to Section 8500, Technology Systems, for additional information.

1.2 SECTION INCLUDES

- A. Sound Reinforcement System
- B. Assistive Listening System

1.3 QUALITY ASSURANCE

- A. NFPA 70 - National Electrical Code.
- B. Underwriter's Laboratory.
- C. TIA/EIA-607 Telecommunications Grounding.
- D. **Eleventh** Edition (or latest) BICSI Telecommunications Distribution Methods Manual (TDMM).
- E. Americans with Disabilities Act (ADA).
- F. Federal Communications Commission Part 15.
- G. Sound System Engineering (Davis & Patronis) – 3rd Edition 2006.
- H. Audio Systems Design and Installation (Giddings) 1990.

1.4 SYSTEM WARRANTY

- A. The Student Dining/Cafeteria Sound Reinforcement System shall be warranted by the contractor for a period of one (1) year from date of substantial completion.

1.5 RELATED SECTIONS

- A. Specification Section 271543–Audio-Video Communications Horizontal Cabling
- B. Specification Section 274119 – Video Display Equipment
- C. Specification Section **274120** – Interactive Audio-Video Equipment
- D. Specification Section **274117** – Broadband Video RF Distribution System

1.6 MATERIALS

- A. Stationary Main Equipment Cabinet with the following rack mounted equipment:
1. Mixer/Preamplifier (minimum of 8 channels)
 2. Power Amplifier(s)
 3. Digital Signal Processor(s)
 4. RS-232 Interface for Configuration and Tuning
 5. Equalization Filters – graphic and/or parametric
 6. Compressor/Limiter
 7. Digital Delay for cluster alignment (***if applicable***)
 8. High and Low Pass and Shelving Filters
 9. Feedback Suppression (may be incorporated in DSP or a stand-alone unit).
 10. Crossover (if bi-amplified speaker system is utilized)
 11. Selectable scene presets
 12. AM/FM radio tuner
 13. i-Pod Docking Station
 14. CD/CD-R/CD-RW/MP3 Player
 15. ***Digital audio recording device***
 16. Wireless microphone receivers (Minimum Qty. 1) and antenna distribution
 17. Assistive Listening Transmitter (provide with ADA-compliant quantity of receivers)
 18. Sequencing AC Power Control System
 19. Passive or Active thermal control
- B. Speaker Options:
1. Point source speaker or speaker cluster suspended from structure.
 2. Speaker cluster with delayed satellite speakers.
 3. Distributed full-range speakers.
- C. Distributed Jackplates
1. Microphone input jackplates (XLR-F connectors).
 2. Balanced, auxiliary-input, jack plate assemblies.
- D. Microphones, microphone stands, cords, and connectors (minimum qty. 4).

1.7 INSTALLATION

- A. Install and balance system. Adjust all sound levels for desired operation levels and evenness of coverage.
- B. Adjust all wireless equipment and verify coverage areas.
- C. Check polarity of all speakers and adjust all microphone and source input levels.
- D. Connect FM Tuner to external, building mounted FM Antenna and Distribution System. Ground Antenna in accordance with NEC and TIA/EIA-607.
–OR–
Receive radio reception from Distributed Broadband RF system as specified in another spec section.
- E. Ground equipment cabinet and associated equipment to cabinet-mounted telecommunications grounding busbar in accordance with NEC and TIA/EIA-607

COMMUNICATIONS

CHAPTER 9: SPECIFICATIONS

- F. Install in accordance with manufacturer's installation instructions and recommendations.


1.8 PERFORMANCE TESTING

- A. Frequency response: 80Hz – 14kHz +/- 3 dB.
- B. Loudness: At least 90 dB-SPL program level with an additional 6 dB Crest factor.
- C. Evenness of coverage: Variation of less than +/- 3dB (400Hz to 4000Hz) at all seats.

1.9 TRAINING

- A. Provide eight (8) hours training for District's personnel on the operation and maintenance of the system.

- B. Provide two (2) video copies of all training

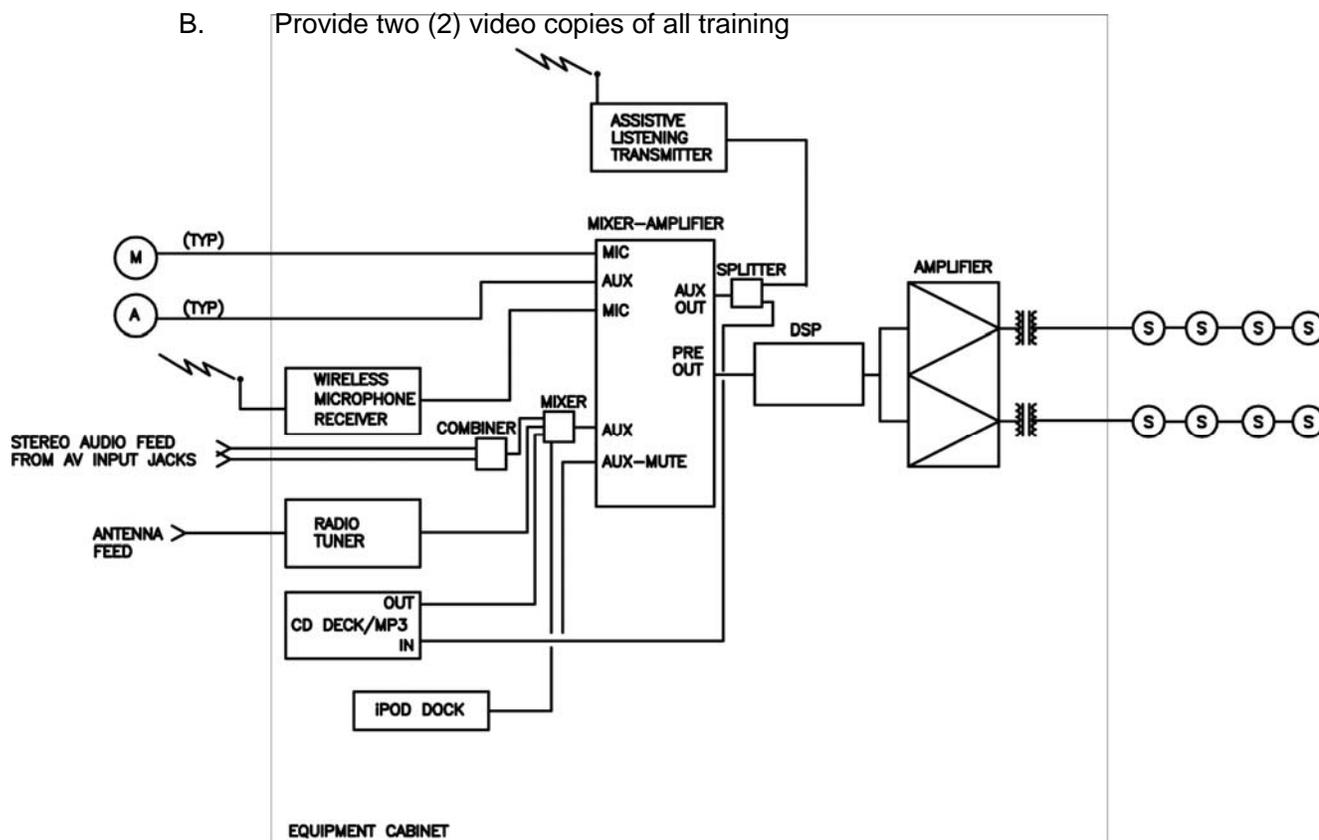

STUDENT DINING/CAFETERIA SOUND REINFORCEMENT SYSTEM DIAGRAM

SCALE: NONE (RE: 27 51 22)

NOTE: THIS DIAGRAM IS SCHEMATIC IN NATURE ONLY. IT IS INTENDED TO SHOW GENERAL CONFIGURATION OF THE SYSTEM. MODIFY TO ACCOMMODATE DESIGN PREFERENCES, OWNER NEEDS AND PROJECT CONDITIONS.

END OF SECTION

SECTION 275123

CENTRAL SOUND AND PAGING SYSTEM

GENERAL GUIDELINES

1.1 GENERAL

- A. This section defines the general design requirements for a uniform Central Sound and Paging System that shall be followed for all OSFC Technology construction projects.
- B. The basis of design is a full-function, microprocessor-based, two-way intercommunications/zoned paging/program distribution system **interfaced with and operated by the telephone system (specified elsewhere)**.
- C. **An optional one-way zoned paging system, interfaced and operated by the telephone system (specified elsewhere) shall require an OSFC variance.**
- D. Refer to Section 8500, Technology Systems, for additional information.

1.2 SECTION INCLUDES

- A. Central Sound and Paging System and all related components.

1.3 QUALITY ASSURANCE

- A. NFPA 70 – National Electrical Code
- B. Underwriter's Laboratory
- C. TIA/EIA-607 Telecommunications Grounding
- D. **Eleventh** Edition (or latest) BICSI Telecommunications Distribution Methods Manual (TDMM)
- E. Americans with Disabilities Act (ADA)
- F. Federal Communications Commission Part 15
- G. Sound Systems Engineering (Davis & Patronis) – 3rd Edition 2006
- H. Audio Systems Design and Installation (Giddings) 1990

1.4 SYSTEM WARRANTY

- A. The Central Sound and Paging System shall be warranted by the Contractor for a period of one (1) year from date of substantial completion.

COMMUNICATIONS

CHAPTER 9: SPECIFICATIONS

1.5 RELATED SECTIONS

- A. Specification section 274117 – Broadband Video RF Distribution System
- B. Specification section 275313 – Clock Systems
- C. Specification section 273113 – **IP-Enabled PABX System**
OR Specification section 273123 – IP-Only PABX System

1.6 MICROPROCESSOR-BASED TWO-WAY INTERCOM / PAGING / PROGRAM DISTRIBUTION SYSTEM (*Base Design*)

- A. PABX System Interface
- B. Administrative communications console – located in main office or at equipment headend
- C. Microprocessor-based with RS-232 Interface for setup and/or control
- D. Minimum eight (8) paging and time tone distribution zones
- E. Internal time-tone schedule programming and software
- F. Synchronization with clock system
- G. Input signal prioritization
- H. Dedicated home-run speaker circuits from each classroom or special function room (gymnasiums, dining rooms, multi-purpose rooms, **exterior spaces**, etc.). **Call button cabling is included in baseline system whether the call button is installed or not. Extend to speaker location if call button is not installed.**
- I. **Base Line** - Call origination switches or handsets in each classroom with annunciator display in central school reception office. **Variance required if District elects not to include. Technology Designer to review system with District, determine need for conduit/box rough-ins for future if District elects not to include in project via variance.**

1.7 ONE-WAY ZONED PAGING SYSTEM (*Optional System Requires Variance*)

- A. PABX System Interface
- B. Microprocessor-based, zoned paging/program distribution system
- C. Minimum of six (6) paging zones
- D. Distribution of class-change time tones as scheduled by Clock System
- E. Input signal prioritization

- F. One-Way Zoned Paging System Options:
1. High impedance, constant voltage system with centrally located power amplifiers and passive speakers with 25-volt transformers. Each classroom speaker circuit to be individually wired and extended to headend equipment. Corridor and common area speakers to be grouped according to zones.
 2. Low-voltage, amplified speakers with central power supplies and star-wired CAT3 cabling system terminated on 110-style cross-connect blocks, located on the backboard in main Equipment Room (ER). Each speaker wired with dedicated, individual home-run cable. Use pair 1 for paging signal and pairs 2-4 for power.
- G. Central paging power supplies based on system load. Connect to Main Equipment Room (ER) UPS unit, powered by building emergency generator circuit(s).

1.8 COMPONENTS COMMON TO ALL SYSTEMS:

- A. PROGRAM SOURCE CABINET - Locate a wall-mounted or desktop cabinet in the central school reception office area and place within the cabinet:
1. ***i-Pod Docking Station (optional)***
 2. CD player or changer
 3. AM/FM radio connected to the building antenna/RF distribution system
 4. Monitor speaker panel for program cueing and preview
 5. Connect audio outputs to audio inputs on the paging adapter (when applicable)
- B. EMERGENCY/EVACUATION ALARM TONE PANEL
1. Locate in central school reception office area – either as a stand-alone wall-mounted device or within Program Source Cabinet.
 2. Minimum of three (3) clearly labeled switches to activate distinct tones: EMERGENCY, EVACUATION, ALL-CLEAR.
 3. Assign highest priority level
- C. ALL-CALL PAGING MICROPHONE
1. Locate in central school reception office area. Use of receptionist's telephone handset is permissible, if acceptable to the school.
- D. Locate a minimum of one (1) paging speaker or horn in all building rooms, including Mechanical areas. Base the quantity of speakers/horns on the required signal level and the size of the area to be covered.
- E. Speaker and horn types:
1. Flush-mounted ceiling speakers with all metal protective dome enclosures and ceiling bridge support.
 2. Surface-mount wall or ceiling speakers
 3. Compression driver paging horns in gymnasiums, shop areas, mechanical rooms, exterior of building (weather-proof type) and other areas with high ambient sound levels.
 4. Wall mounted volume controls in meeting rooms and other District specified areas.

COMMUNICATIONS


CHAPTER 9: SPECIFICATIONS

1.9 INSTALLATION

- A. Install and balance the paging system volume levels according to ambient noise levels.
- B. Integrate with Telephone System PABX for access to zone paging and intercom (if applicable) functions.
- C. Establish building paging zones as directed by the School District.
- D. Provide programming and setup of paging zones, signal priorities, and bell (time tone) schedule.
- E. Connect to building antenna (if applicable) and ground in accordance with NEC and TIA/EIA-607.
- F. Install in accordance with manufacturer's installation instructions and recommendations.

1.10 TRAINING


- A. Provide eight (8) hours training for school and district personnel on the operation, programming, and maintenance of the system.
- B. Provide two (2) video copies of all training.

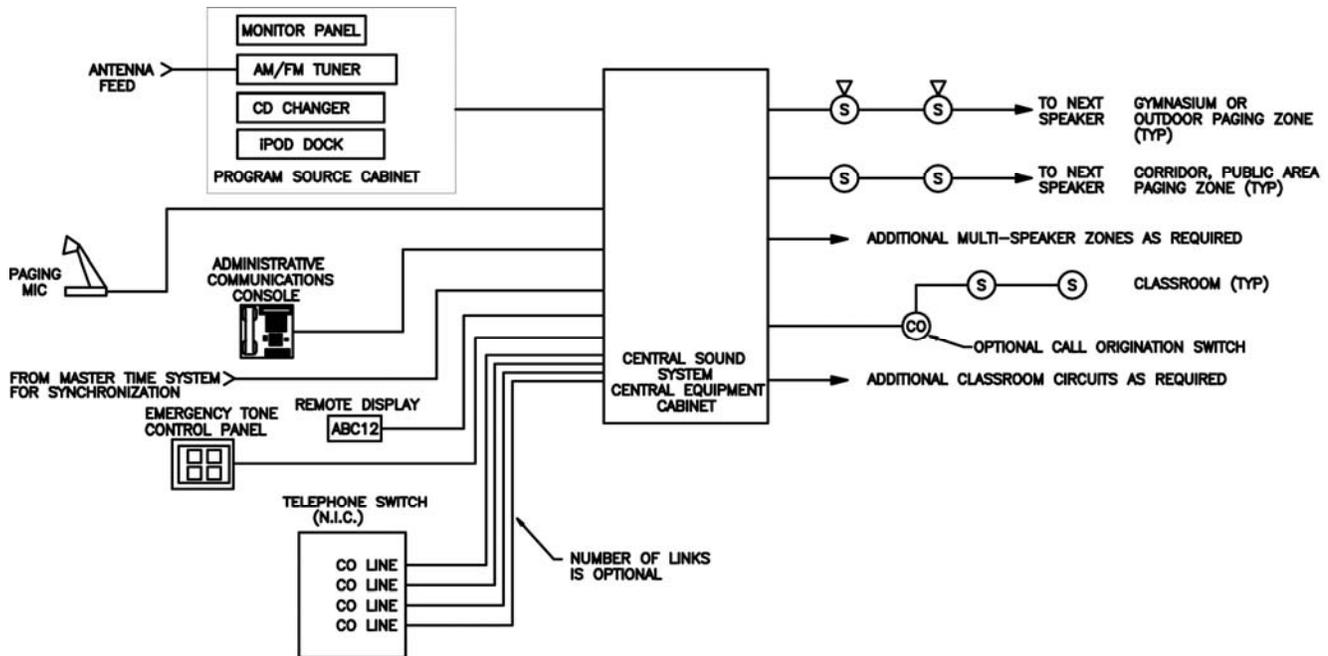

CENTRAL SOUND/INTERCOM SYSTEM DIAGRAM (BASELINE SYSTEM)

SCALE: NONE (RE: 27 51 23A)


NOTE: THIS DIAGRAM IS SCHEMATIC IN NATURE ONLY. IT IS INTENDED TO SHOW GENERAL CONFIGURATION OF THE SYSTEM. MODIFY TO ACCOMMODATE DESIGN PREFERENCES, OWNER NEEDS AND PROJECT CONDITIONS.

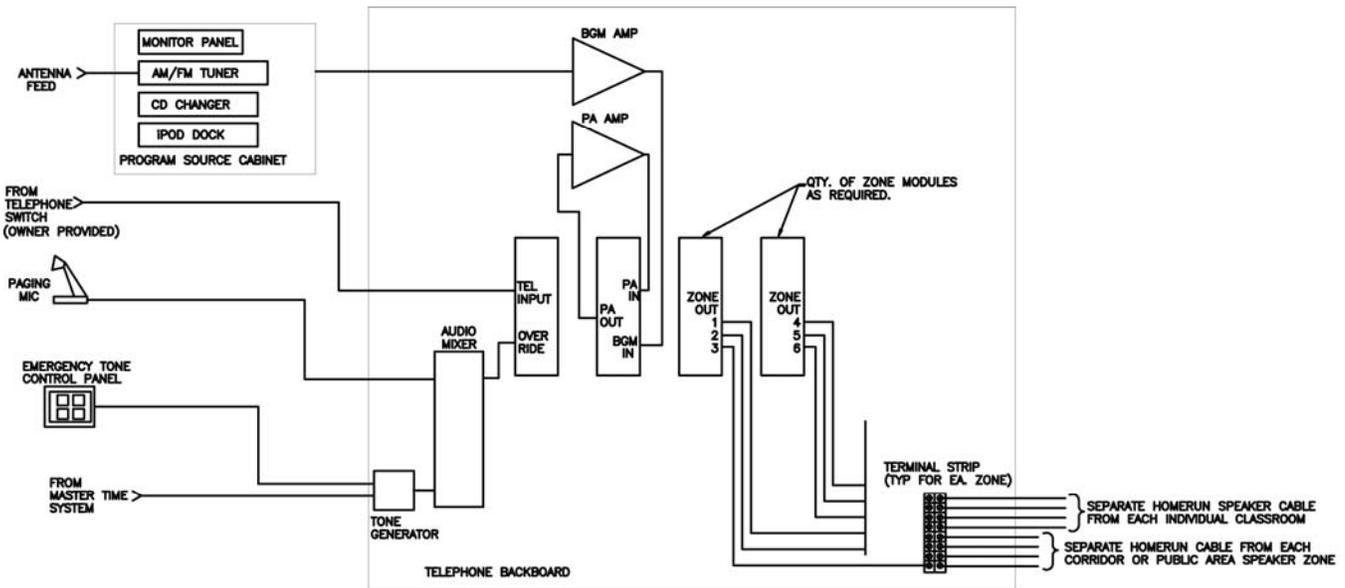

CENTRAL SOUND PAGING/PROGRAM DISTRIBUTION SYSTEM DIAGRAM – PASSIVE SPEAKERS

SCALE: NONE (RE: 27 51 23B) (OPTIONAL – REQUIRES VARIANCE)

NOTE: THIS DIAGRAM IS SCHEMATIC IN NATURE ONLY. IT IS INTENDED TO SHOW GENERAL CONFIGURATION OF THE SYSTEM. MODIFY TO ACCOMMODATE DESIGN PREFERENCES, OWNER NEEDS AND PROJECT CONDITIONS.

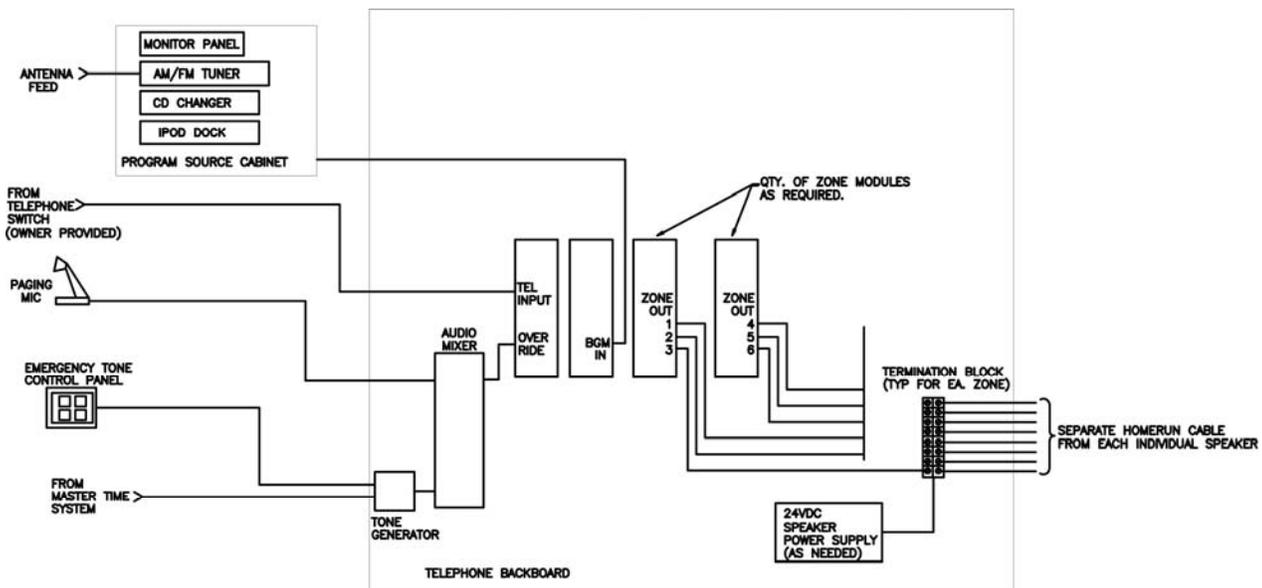

CENTRAL SOUND PAGING/PROGRAM DISTRIBUTION SYSTEM DIAGRAM – POWERED SPEAKERS

SCALE: NONE (RE: 27 51 23C) (OPTIONAL – REQUIRES VARIANCE)

NOTE: THIS DIAGRAM IS SCHEMATIC IN NATURE ONLY. IT IS INTENDED TO SHOW GENERAL CONFIGURATION OF THE SYSTEM. MODIFY TO ACCOMMODATE DESIGN PREFERENCES, OWNER NEEDS AND PROJECT CONDITIONS.

END OF SECTION

SECTION 275124

GYMNASIUM SOUND REINFORCEMENT SYSTEM

GENERAL GUIDELINES

1.1 GENERAL

- A. This section defines the general design requirements for a uniform Gymnasium Sound Reinforcement System that shall be followed for all OSFC Technology construction projects – High School, Middle School, and Elementary School facilities.
- B. The variations as related to school type are defined in Parts 2 and 3 of this guideline.
- C. Refer to Section 8500, Technology Systems, for additional information.

1.2 SECTION INCLUDES

- A. Gymnasium Sound Reinforcement System and all related components.

1.3 QUALITY ASSURANCE

- A. NFPA 70 - National Electrical Code.
- B. Underwriter's Laboratory.
- C. TIA/EIA-607 Telecommunications Grounding.
- D. ***Eleventh*** Edition (or latest) BICSI Telecommunications Distribution Methods Manual (TDMM).
- E. Americans with Disabilities Act (ADA).
- F. Federal Communications Commission Part 15.
- G. Sound System Engineering (Davis & Patronis) – 3rd Edition 2006.
- H. Audio Systems Design and Installation (Giddings) 1990.

1.4 SYSTEM WARRANTY

- A. The Gymnasium Sound Reinforcement System shall be warranted by the contractor for a period of one (1) year from date of substantial completion.

1.5 RELATED SECTIONS

- A. Specification section 274117 – Broadband Video RF Distribution System

1.6 MATERIALS

- A. Stationary Main Equipment Cabinet with the following rack mounted equipment:
1. Mixer/Preamplifier
 2. Power Amplifier(s)
 3. Digital Signal Processor(s)
 - a) RS-232 Interface for Configuration and Tuning
 - b) Equalization Filters – graphic and/or parametric
 - c) Compressor/Limiter
 - d) Digital Delay for cluster alignment
 - e) High and Low Pass and Shelving Filters
 - f) Feedback Suppression (may be incorporated in DSP or a stand-alone unit)
 - g) Crossover (if bi-amplified speaker system is utilized)
 - h) Selectable scene presets
 4. AM/FM radio tuner
 5. **Digital audio recording device.**
 6. Assistive Listening Transmitter (provide with ADA-compliant quantity of receivers)
 7. Sequencing AC Power Control System
 8. Passive or Active thermal control
- B. Mobile Equipment Cabinet shall contain the following equipment for mic level signal insertion into a wall or floor mounted microphone jack:
1. Rack-mounted mixer with mic level output
 2. Wireless microphone receiver with handheld and/or lavalier microphone
 3. CD/CD-R/CD-RW/MP3 Player
 4. i-Pod Docking Station
 5. Input/output jack panel
 6. AC power distribution panel
 7. Note: In Middle and Elementary School Gymnasium systems, the mobile equipment cabinet may be eliminated with the associated components being located in the Stationary Equipment Cabinet.
- C. Speaker cluster or distributed speakers suspended from structure.
1. Middle School and Elementary School Gymnasium speaker systems shall provide even coverage of both the entire floor area and seating areas.
 2. High School Gymnasium speaker systems shall provide switchable speaker zones as follows: Home Bleachers, Visitors Bleachers, Floor, and Mezzanine (where applicable). The zone selection shall be performed via selector switches in the Stationary Equipment Cabinet.
- D. Microphone input jack at scorer's table.
- E. Distributed mic/aux level input jacks on end walls –OR- mic level input jacks only (provide with aux/line level-to-microphones level direct box(es)).

1.7 INSTALLATION

- A. Install and balance system. Adjust all sound levels for desired operation levels and evenness of coverage.

COMMUNICATIONS

CHAPTER 9: SPECIFICATIONS

- B. Adjust all wireless equipment and verify coverage areas.
- C. Check polarity of all speakers and adjust all microphone and source input levels.
- D. Connect FM Tuner to external, building mounted FM Antenna and Distribution System. Ground Antenna in accordance with NEC and TIA/EIA-607. –OR- Receive radio reception from Distributed Broadband RF system as specified in another spec section.
- E. Ground equipment cabinet and associated equipment to cabinet-mounted telecommunications grounding buss bar in accordance with NEC and TIA/EIA-607.
- F. Install in accordance with manufacturer's installation instructions and recommendations.


1.8 PERFORMANCE TESTING

- A. Frequency response: 100Hz – 14kHz +/- 3 dB
- B. Loudness: High School Varsity Gym: At least 100dB-SPL program level with an additional 6dB Crest factor; Middle, Elementary School and Auxiliary Gym: At least 90dB-SPL program level with an additional 6 dB Crest factor
- C. Evenness of coverage: Variation of less than +/- 3 dB (400Hz to 4000Hz) at all seats.

1.9 TRAINING

- A. Provide minimum eight (8) hours training for District's personnel on the operation and maintenance of the system.
- B. Provide two (2) video copies of all training.


(See diagrams on next page)

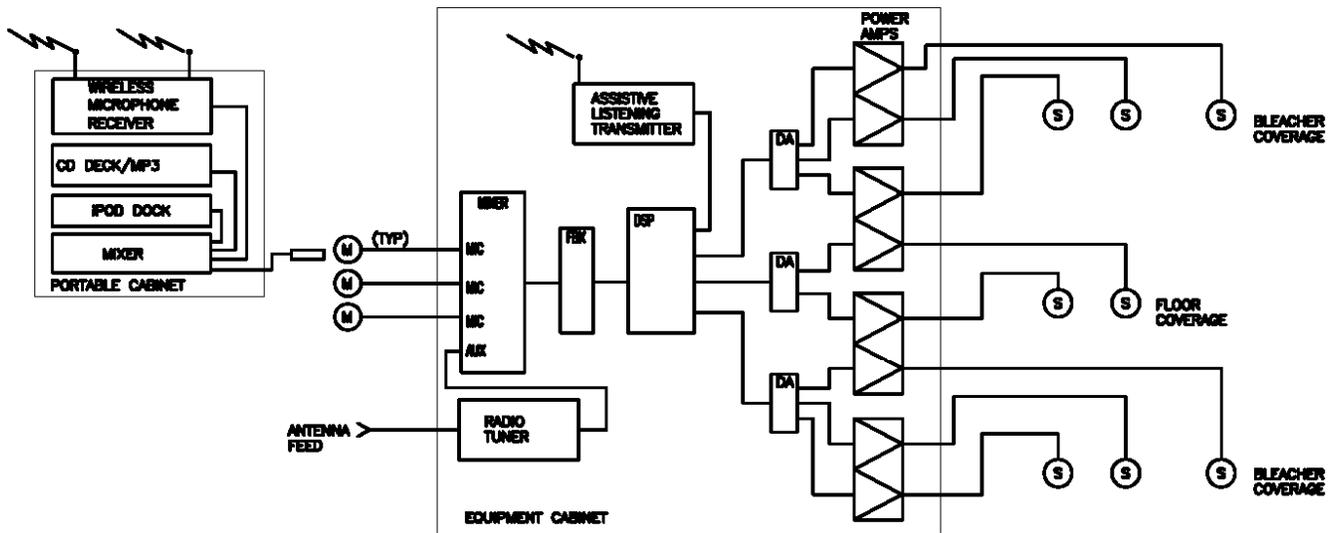

HS GYMNASIUM SOUND SYSTEM DIAGRAM

SCALE: NONE (RE: 27 51 24A)

NOTE: THIS DIAGRAM IS SCHEMATIC IN NATURE ONLY. IT IS INTENDED TO SHOW GENERAL CONFIGURATION OF THE SYSTEM. MODIFY TO ACCOMMODATE DESIGN PREFERENCES, OWNER NEEDS AND PROJECT CONDITIONS.

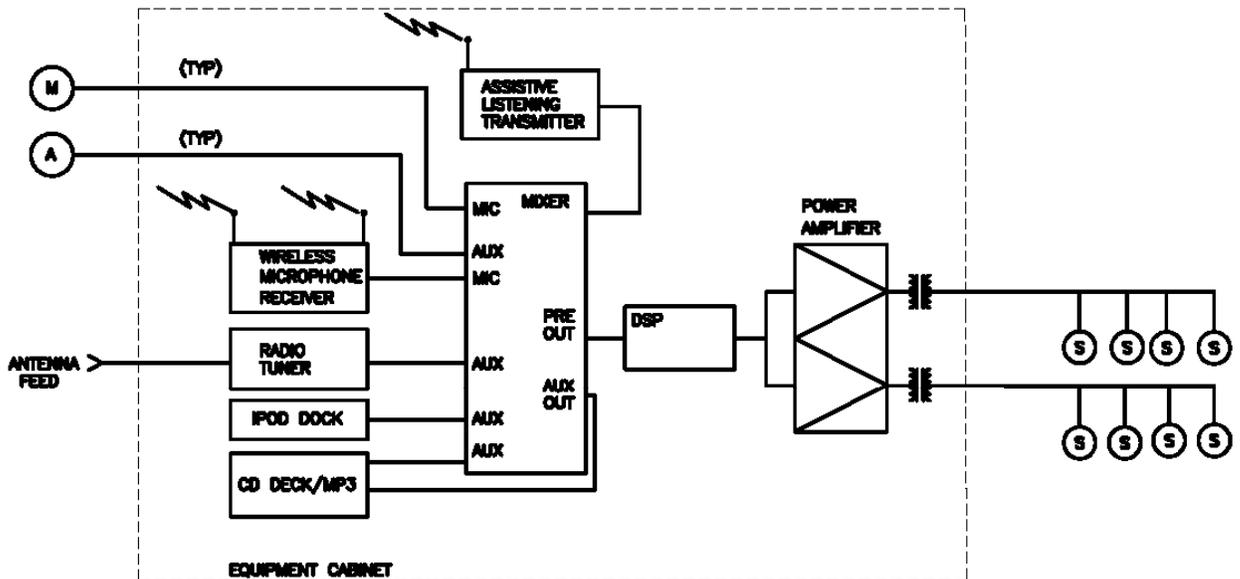

MS/AUX GYMNASIUM SOUND SYSTEM DIAGRAM

SCALE: NONE (RE: 27 51 24B)

NOTE: THIS DIAGRAM IS SCHEMATIC IN NATURE ONLY. IT IS INTENDED TO SHOW GENERAL CONFIGURATION OF THE SYSTEM. MODIFY TO ACCOMMODATE DESIGN PREFERENCES, OWNER NEEDS AND PROJECT CONDITIONS.

END OF SECTION

SECTION 275125

MUSIC ROOM AUDIO PROGRAM PLAYBACK SYSTEM - MIDDLE SCHOOL

GENERAL GUIDELINES

1.1 GENERAL

- A. Refer to Section 8500, Technology Systems, for additional information.

1.2 SECTION INCLUDES

- A. Music room sound system and components for playback of audio program material.

1.3 QUALITY ASSURANCE

- A. NFPA 70 - National Electrical Code.
- B. Underwriter's Laboratory.
- C. TIA/EIA-607 Telecommunications Grounding.
- D. **Eleventh** Edition (or latest) BICSI Telecommunications Distribution Methods Manual (TDMM).
- E. American with Disabilities Act.
- F. Federal Communications Commission Part 15.
- G. Sound System Engineering (Davis & Patronis) – 3rd Edition 2006.
- H. Audio Systems Design and Installation (Giddings) 1990.

1.4 SYSTEM WARRANTY

- A. The Sound System shall be warranted by the contractor for a period of one (1) year from date of substantial completion.

1.5 MATERIALS


- A. Mobile or permanently mounted main equipment rack.
 1. Stereo Mixer or Source Selection Device – rack-mounted.
 2. Dual channel Amplifier.
 3. Dual channel octave band equalizer.
 4. **CD/CD-R/CD-RW/MP3 Player.**
 5. **i-Pod Docking Station.**
 6. Input Jack panel for insertion of external sources.
- B. Wall mounted or tripod mounted speakers – stereo pair.
- C. Wall-mounted speaker jack plate – for connection of amplifier in mobile rack to permanently-mounted speakers.

1.6 INSTALLATION

- A. Install and balance system volume levels.
- B. Check polarity of all speakers.
- C. Install in accordance with manufacturer's installation instructions and recommendations.

1.7 TRAINING

- A. Provide four (4) hours training for District's personnel on the operation and maintenance of the system.
- B. Provide two (2) video copies of all training.

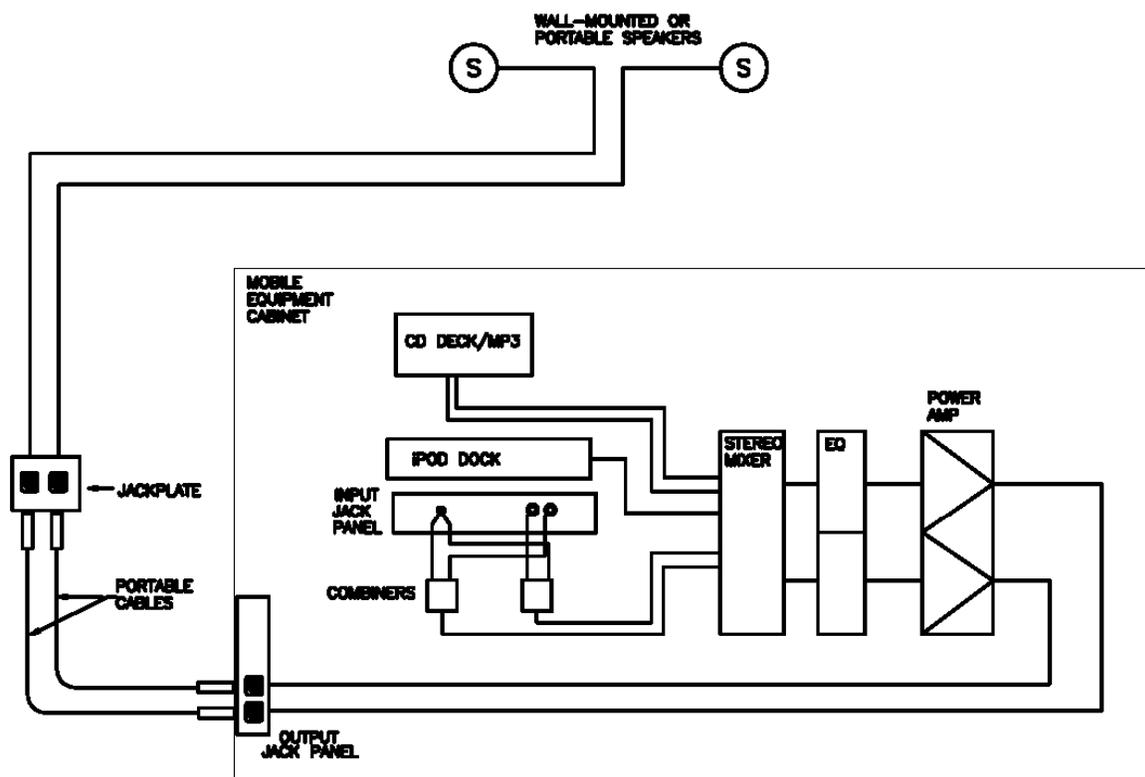

NOTE: SINGLE MOBILE EQUIPMENT CABINET SHARED BETWEEN VOCAL & INSTRUMENTAL ROOMS.

NOTE: THIS DIAGRAM IS SCHEMATIC IN NATURE ONLY. IT IS INTENDED TO SHOW GENERAL CONFIGURATION OF THE SYSTEM. MODIFY TO ACCOMMODATE DESIGN PREFERENCES, OWNER NEEDS AND PROJECT CONDITIONS.

MS MUSIC ROOM PLAYBACK SYSTEM DIAGRAM

2009.09.08 (REV. 27 51 25)

END OF SECTION

SECTION 275126

MUSIC ROOM AUDIO RECORDING/PLAYBACK SYSTEM - HIGH SCHOOL

GENERAL GUIDELINES

1.1 GENERAL

- A. Refer to Section 8500, Technology Systems, for additional information.

1.2 SECTION INCLUDES

- A. Music room sound system and components for recording and playback of audio program material.

1.3 QUALITY ASSURANCE

- A. NFPA 70 - National Electrical Code.
- B. Underwriter's Laboratory.
- C. TIA/EIA-607 Telecommunications Grounding.
- D. Eleventh Edition (or latest) BICSI Telecommunications Distribution Methods Manual (TDMM).
- E. American with Disabilities Act.
- F. Federal Communications Commission Part 15.
- G. Sound System Engineering (Davis & Patronis) – 3rd Edition 2006.
- H. Audio Systems Design and Installation (Giddings) 1990.

1.4 SYSTEM WARRANTY

- A. The Sound System shall be warranted by the contractor for a period of one (1) year from date of substantial completion.

1.5 MATERIALS

- A. Mobile or permanently mounted main equipment rack.
 1. Stereo microphone mixer/pre-amplifier – rack-mounted.
 2. Recording Input patch panel for insertion of external microphones or mixing consoles.
 3. Stereo program playback mixer or source selection device – rack-mounted.
 4. Program source, playback patch panel for insertion of external playback devices.
 5. Dual channel amplifier.
 6. Dual channel, octave band equalizer.
 7. CD/CD-R/CD-RW/MP3 Player


8. i-Pod Docking Station.
 9. **Digital audio recording device**
 10. Stereo hanging and/or floor stand microphones as required.
- B. Wall mounted or tripod mounted speakers – stereo pair.
- C. Wall mounted speaker jack plate – for connection of amplifier in mobile rack to permanently mounted speakers.

1.6 INSTALLATION

- A. Install and balance system volume levels.
- B. Check polarity of all speakers and microphones.
- C. Install in accordance with manufacturer's installation instructions and recommendations.

1.7 TRAINING

- A. Provide four (4) hours training for District's personnel on the operation and maintenance of the system.
- B. Provide two (2) video copies of all training.

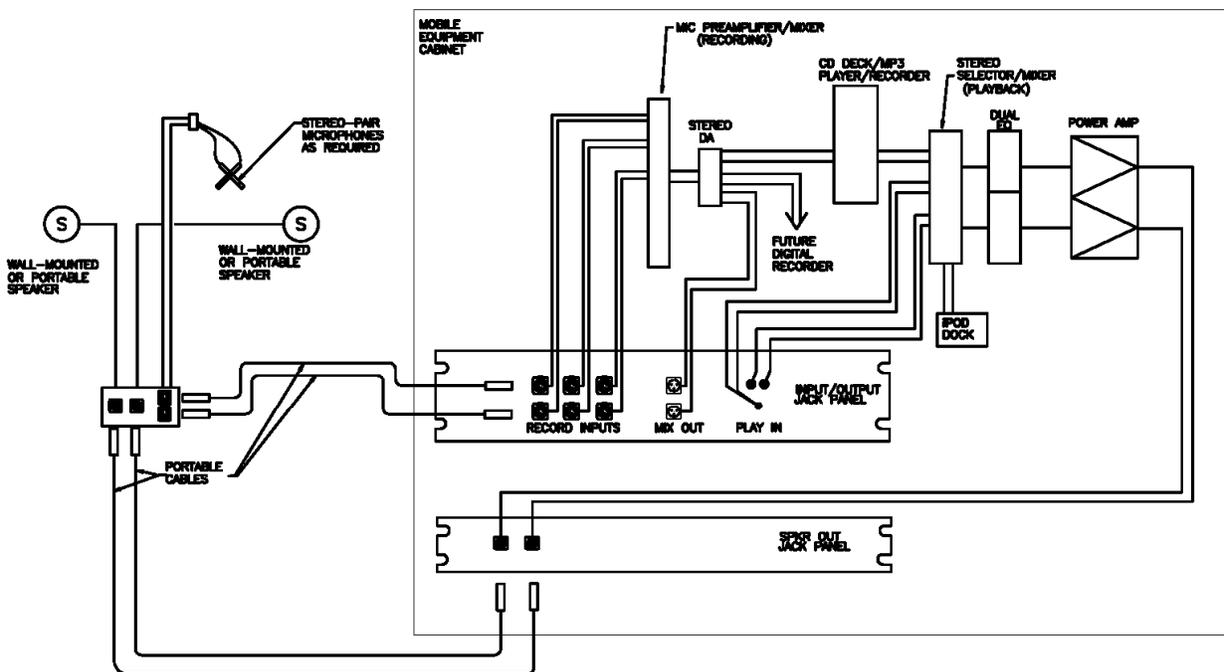

HS MUSIC ROOM RECORD/PLAYBACK SYSTEM DIAGRAM

SCALE NONE (RE: 27 51 28)

NOTE: THIS DIAGRAM IS SCHEMATIC IN NATURE ONLY. IT IS INTENDED TO SHOW GENERAL CONFIGURATION OF THE SYSTEM. MODIFY TO ACCOMMODATE DESIGN PREFERENCES, OWNER NEEDS AND PROJECT CONDITIONS.

END OF SECTION

SECTION 275127

CLASSROOM SOUND REINFORCEMENT SYSTEM

GENERAL GUIDELINES

1.1 GENERAL

- A. This Section defines the general design requirements for a uniform Classroom Sound Reinforcement System that shall be followed for all OSFC Technology construction projects.
- B. Refer to Section 8500, Technology Systems for additional information.

1.2 SECTION INCLUDES

- A. Classroom sound reinforcement system and components.

1.3 QUALITY ASSURANCE

- A. NFPA 70 – National Electrical Code.
- B. Underwriter's Laboratory.
- C. Latest ANSI TIA/EIA-568, 569, 606, 607 Standards and Eleventh Edition (or later).
- D. Eleventh Edition (or latest) BICSI Telecommunications Distribution Methods Manual (TDMM).
- E. American with Disabilities Act.
- F. Federal Communications Commission Part 15.

1.4 SYSTEM WARRANTY

- A. The Sound System shall be warranted by the contractor for a period of one (1) year from date of substantial completion.

1.5 CLASSROOM SOUND REINFORCEMENT SYSTEM

- A. **IR or RF** Receiver/Amplifier, equipped with:
 1. Minimum of 30-Watts RMS Watts total output.
 2. Minimum of 50-20 KHz frequency response.
 3. Two (2) **wireless** microphone input **channels** with individual volume controls.
 4. Tone Controls or Equalizer.
 5. Minimum of three (3) auxiliary line inputs with individual volume controls.
 6. Minimum of one (1) line output for optional ADA, wireless headphone system.
 7. System Power Supply.
 8. Power Switch.
 9. Minimum of two (2) **wireless microphone** frequencies.

10. Minimum of one (1) ceiling-mounted, Infrared **sensor or RF antenna** with plenum rated cabling.
11. One (1) Lavalier or collar microphone, with NiMH rechargeable batteries and charger.
12. One (1) Handheld microphone, with NiMH rechargeable batteries and charger.
13. Minimum of four (4) acoustical ceiling mounted, 360-degree dome speakers with all metal acoustical back enclosure and ceiling tile bridge, minimum 15-Watt capacity and minimum of 65-20KHz frequency response.
14. Receiver/Amplifier must be capable of being placed in Instructor's casework or cabinet mounted with no loss of infrared signal strength.
15. Unit must provide uniform pickup from the Instructor's **microphone** throughout the classroom.
16. Provide means for the central paging system to mute or override the classroom sound reinforcement system when a central page occurs.
17. **Both IR or encrypted RF technologies are acceptable, providing transmission does not interfere with reception in other rooms. Multi-channel, encrypted RF systems shall provide auto frequency selection.**

1.6 INSTALLATION

- A. Install in accordance with manufacturer's installation instructions.
- B. Per Speaker, provide minimum of 16 AWG, CMP rated speaker wire. Wire gauge based on cable lengths and power ratings.
- C. Route speaker wires through associated faceplate Space speakers in classroom to provide uniform coverage.
- D. For rooms using Overhead Mounted Projectors:
 1. Provide a wall bracket/shelf for mounting Infrared Receiver/Amplifier or mounted in cabinet or casework.
 2. Provide Line Level cabling from Instructor's PC, DVD/VHS Unit and MPEG Set-Top-Box Line Outputs to Auxiliary Line Inputs on Infrared Receiver/Amplifier.
 3. Balance and adjust all volume levels.
 4. Properly phase all speakers.
- E. Add additional speakers and infrared sensors in large classrooms, as required, to maintain complete coverage.
- F. Classroom Sound Reinforcement system shall be installed in all classrooms/labs for K-12.
- G. Classroom Sound Reinforcement system shall be integrated with the classroom A/V system.

1.7 TRAINING

- A. Provide four (4) hours training for District's personnel on the operation and maintenance of the system.
- B. Provide two (2) video copies of all training.

END OF SECTION

SECTION 275313

CLOCK SYSTEMS

GENERAL GUIDELINES

1.1 GENERAL

- A. This Section defines the general design requirements for a uniform Building-wide Synchronized Clock System that shall be followed for all OSFC Technology construction projects.
- B. The options are defined in Parts 2 and 3 of this guideline.
- C. Refer to Section 8500, Technology Systems, for additional information.

1.2 SECTION INCLUDES

- A. Master Clocks, Secondary Clocks and accessory components.

1.3 QUALITY ASSURANCE

- A. NFPA 70 – National Electrical Code
- B. Underwriter's Laboratory
- C. TIA/EIA-607 Telecommunications Grounding
- D. **Eleventh** edition (or latest) BICSI Telecommunications Distribution Methods Manual (TDMM)

1.4 SYSTEM WARRANTY

- A. The Clock System shall be warranted by the Contractor for a period of one (1) year from date of substantial completion.

1.5 RELATED SECTIONS

- A. Specification Section 275123 - Central Sound and Paging System

1.6 GENERAL

- A. Synchronized with the United States Atomic Clock via GPS receiver with external antenna, NTP Internet connection, **or CDMA.**
- B. Self-correcting for Daylight Savings Time changes.
- C. Analog Secondary Clocks:
 1. 12" diameter minimum, surface-mounted.
 2. Metal hour, minute, and second hands with impact resistant molded plastic case.

3. Corridors: Double-faced, securely mounted perpendicular to wall or ceiling mounted.
 4. Gymnasiums: 15" diameter minimum. Provide wire guards in gymnasiums, auxiliary gymnasiums, and locker rooms.
- D. Digital Secondary Clocks:
1. 2.3" height minimum, 4-digit, 7-segment LED display with metal case.
 2. Corridors: Double-faced with perpendicular wall or ceiling mount.
 3. Gymnasiums: 4" height minimum, 4-digit, 7-segment LED display with metal case. Provide wire guards in gymnasiums, auxiliary gymnasiums, and locker rooms.
 4. Optional Text Messaging capability.
- E. Master Clock with software-programmable, integral building bell schedule and audible tone generator with selectable tones to provide class change tones to input of Central Sound System.
1. Minimum of four (4) selectable, pre-programmed class change schedules, easily selectable from the main school office.
 2. Manual activation of audible tone from the main school office.
 3. Permanent or periodic temporary RS-232 connection to PC for data download update of class change schedules.
 4. NOTE: Where Central Sound Systems with built-in tone generator and programmable bell schedule function are utilized, the Master Clock need only to be able to synchronize time with the Central Sound System headend processor.

1.7 WIRELESS CLOCK SYSTEMS

- A. Battery-operated - minimum 5-year battery life
- B. Provide RF transmitters and antennas, as required to provide complete building-wide coverage.

1.8 WIRED CLOCK SYSTEMS

- A. Low-voltage power – 24V or less
- B. Central or distributed power supplies as required
- C. Optional IEEE 802.3af, Power Over Ethernet (POE) connectivity

1.9 INSTALLATION

- A. Securely mount the clocks flush on the walls in classrooms and office areas.
- B. Connect tone generator output to input of Central Sound System if function is not provided by that system.
- C. Synchronize time with the Central Sound System master clock if the tone generation and program schedule functions are provided by that system.
- D. Program initial bell schedules as provided by the Owner.

COMMUNICATIONSCHAPTER 9: SPECIFICATIONS

- E. Located schedule selection and manual bell activation functions in main school office.

1.10 TRAINING

- A. Provide four (4) hours training for School/District personnel on the operation, programming, and maintenance of the system.
- B. Provide two (2) video copies of all training.

END OF SECTION